



EA Engineering, Science,
and Technology, Inc., PBC

301 Metro Center Blvd, Suite 102
Warwick, Rhode Island 02886
Telephone: 401-736-3440
www.eaest.com

15 June 2023

Mr. Joseph T. Martella II, Senior Engineer
Site Remediation Program
Office of Waste Management
RI Department of Environmental Management
235 Promenade Street
Providence, RI 02908

*RE: Quarterly O&M Status Report No. 63
Alvarez High School, 333 Adelaide Avenue, Providence, Rhode Island
Case No. 2005-029
EA Project No. 15066.10*

Dear Mr. Martella:

On behalf of the City of Providence School Department (City), EA Engineering, Science, and Technology, Inc., PBC (EA) is providing this Quarterly Operations and Maintenance (O&M) Status Report in accordance with Provision 6(f) of the Order of Approval and amendments (Amended OA) for the referenced Alvarez High School site (the Site, formerly Adelaide Avenue High School).

This O&M Report summarizes recently completed Site activities related to compliance sub-slab vapor and indoor air sampling for the period from March 2023 through May 2023.

If you have any questions or require additional information, please contact me at (401) 287-0370.

Sincerely,

EA ENGINEERING, SCIENCE,
AND TECHNOLOGY, INC., PBC


Frank B. Postma, LSP, LEP, PG
Project Manager

cc: Superintendent, Prov. Dept. of Public Schools Director, Prov. Dept. of Public Property
A. DeGrace, Prov. Redevelopment Agency Knight Memorial Library Repository
R. Dorr, Neighborhood Resident Principal Biah, Alvarez High School
Rep. Scott Slater

This page intentionally left blank



Quarterly O&M Status Report No. 63

Summarizing Sub-slab Depressurization and Indoor Air Monitoring and Sampling Activities

**Alvarez High School Site
(Formerly Adelaide Avenue High School)
Providence, Rhode Island**

Prepared for

City of Providence School Department
797 Westminster Street
Providence, Rhode Island 02903

Prepared by:

EA Engineering, Science, and Technology, Inc., PBC
301 Metro Center Blvd., Suite 102
Warwick, Rhode Island 02886
(401) 736-3440

EA Project No. 15066.10
June 2023

This page intentionally left blank

TABLE OF CONTENTS

1.	INTRODUCTION AND BACKGROUND	1
2.	SUMMARY OF SSD SYSTEM AND INDOOR METHANE MONITORING SYSTEM PERFORMANCE	2
2.1	SSD SYSTEM AND RELATED MONITORING	2
2.1.1	Sub-Slab Monitoring.....	2
2.1.2	Rooftop Extraction Fans	3
2.1.3	Engineered Cap	3
2.2	INDOOR METHANE MONITORING SYSTEM	3
2.3	AMBIENT OUTDOOR AND INDOOR AIR SAMPLING	3
2.4	SUB-SLAB VAPOR SAMPLING AND EVALUATION OF POTENTIAL VOC REBOUND EFFECT	4
2.5	SUMMARY OF ROOFTOP VOC EMISSIONS	5
3.	CONCLUSIONS.....	7
4.	FUTURE ACTIVITIES AND NEXT QUARTERLY SUMMARY REPORT	8

FIGURES

- FIGURE 1: SITE LOCATION MAP
FIGURE 2: INDOOR AIR SAMPLING AND METHANE MONITORING SYSTEM DIAGRAM
FIGURE 3: AS-BUILT SUB-SLAB MONITORING AND SAMPLING PLAN
FIGURE 4: PARCEL C SHOTPUT & DISCUS THROWING FIELD

APPENDICES

- APPENDIX A: O&M FIELD FORMS
APPENDIX B: INDOOR AND AMBIENT OUTDOOR AIR ANALYTICAL SUMMARY
APPENDIX C: SUB-SLAB VAPOR ANALYTICAL SUMMARY
APPENDIX D: ROOFTOP EMISSION ANALYTICAL SUMMARY
APPENDIX E: INDOOR AIR, AMBIENT OUTDOOR AIR, AND SUB-SLAB VAPOR LABORATORY ANALYTICAL REPORTS
APPENDIX F: LABORATORY DETECTION LIMITS CORRESPONDENCE

This page intentionally left blank

1. INTRODUCTION AND BACKGROUND

On behalf of the City of Providence School Department (the City), EA Engineering, Science, and Technology, Inc., PBC (EA) has prepared this Quarterly Operations and Maintenance (O&M) Status Report No. 62 for the Parcel B area of the former Gorham Manufacturing site in Providence, Rhode Island, formerly referred to as Adelaide Avenue High School and now referred to as Alvarez High School (the Site). A Site Location Map is provided as Figure 1. This report has been prepared to satisfy provision 6(f) of the Rhode Island Department of Environmental Management (RIDEM) Order of Approval (OA) issued in June 2006, as amended in February 2007, July 2007, and July 2009. For the purposes of this report, the original and the amended OA will collectively be referred to as the Amended OA.

The Amended OA specifies the details of the approved remedy for the Site including, but not limited to, the installation of a sub-slab depressurization (SSD) system, installation of a continuous indoor air methane monitoring system, and implementation of an associated periodic monitoring and sampling program. In August 2007, the RIDEM-approved remedy for the Site was completed and a Remedial Action Closure Report (RACR) was submitted to RIDEM. In July 2009, the periodic indoor air and sub-slab vapor sampling schedule was reduced to quarterly sampling from previously required monthly sampling.

This report summarizes the O&M, monitoring, and sampling activities completed at the Site for the three-month period from March 2023 through May 2023 (Quarterly Reporting Period No. 63). Please refer to Quarterly O&M Status Reports No. 1 through No. 62 for information regarding monitoring and sampling at the Site during the previous quarters. The RACR and previously submitted monthly correspondence contain details regarding the results of the monitoring and sampling program for the period prior to Reporting Period No. 1.

2. SUMMARY OF SSD SYSTEM AND INDOOR METHANE MONITORING SYSTEM PERFORMANCE

2.1 SSD SYSTEM AND RELATED MONITORING

The following SSD system performance parameters were inspected and/or monitored at the frequencies indicated below in accordance with the Amended OA and through discussions with RIDEM to evaluate system performance:

- Monthly indoor air monitoring of vapor-phase constituents and methane (24 March 2023, 19 April 2023, and 24 May 2023) at 8 monitoring locations, as illustrated on the Indoor Air Sampling and Methane Monitoring System Diagram provided as Figure 2.
- Monthly sub-slab monitoring of vacuum pressure, vapor-phase constituents, and methane (24 March 2023, 19 April 2023, 24 May 2023) at 11 monitoring locations, as illustrated on the As-Built Sub-slab Monitoring and Sampling Locations provided as Figure 3.
- Monthly inspections and monitoring (air velocity and vacuum) of the three rooftop fans to verify proper operation and effluent concentrations.
- Monthly inspections of the electronic monitoring system associated with each of three SSD system extraction fans and the methane sensor system (automatic alarm notification via audible signal and phone notification).
- Monthly inspections of the RIDEM approved engineered cap.
- Quarterly sampling (19 April 2023) of eight indoor air locations, one ambient outdoor air location, and six sub-slab points.

Copies of O&M field forms summarizing SSD System monitoring data collected during this reporting period are provided in Appendix A.

2.1.1 Sub-Slab Monitoring

Vacuum measurements taken at each interior and perimeter sub-slab monitoring/sampling locations ranged from -0.15 to -0.01 in. of water column. Negative measurements confirm that a negative pressure was maintained beneath the building slab due to continuous fan operation. Rooftop fans were not able to be accessed in every monitoring event due to safety and weather reasons. When rooftop fans were observed, they were observed to be operating correctly during this reporting period; pressure and air velocity recorded at all rooftop fans were within normal ranges.

2.1.2 Rooftop Extraction Fans

The pressure sensors on each rooftop fan are connected to an alarm panel and autodialer system, which is triggered when a change in pressure is detected in the rooftop exhaust fans. The exhaust fan alarm system is connected to back-up battery packs in the control panel, which have sufficient capacity to operate for multiple days in the event of an electrical outage or power disruption to the system. Negative fan vacuums, fan speeds, and the negative sub-slab pressures observed at the site were within normal ranges and the system is operating properly. No alarm triggers occurred in this 3-month period.

2.1.3 Engineered Cap

The engineered cap appeared in good condition. Previously eroded areas of the cap on Parcel B were filled with clean loam and seeded on 7 July 2022. EA will continue to monitor the cap for any future deficiencies.

In April 2020, the City installed two 10-foot (ft) by 20-ft by 4-in thick concrete throwing pads in the southwestern corner of Parcel C on the grassed recreation field between Dr. Jorge Alvarez High School and Mashapaug Pond. The pads were constructed in accordance with the Temporary Parcel C Cap Disturbance Notification letter submitted to RIDEM on 31 March 2020. The concrete pads remain in place as part of the engineered cap and concrete pad inspections have been incorporated into the routine monitoring events. The concrete pads appeared to be in good condition and no cracks or chips were observed. Shotput and discus landing zones also appeared in good condition and no erosion damages to the cap were present. A site plan depicting the location of the shotput and discus throwing pads is included as Figure 4.

Any future landscaping work at Alvarez High School (Parcel B), and/or the shot-put and discus throwing field (Parcel C) must adhere to the Soil Management Plan and the Amended OA to ensure the engineered cap is not damaged and the protective cover soil layer is maintained. EA will continue to inspect the pads on a monthly basis and report findings and routine maintenance in the Quarterly O&M Status Reports.

2.2 INDOOR METHANE MONITORING SYSTEM

Indoor methane concentrations were monitored by an indoor methane monitoring system equipped with automatic alarm notification via audible signal and phone notification within the school at eight RIDEM-approved locations (refer to the Indoor Air Sampling and Methane Monitoring System Diagram provided as Figure 2) during this reporting period. The methane monitoring system was inspected during each monitoring event and the filters were replaced on 19 April 2023. The next filter replacement is scheduled for July 2023.

2.3 AMBIENT OUTDOOR AND INDOOR AIR SAMPLING

Eight indoor air samples and one ambient outdoor air sample were collected at the site at RIDEM-approved sampling locations during the quarterly sampling event on 19 April 2023. The

samples collected in April 2023 were submitted to Con-Test Analytical Laboratory (Con-Test) for analysis of VOCs via Method TO-15 Selective Ion Monitoring (SIM). Each summa canister used during this monitoring period was individually certified to ensure that all containers were devoid of residual contamination. The typical summa canister certification process occurs in batches. However, individual certification was requested by RIDEM for this and future sampling events after residual contamination affected the 1 August 2014 sampling results.

Sample results were compared to the State of Connecticut's Draft Proposed Indoor Residential Targeted Air Concentrations (CT RTACs) and the RIDEM approved threshold level in accordance with the Amended OA. Sampling locations for the indoor air samples are illustrated on Figure 3. The 19 April 2023 ambient outdoor air sample was collected downwind (west-southwest) of the school. A data summary table is provided as Appendix B and a copy of the laboratory data report associated with this sampling event is provided in Appendix E.

There were no exceedances of the CT RTACs and RIDEM threshold levels during the 19 April 2023 quarterly sampling event.

The MDLs for four VOCs reported via TO-15 analysis were greater than the respective CT RTACs/RIDEM threshold levels even though analysis was performed using the method with the lowest available detection levels (SIM procedure). The elevated MDLs occurred for bromodichloromethane, 1,1,2,2-tetrachloroethane, 1,1,1,2-tetrachloroethane, and 1,2-dibromomethane. These analytes have either never been or are rarely detected in indoor air at concentrations greater than the applicable standards. Therefore, the slightly elevated MDLs for some analytes were not considered significant and do not disqualify the dataset. Refer to Appendix F for an MDL verification letter from Con-Test verifying that where MDLs are not able to be met, the detection limit was the lowest currently achievable.

2.4 SUB-SLAB VAPOR SAMPLING AND EVALUATION OF POTENTIAL VOC REBOUND EFFECT

A total of 11 RIDEM-approved sub-slab sampling locations are installed at the Site. Six sub-slab samples were collected on the rotating schedule in accordance with the Amended OA and analyzed for VOCs via US EPA Method TO-15 SIM. Two interior sub-slab vapor samples and four exterior sub-slab vapor samples were collected on 19 April 2023. The sub-slab analytical results are presented in Appendix C and a copy of the laboratory data report associated with this sampling event is included in Appendix E. The locations for sub-slab sampling are illustrated on Figure 3.

The sub-slab data has been evaluated for potential rebound. No evidence of increasing VOCs (i.e., VOC rebound) beneath the school has been observed. Slight fluctuations in concentrations were noted during this reporting period though these variations were within historical ranges and do not constitute an increasing trend.

2.5 SUMMARY OF ROOFTOP VOC EMISSIONS

Previous rooftop effluent sampling rounds conducted in March 2007 (immediately after SSD system startup), June 2007, June 2008, September 2009, and annually in July thereafter (2010 – 2022) indicated compliance with all Air Pollution Control Permit Applicability Thresholds. Additionally, in October 2014 RIDEM conducted roofline and downwind outdoor air sampling to determine if rooftop fan exhaust was possibly infiltrating the building or impacting downwind air. The roofline and downwind sample concentrations were approximately the same as the upwind sample concentration and significantly lower than those concentrations observed in the rooftop fan exhaust, indicating that exhausted vapors from the rooftop fans were well dispersed and are not causing significant impacts downwind or inside the building.

The Amended OA requires that rooftop VOC sampling be completed on an annual basis. Concentrations of VOCs in rooftop fan vents continue to be evaluated based on the regulatory thresholds and their effect to background air at the school and the nearby residential neighborhood. Rooftop fan sampling was conducted on 28 July 2022. No exceedances of the RIDEM Air Pollution Control Permit Applicability Thresholds for hourly, daily, or annual emissions were observed. A summary of historical rooftop fan emission data is summarized in Table 1 below.

Table 1 Annual Rooftop Fan Emissions

Annual Monitoring Date	Total Emissions ^a (lbs/year)
-	RIDEM Threshold: 50,000 ^b
20 July 2012	3.30
9 July 2013	2.33
1 August 2014	2.49
22 October 2014	1.83
21 July 2015	2.01
20 July 2016	2.34
26 July 2017	1.41
27 July 2018	0.652
29 July 2019	2.15
23 July 2020	0.829
21 July 2021	0.388
28 July 2022	1.24

^a Sum of all three rooftop fan emissions; emissions based on measured flow speed and EPA Method TO15-SIM air sample analysis
^b RIDEM Air Pollution Control Regulation No. 9 [Amended April 2004]
 RIDEM = Rhode Island Department of Environmental Management
 lbs/year = pounds of gas per year

All emissions are below the RIDEM Air Pollution Control Regulations. Fluctuations in emissions were observed in the 27 July 2018 and 28 July 2022 samples. One possible explanation for this variability may be fluctuating depths to the groundwater table in the vicinity of the school; as the depth to groundwater increases, soil gas emissions to the extraction system

are anticipated to decrease due to reduced pressure from the capillary fringe. Full analytical results of rooftop fan sampling are summarized in Appendix D and Quarterly Monitoring Reports No. 1 – No. 60. The next annual rooftop effluent VOC sampling event is scheduled for July 2023.

3. CONCLUSIONS

The following conclusions are made based upon the completed inspections, monitoring, and sampling performed during this reporting period:

- The consistent negative pressure maintained below the floor slab indicates that soil vapor intrusion into Alvarez High School is not occurring.
- The continuous operation of the SSD System and confirmation of continuous sub-slab vacuum beneath the school illustrates ongoing, effective operation of the SSD System.
- Previously eroded areas on the engineered cap were repaired in July 2022 and appear to be in good condition.
- The concrete pads and throwing areas on Parcel C appeared to be in good condition and no signs of cap degradation or erosion were observed.
- The sub-slab data was evaluated for potential rebound in accordance with the Amended OA. No evidence of increasing VOCs (i.e., VOC rebound) beneath the school has been observed. Fluctuations in concentrations were noted during this reporting period; these variations do not constitute an increasing trend.
- The use of certified clean summa canisters, as requested by RIDEM, yielded confidence in the samples collected in April 2023. EA will continue to use certified clean canisters in the upcoming sampling events.

4. FUTURE ACTIVITIES AND NEXT QUARTERLY SUMMARY REPORT

The following activities will be completed in accordance with the Amended OA during the next quarterly status reporting period from June 2023 to August 2023:

- Continuous monitoring of the operational status of the three rooftop extraction fans;
- Monthly site inspections and monitoring using a calibrated photoionization detector with part-per-billion sensitivity and a Landtec multi-gas meter;
- Collection of air samples from eight indoor locations, one ambient outdoor location, and six sub-slab monitoring points in July 2023;
- The engineered cap on Parcel B as well as the concrete throwing pads on Parcel C will be inspected during the routine monthly sub-slab inspections and reported in future Quarterly O&M reports;
- Any future landscaping projects and erosion repairs by the City must be conducted in accordance with the site specific Soil Management Plan and the Amended OA to prevent damage to the engineered cap.

These activities will be summarized in the next status report (Quarterly Status Report No. 64), expected to be submitted by the end of September 2023.


FIGURES



ALVAREZ HIGH SCHOOL
333 ADELAIDE AVENUE
PROVIDENCE, RHODE ISLAND

FIGURE 1
SITE LOCUS

PROJECT MGR:	DESIGNED BY:	CREATED BY:	CHECKED BY:	SCALE:	DATE:	PROJECT NO:	FILE NO:
FP	PT	PT	FP	1:24,000	FEBRUARY 2010	14687.01	SITE_LOCUS.MXD

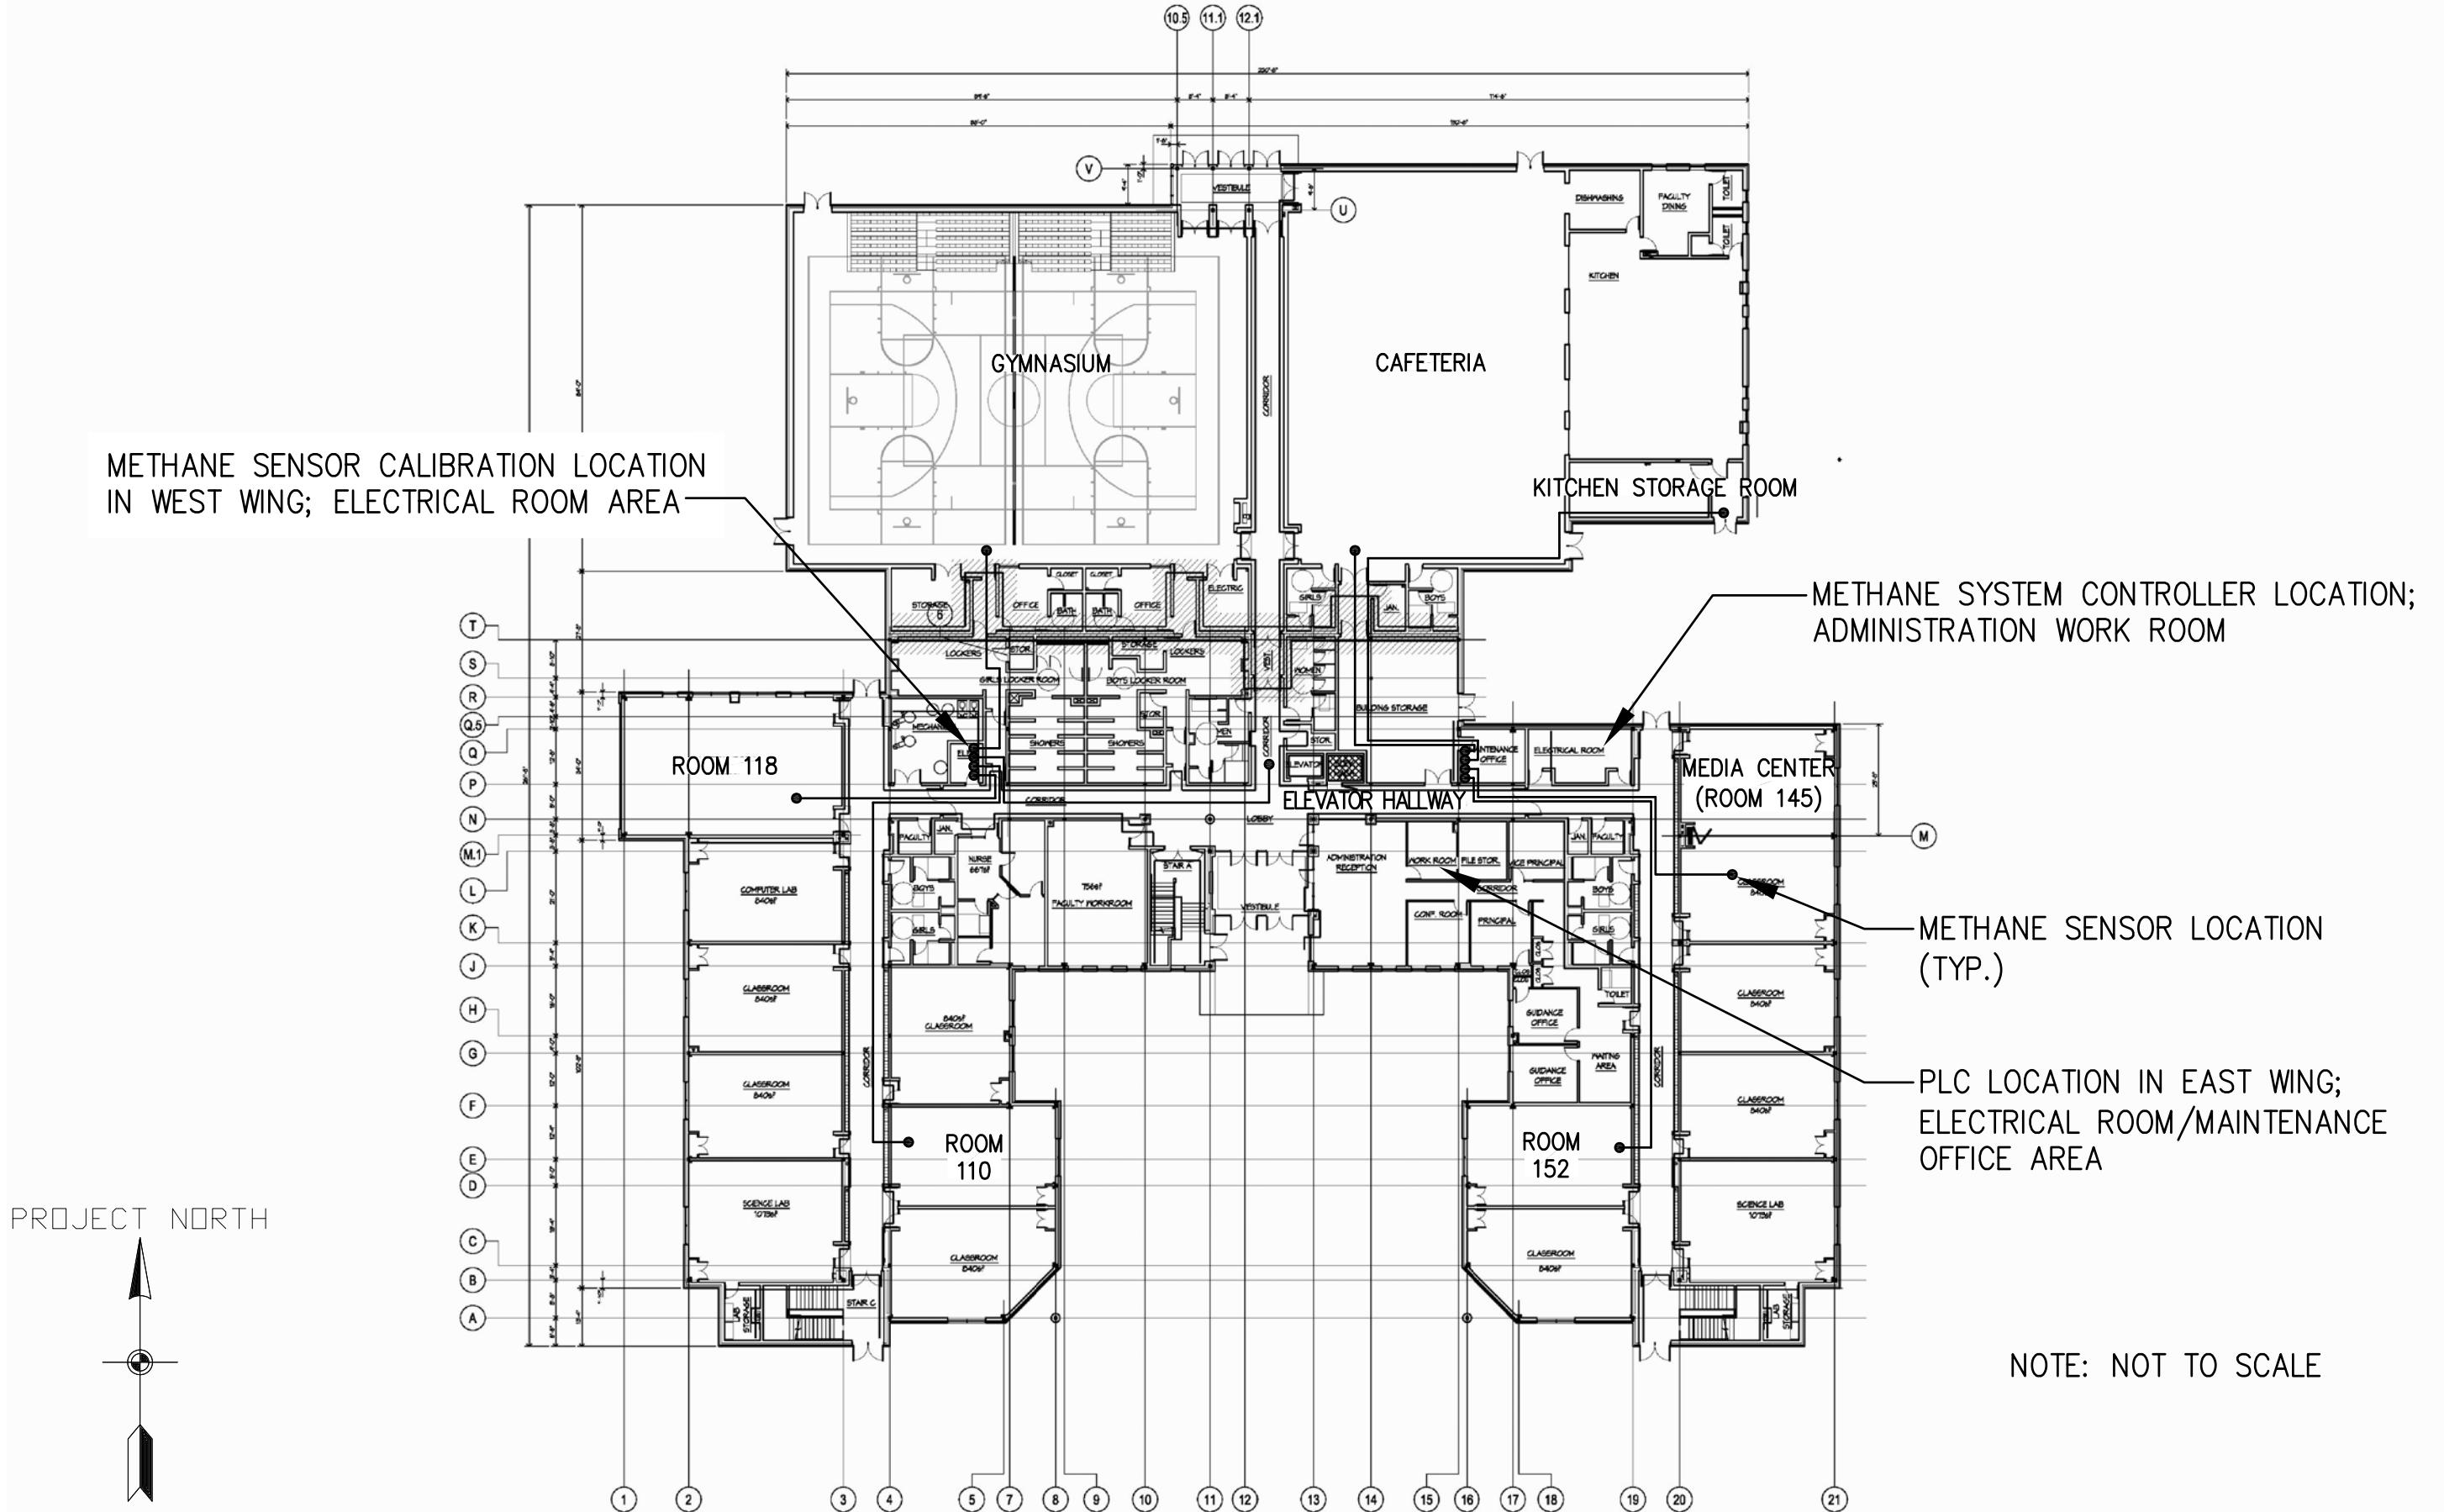

NOTE: NOT TO SCALE




DESIGNED BY RGM	DRAWN BY DPA	DATE OCT. 16, 2013	PROJECT NO. 15066.01	FILE NAME ALVAREZ LAYOUT
CHECKED BY ERP	PROJECT MGR. ERP	SCALE NTS	DRAWING NO. —	FIGURE 2

INDOOR AIR SAMPLING AND METHANE MONITORING
SYSTEM DIAGRAM — ALVAREZ HIGH SCHOOL
PROVIDENCE, RHODE ISLAND

QUARTERLY STATUS REPORT FIGURE 2

LEGEND:

- SUB-SLAB MONITORING POINT
- INTERIOR SUB-SLAB MONITORING POINT
- +— SLOTTED 1 INCH PVC PIPING
- ◆ ROOFTOP FAN LOCATION
- SP-1 SSD SYSTEM SUCTION PIT
- +— SOLID 4 INCH PVC PIPING

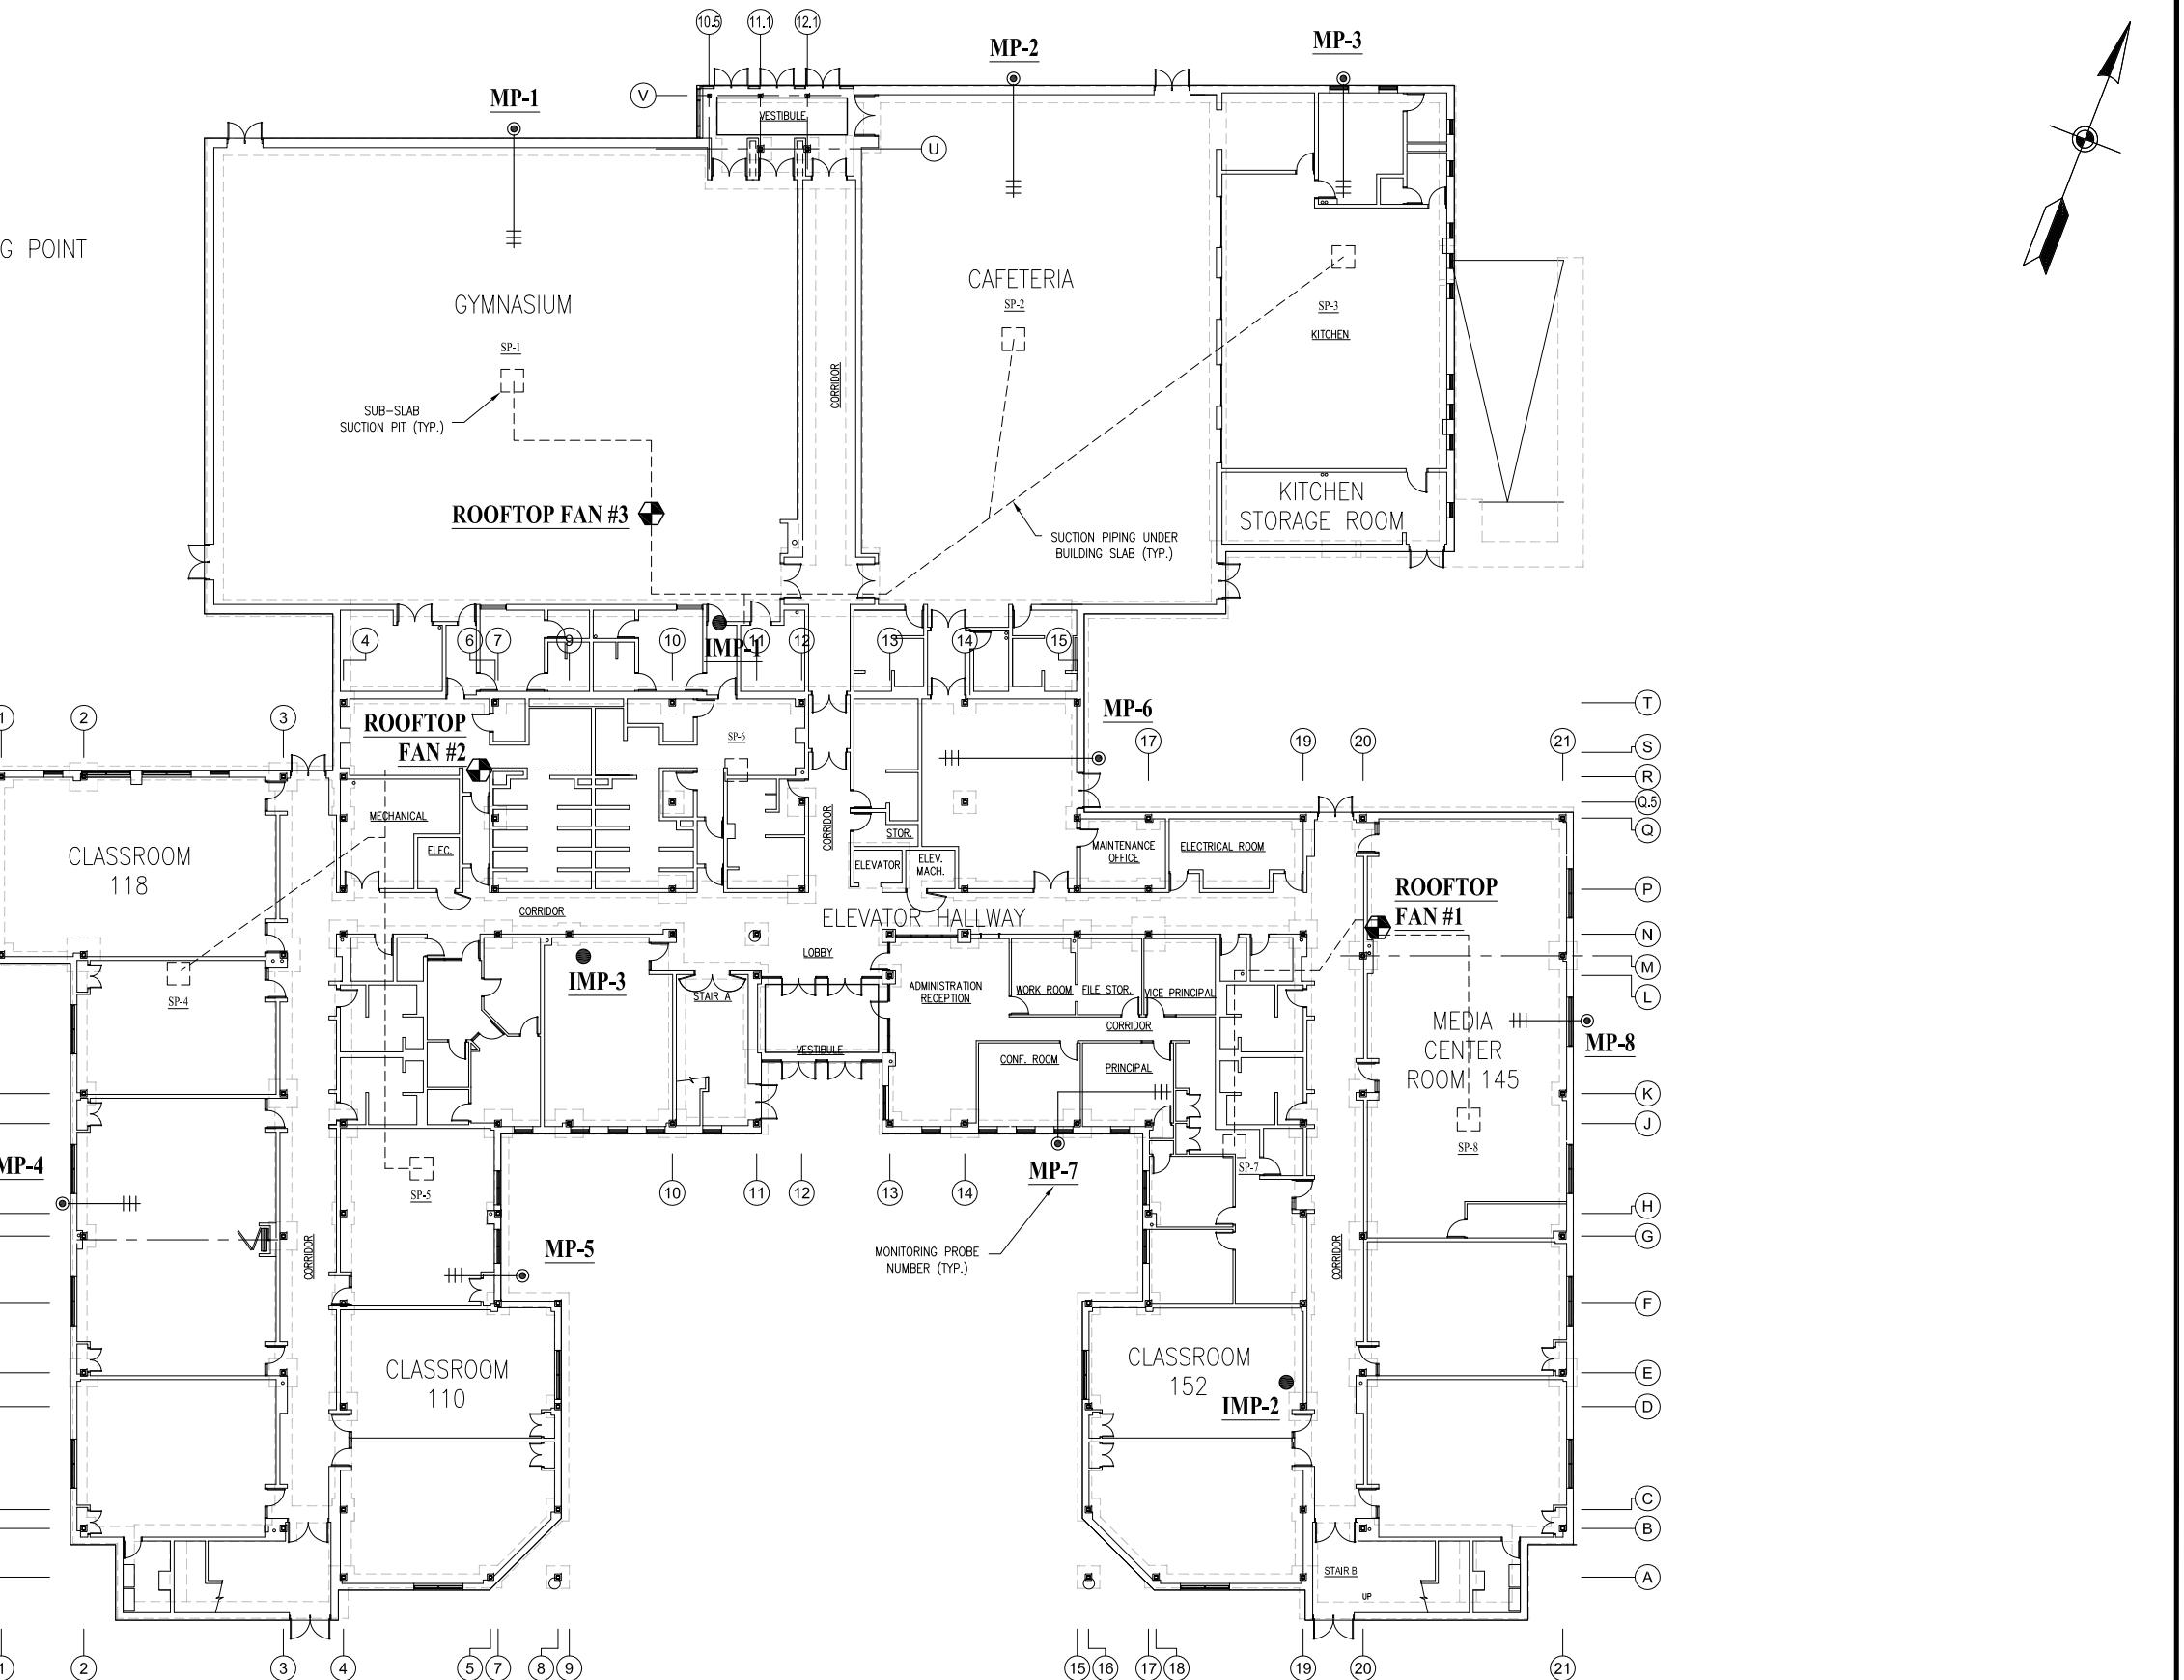

DESIGNED BY RGM	DRAWN BY DPA	DATE OCT. 16, 2013	PROJECT NO. 15066.01	FILE NAME FIG 3
CHECKED BY FBP	PROJECT MGR. FBP	SCALE NTS	DRAWING NO. N/A	FIGURE 3

AS-BUILT
SUB SLAB MONITORING AND SAMPLING LOCATIONS
ALVAREZ HIGH SCHOOL
PROVIDENCE, RHODE ISLAND

QUARTERLY STATUS REPORT
FIGURE 3

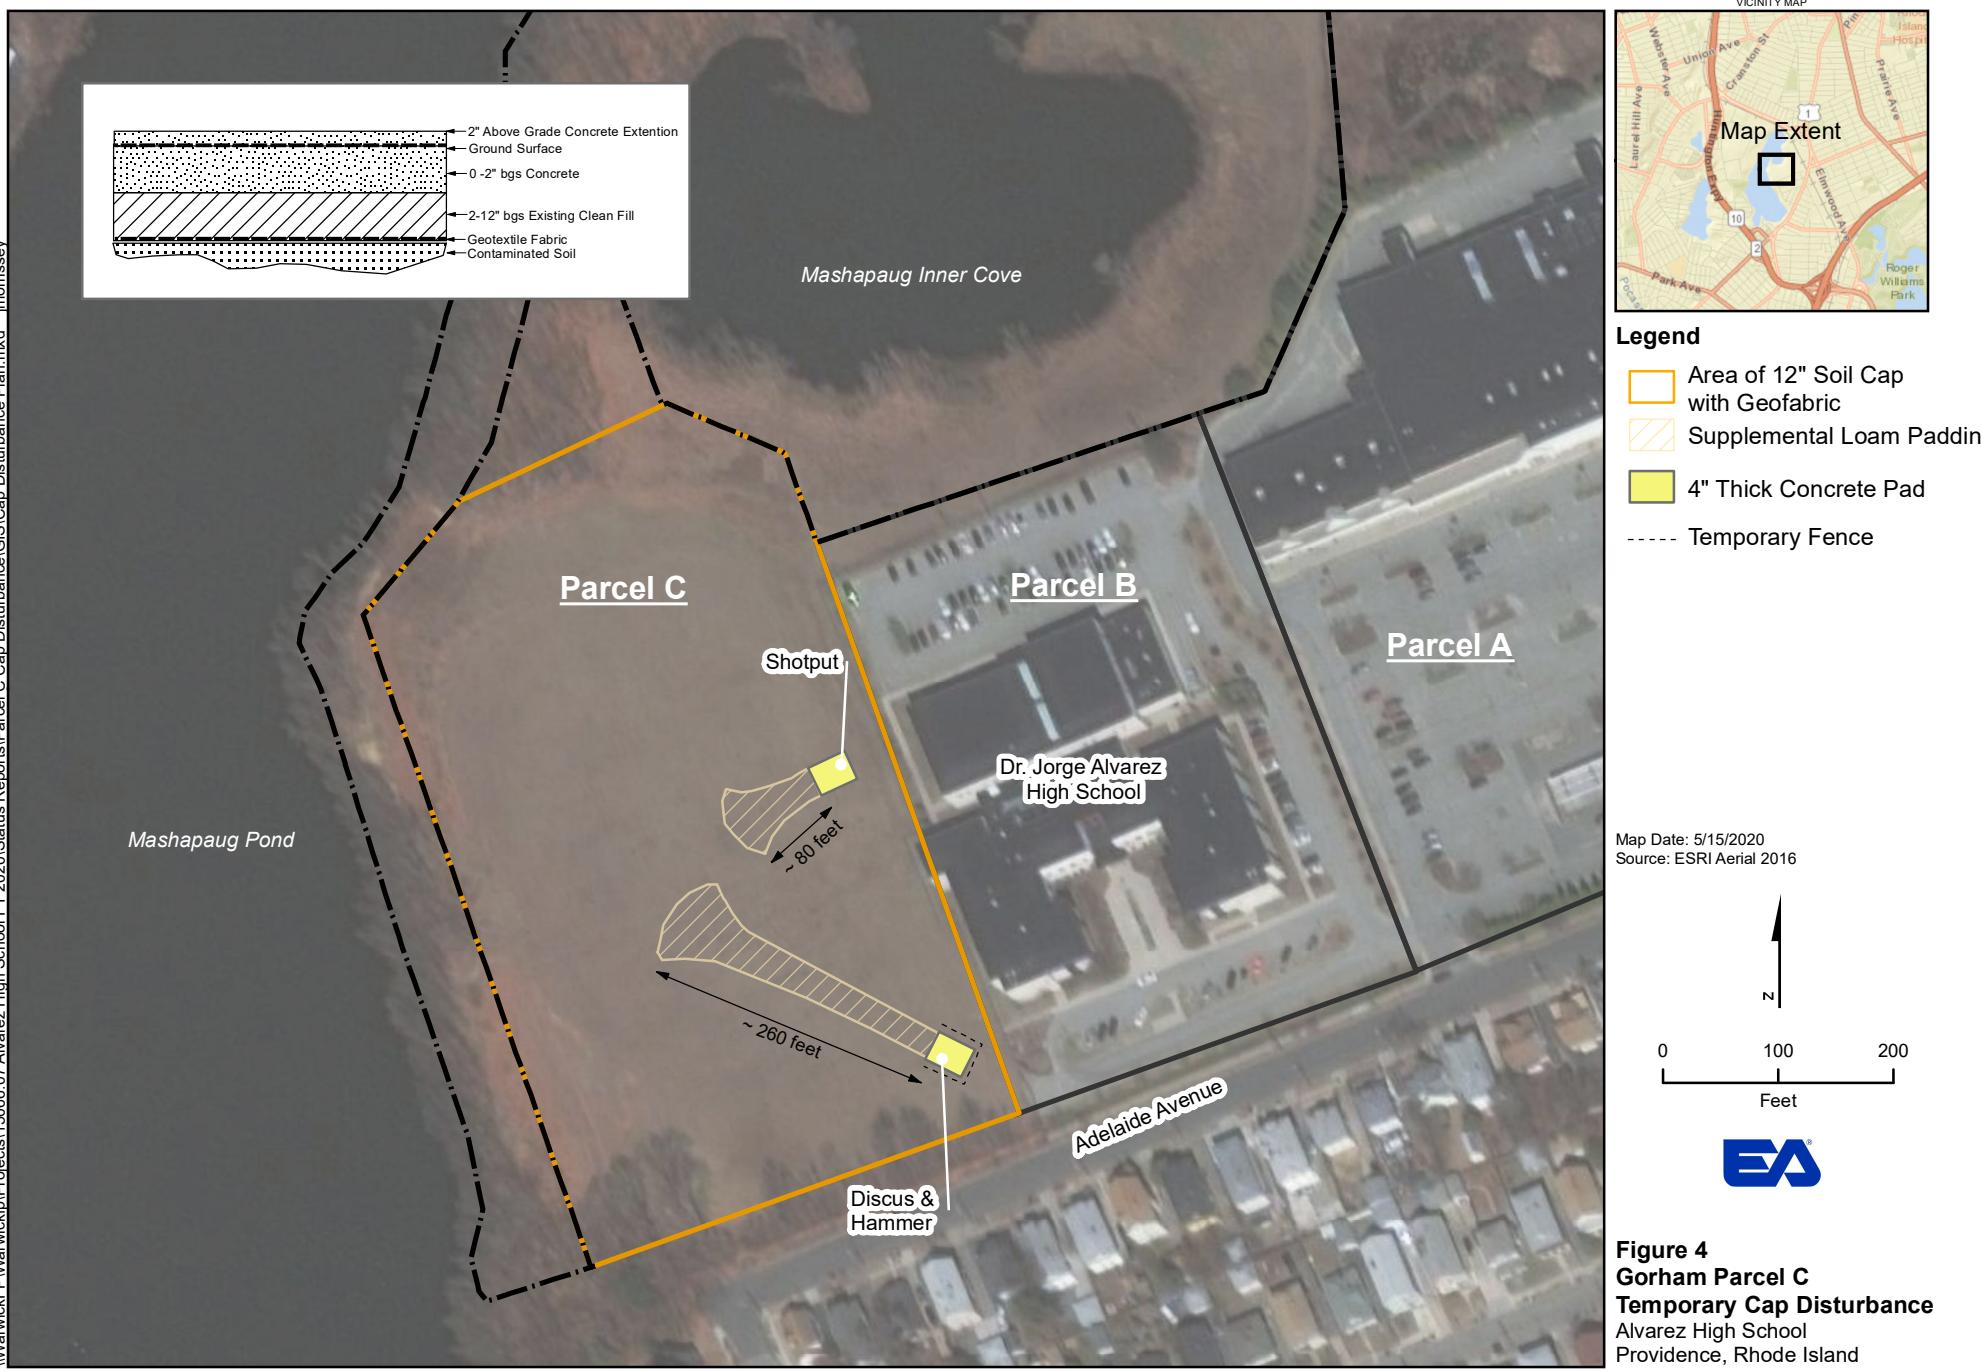


Figure 4
Gorham Parcel C
Temporary Cap Disturbance
Alvarez High School
Providence, Rhode Island

APPENDIX A

O&M Field Forms



EA Engineering, Science, and Technology, Inc.,
PBC

Alvarez High School - SSD & Interior Methane Monitoring System O&M

Date of O&M: 3/24/2023

Performed by: TC

PID/Methane Calibration? yes (yes/no)

PID Calibration Result: 10

Date of last Methane Sensor Filter
Replacement: 1/24/2023

Replaced this O&M Visit? no (yes/no)

General Status of SSD System: Functioning properly

General Status of Methane
Monitoring System: Functioning properly

Eng. Cap/Fence Inspection

Performed/Notes: No visible issues.

Monitoring/ Sampling Location	Sub-slab or gauge vacuum	Air Velocity (fpm)	VOC Monitoring	Methane Monitoring			Air/Vapor Sample Collection						Comments/Notes (Ambient weather conditions, status of HVAC, possible monitoring/sampling interferences, etc)
			PID (ppb)	Indoor Sensor (ppm)	(% Gas)	(% LEL)*	Summa Can ID	Controller ID	Start Time	Start Vac (inches Hg)	End Time	End Vac (inches Hg)	
Gymnasium	NA	NA	123	0	0	0							
Cafeteria	NA	NA	153	0	0	0							
Kitchen Storage Room	NA	NA	174	0	0	0							
Elevator Hallway	NA	NA	128	0	0	0							
Room 145	NA	NA	162	0	0	0							
Room 152	NA	NA	152	0	0	0							
Room 118	NA	NA	180	0	0	0							
Room 110	NA	NA	348	0	0	0							Perfume Scent in room
MP-1	-0.15	NA	41	NA	0	0							
MP-2	-0.15	NA	50	NA	0	0							
MP-3	-0.05	NA	109	NA	0	0							
MP-4	-0.1	NA	22	NA	0	0							
MP-5	-0.05	NA	89	NA	0	0							
MP-6	-0.1	NA	87	NA	0	0							
MP-7	-0.05	NA	21	NA	0	0							
MP-8	-0.15	NA	88	NA	0	0							
IMP-1	-0.05	NA	94	NA	0	0							
IMP-2	-0.1	NA	152	NA	0	0							
IMP-3	-0.05	NA	150	NA	0	0							
Roof-Top Fan 1	-2.2	1905	57	NA	0	0							
Roof-Top Fan 2	-2	1849	84	NA	0	0							
Roof-Top Fan 3				NA									
Ambient Outdoor Air	NA	NA	0	NA	0	0							

NA: not applicable.

NM: not monitored on this date.

NS : not sampled on this date.

* RIDEM Action Level for methane %LEL beneath the building is 10% and within the building is 1%.

If these methane levels are exceeded, immediately notify EA Project Manager to initiate response protocol.



EA Engineering, Science, and Technology, Inc.,
PBC

Alvarez High School - SSD & Interior Methane Monitoring System O&M

Date of O&M: 4/19/2023

Performed by: TC/LL

PID/Methane Calibration? yes (yes/no)

PID Calibration Result: 10

Date of last Methane Sensor Filter Replacement: 4/19/2023

Replaced this O&M Visit? Yes (yes/no)

General Status of SSD System: Fine

General Status of Methane Monitoring System: Fine

Eng. Cap/Fence Inspection

Performed/Notes: _____ (take photographs of any deficiencies noted)

Monitoring/ Sampling Location	Sub-slab or gauge vacuum	Air Velocity (fpm)	VOC Monitoring	Methane Monitoring			Air/Vapor Sample Collection						Comments/Notes (Ambient weather conditions, status of HVAC, possible monitoring/sampling interferences, etc)
			PID (ppb)	Indoor Sensor (ppm)	(% Gas)	(% LEL)*	Summa Can ID	Controller ID	Start Time	Start Vac (inches Hg)	End Time	End Vac (inches Hg)	
Gymnasium	NA	NA	0	0	0	0	1259	4184	9:28	-29	1009	-3	
Cafeteria	NA	NA	0	0	0	0	9004	4579	9:33	-29	1003	-3	
Kitchen Storage Room	NA	NA	0	0	0	0	9002	4580	9:35	-30	1005	-4	
Elevator Hallway	NA	NA	0	0	0	0	1991	4589	9:23	-28	953	-2	
Room 145	NA	NA	0	0	0	0	1176	4590	9:25	-29	955	0	
Room 152	NA	NA	0	0	0	0	2160	4741	8:50	-30	920	-2	performed 4/21/23
Room 118	NA	NA	0	0	0	0	2144	4740	8:54	-29	924	-4	performed 4/21/23
Room 110	NA	NA	0	0	0	0	1222	4551	8:57	-30	927	-1	performed 4/21/23
MP-1	-0.1	NA	0	NA	0	0	-	-	-	-	-	-	
MP-2	-0.1	NA	0	NA	0	0	9006	4746	10:56	-29	1127	-3	
MP-3	-0.1	NA	0	NA	0	0	-	-	-	-	-	-	
MP-4	-0.05	NA	0	NA	0	0	-	-	-	-	-	-	
MP-5	-0.05	NA	0	NA	0	0	1884	4275	11:08	-30	1147	-4	
MP-6	-0.05	NA	0	NA	0	0	-	-	-	-	-	-	
MP-7	-0.05	NA	0	NA	0	0	1163	4286	11:10	-30	1155	-5	
MP-8	-0.1	NA	0	NA	0	0	9015	4747	10:46	-29	1128	-4	
IMP-1	-0.05	NA	0	NA	0	0	2139	4670	9:32	-30	1008	0	
IMP-2	-0.05	NA	0	NA	0	0	-	-	-	-	-	-	
IMP-3	-0.05	NA	0	NA	0	0	1987	4669	9:18	-27	948	0	
Roof-Top Fan 1	-2.2	1915	0	NA	0	0	-	-	-	-	-	-	
Roof-Top Fan 2	-2.2	1810	0	NA	0	0	-	-	-	-	-	-	
Roof-Top Fan 3	-2.2	1435	0	NA	0	0	-	-	-	-	-	-	
Ambient Outdoor Air	NA	NA	0	NA	0	0	1190	4185	10:41	-28	1112	-2	

NA: not applicable.

NM: not monitored on this date.

NS : not sampled on this date.

* RIDEM Action Level for methane %LEL beneath the building is 10% and within the building is 1%.

If these methane levels are exceeded, immediately notify EA Project Manager to initiate response protocol.



EA Engineering, Science, and Technology, Inc.,
PBC

Alvarez High School - SSD & Interior Methane Monitoring System O&M

Date of O&M: 5/24/2023

Performed by: GJ/SP

PID/Methane Calibration? yes (yes/no)

PID Calibration Result: 10

Date of last Methane Sensor Filter

Replacement: 4/19/2023

Replaced this O&M Visit? No (yes/no)

General Status of SSD System: functioning properly

General Status of Methane

Monitoring System: functioning properly

Eng. Cap/Fence Inspection

Performed/Notes: no changes

(take photographs of any deficiencies noted)

Monitoring/ Sampling Location	Sub-slab or gauge vacuum	Air Velocity (fpm)	VOC Monitoring	Methane Monitoring			Air/Vapor Sample Collection					Comments/Notes (Ambient weather conditions, status of HVAC, possible monitoring/sampling interferences, etc)
			PID (ppb)	Indoor Sensor (ppm)	(% Gas)	(% LEL)*	Summa Can ID	Controller ID	Start Time	Start Vac (inches Hg)	End Time	End Vac (inches Hg)
Gymnasium	NA	NA	0	0	0	0						
Cafeteria	NA	NA	0	0	0	0						
Kitchen Storage Room	NA	NA	0	0	0	0						
Elevator Hallway	NA	NA	0	0	0	0						
Room 145	NA	NA	0	0	0	0						
Room 152	NA	NA	80	0	0	0						
Room 118	NA	NA	0	0	0	0						
Room 110	NA	NA	0	0	0	0						
MP-1	-0.02	NA	0	NA	0	0						
MP-2	-0.02	NA	0	NA	0	0						
MP-3	-0.02	NA	0	NA	0	0						
MP-4	-0.01	NA	11 ppm	NA	0	0						
MP-5	-0.01	NA	178	NA	0	0						
MP-6	-0.01	NA	130	NA	0	0						
MP-7	-0.01	NA	0	NA	0	0						
MP-8	-0.02	NA	0	NA	0	0						
IMP-1	-0.01	NA	0	NA	0	0						
IMP-2	-0.01	NA	30	NA	0	0						
IMP-3	-0.01	NA	0	NA	0	0						
Roof-Top Fan 1	-2.2	2225	0	NA	0	0						
Roof-Top Fan 2	-2	2224	0	NA	0	0						
Roof-Top Fan 3	-2.4	2064	180	NA	0	0						
Ambient Outdoor Air	NA	NA	0	NA	0	0						

NA: not applicable.

NM: not monitored on this date.

NS : not sampled on this date.

* RIDEM Action Level for methane %LEL beneath the building is 10% and within the building is 1%.

If these methane levels are exceeded, immediately notify EA Project Manager to initiate response protocol.

APPENDIX B

Indoor and Ambient Outdoor Air Analytical Summary

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/ Interim RIDEM-Approved Action Level																				
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
Acetone	180.0	8-Feb-08	20.20	8.24	4.75	U	4.75	U	6.87	8.06	4.75	U	4.78					4.750	U		
		27-Mar-08 ²	576.00	186.00	108.00		89.90		24.70	38.30	76.70		47.40					5.870			
		25-Apr-08	61.70	12.90	19.00		12.80		15.10	14.80	18.60		12.50		17.10			6.670			
		29-May-08	19.50	16.00	12.80		16.20		10.90	17.20	13.20		11.60					7.480			
		27-Jun-08	87.90	20.00	20.50		27.70		28.90	29.00	26.00		29.80					19.700			
		31-Jul-08	32.20	17.20	20.80		16.80		23.80	20.00	18.60		23.50					20.000			
		28-Aug-08	33.10	21.10	21.50		25.80		27.00	32.40	29.10		23.80					37.000			
		30-Sep-08	39.40	10.40	7.60		11.20		44.80	29.90	19.60		55.60					6.800			
		27-Oct-08	56.20	23.10	14.90		24.10		15.90	26.50	34.30		25.10					109.000			
		25-Nov-08	21.30	8.20	5.30		14.00		15.60	9.70	6.50		10.00					7.000			
		18-Dec-08	39.30	18.50	16.90		21.50		23.10	41.90	22.00		28.80					40.000			
		21-Jan-09	5.30	2.40	2.40	U	3.60		5.60	5.00	3.30		4.00					2.400	U		
		25-Feb-09	2.40	U	2.90		2.40	U	NS	9.60	5.00		3.80					2.400	U		
		26-Mar-09	34.40	10.70	8.82		11.30		13.80	12.00	10.50		12.00					9.680			
		29-Apr-09	4.75	U	5.70		7.23		8.24	19.20	9.42		7.57					7.700			
		22-Jul-09	2.37	U	13.10		18.70		11.70	28.90	29.40		17.10					11.000			
		9-Oct-09	19.50	10.10	9.22		11.00		15.50	12.00	10.60		11.60					8.570			
		15-Jan-10	11.90	8.16	5.08		6.70		7.32	7.27	5.26		8.11					6.190			
		21-Apr-10	26.70	22.00	23.20		23.20		19.30	19.90	21.80		20.50					4.960			
		16-Jul-10	28.20	16.50	13.80		16.10		36.90	24.90	40.70		16.00					14.300			
		15-Oct-10	32.70	8.18	4.75	U	11.50		7.36	6.01	5.53		6.69					7.630			
		30-Nov-10	NS	13.20	13.00		NS		NS	NS	6.46		NS					NS			
		26-Jan-11	28.50	20.80	11.60		14.90		13.50	33.20	12.60		24.00		21.50		15.90	9.850			
		26-Jan-11**	NS	17.00	15.00		NS		NS	12.00								NS			
		27-Apr-11	6.82	12.80	11.30		14.70		14.60	7.55	12.30		5.93					5.600			
		26-Jul-11	51.80	48.00	22.80		82.20		28.70	7.17	25.40		39.40					8.840			
		28-Oct-11	17.00	12.00	7.40		9.90		11.00	9.70	13.00		15.00					8.000			
		23-Jan-12	15.00	15.00	18.00		18.00		10.00	37.00	19.00		18.00					13.000			
		13-Apr-12	11.00	16.00	11.00		11.00		11.00	21.00	9.10		19.00					24.000			
		2-Jul-12 resample	NS	NS	NS		NS		NS	NS	NS		21.00					9.100			
		20-Jun-12	19.00	22.00	17.00		21.00		20.00	15.00	15.00		22.00					11.000			
		1-Nov-12	12.00	11.00	9.50		16.00		8.30	12.00	13.00		11.00					9.000			
		1-Feb-13	16.00	15.00	12.00		14.00		9.10	39.00	16.00		18.00					8.200			
		29-Apr-13	26.00	23.00	22.00		21.00		28.00	32.00	27.00		35.00					18.000			
		9-Jul-13 RIDEM	NS	NS	NS		NS		18.83	NS	NS		NS					11.710			
		18-Oct-13	34.00	32.00	30.00		42.00		29.00	29.00	46.00		34.00					20.000			
		9-Jan-14	8.90	19.00	16.00		20.00		21.00	24.00	27.00		45.00					8.300			
		24-Apr-14	19.00	12.00	18.00		17.00		17.000 ^M	12.00	16.00		76.000 ^M					6.100			
		1-Aug-14	35.000 ^M	12.000 ^M	29.000 ^M		37.000 ^M		43.000 ^M	38.000 ^M	81.000/62.000 ^M		35.000 ^M					27.000 ^M			
		12-Sep-14 resample	NS	NS	NS		NS		NS	33.00								NS			
		22-Oct-14	17.00	12.00	2.90	U	18.00		27.00	34.00	26.00		51.00					13.000			
		20-Jan-15	37.00	30.00	30.00		34.00		39.00	44.00	57.00		17.00					49.000</td			

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		27-Mar-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		25-Apr-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		29-May-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		27-Jun-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		31-Jul-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		28-Aug-08	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		30-Sep-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		27-Oct-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		25-Nov-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		18-Dec-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		21-Jan-09	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		25-Feb-09	2.200	U	2.200	U	2.200	U	NS		2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		26-Mar-09	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		29-Apr-09	1.080	U	1.080	U	2.740	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		22-Jul-09	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		9-Oct-09	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		15-Jan-10	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		21-Apr-10	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		16-Jul-10	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		15-Oct-10	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		30-Nov-10	NS		1.080	U	1.080	U	NS		NS		NS		1.080	U	1.080	U	NS		NS		
		26-Jan-11	1.850	U	1.840	U	1.850	U	0.185	U	1.850	U	1.840	U	1.840	U	1.850	U	1.840	U	1.840	U	
		26-Jan-11**	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		
		27-Apr-11	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		26-Jul-11	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	1.080	U	
		28-Oct-11	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.250	U	
		23-Jan-12	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	
		13-Apr-12	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.500	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		
		20-Jun-12	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		1-Nov-12	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		1-Feb-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		29-Apr-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		9-Jul-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.164	U	NS		NS		NS		NS		0.164	U	
		18-Oct-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		9-Jan-14	0.250	U</td																			

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)		
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual		
Benzene	3.3	8-Feb-08	0.910		0.840		0.730		0.780		0.810		0.800		0.750		0.790					0.870		
		27-Mar-08	1.420		1.350		1.600		1.420		0.218		2.130		1.730		1.680						0.372	
		25-Apr-08	1.360		1.300		0.638		1.400		1.150		1.270		1.130		1.120						0.413	
		29-May-08	0.370		0.430		0.300		0.400		0.300		0.450		0.410		0.310						0.230	
		27-Jun-08	0.631		0.603		0.666		0.644		0.657		0.604		0.849		0.582						0.726	
		31-Jul-08	0.568		0.477		0.419		0.451		0.528		0.465		0.378		0.390						0.405	
		28-Aug-08	1.190		1.110		1.010		0.953		0.935		1.060		1.060		1.020						1.280	
		30-Sep-08	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	0.2	1.600	U					1.600	U
		27-Oct-08	2.100		1.600		1.600		1.600		1.600		1.600		1.600		1.900						3.600	
		25-Nov-08	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U					1.600	U
		18-Dec-08	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U					1.600	U
		21-Jan-09	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U	1.600	U					1.600	U
		25-Feb-09	1.600	U	1.600	U	1.600	U	NS		1.600	U	1.600	U	1.600	U	1.600	U					1.600	U
		26-Mar-09	2.330		1.840		1.740		1.650		1.540		2.210		0.316		1.880						2.390	
		29-Apr-09	0.594		0.358		0.332		0.332		0.303		0.358		1.460		0.335						0.351	
		22-Jul-09	0.626		0.546		0.642		0.574		0.852		1.560		1.460		1.080						4.330	
		9-Oct-09	1.130		0.954		0.903		0.878		0.919		1.050		1.070		0.996						1.100	
		15-Jan-10	1.670		1.510		1.340		1.460		1.420		1.450		1.540		1.550						1.370	
		21-Apr-10	1.020		1.320		1.080		1.380		1.270		1.210		1.230		1.240						0.335	
		16-Jul-10	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.485		0.319	U					0.319	U
		15-Oct-10	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U					0.319	U
		30-Nov-10	NS		0.514		0.594		NS		NS		NS		0.412		NS						NS	
		26-Jan-11	2.920		2.890		2.970		3.290		2.940		3.430		2.560		3.660		2.940		2.850		3.350	
		26-Jan-11**	NS		3.600		3.800		NS		NS		NS		3.800		NS						NS	
		27-Apr-11	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U	0.319	U					0.319	U
		26-Jul-11	0.559		0.664		0.319		0.326		0.319		0.319		0.329		0.319						0.319	
		28-Oct-11	0.640		0.500		0.380		0.390		0.410		0.450		0.460		0.430						0.300	
		23-Jan-12	1.300		1.200		1.200		1.200		1.200		1.200		1.200		1.300						1.200	
		13-Apr-12	0.680		0.670		0.590		0.600		0.580		0.650		0.580		0.520						0.220	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS						0.140	
		20-Jun-12	0.490		0.540		0.410		0.510		0.520		0.440		0.460		0.540						0.740	
		1-Nov-12	1.300		1.000		0.770		1.200		0.990		1.500		1.700		1.300						0.470	
		1-Feb-13	0.470		0.410		0.400		0.420		0.410		0.490		0.500		0.430						0.410	
		29-Apr-13	0.960		0.920		0.900		0.930		0.760		0.710		0.940		0.840						0.300	
		9-Jul-13	0.440		0.420		0.400		0.450		0.450		0.420		0.450		0.440						0.520	
		9-Jul-13 RIDEM	NS		NS		NS		NS		NS		NS		NS		NS						0.597	
		18-Oct-13	0.240		1.000		0.880		0.660		1.100		0.830		0.800		1.000						1.000	
		9-Jan-14	1.400		1.700		0.910		0.860		0.730		0.810		0.960		0.820	</						

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date																				
		8-Feb-08	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		27-Mar-08	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		25-Apr-08	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		29-May-08	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		27-Jun-08	0.134	U	0.134	U	0.130	U	0.130	U	0.134	U	0.130	U	0.231	U	0.134	U	0.134	U	0.134	U
		31-Jul-08	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		28-Aug-08	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		30-Sep-08	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		27-Oct-08	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		25-Nov-08	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		18-Dec-08	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		21-Jan-09	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		25-Feb-09	0.130	U	0.130	U	0.130	U	NS		0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		26-Mar-09	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		29-Apr-09	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		22-Jul-09	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		9-Oct-09	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		15-Jan-10	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		21-Apr-10	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		16-Jul-10	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		15-Oct-10	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		30-Nov-10	NS		0.134	U	0.134	U	NS		NS		NS		0.134	U	NS		NS		NS	
		26-Jan-11	0.228	U	0.228	U	0.228	U	0.228	U	0.227	U	0.228	U	0.228	U	0.228	U	0.228	U	0.228	U
		26-Jan-11**	NS		0.340	U	0.340	U	NS		NS		NS		0.340	U	NS		NS		NS	
		27-Apr-11	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		26-Jul-11	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U	0.134	U
		28-Oct-11	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U
		23-Jan-12	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U
		13-Apr-12	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.100	U	0.100	U	0.100	U
		20-Jun-12	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		1-Nov-12	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U
		1-Feb-13	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U
		29-Apr-13	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U
		9-Jul-13	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U	0.067	U
		18-Oct-13	0.130	U	0.130	U	0.130	U	0.130													

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																						
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual		
Bromoform	0.55	8-Feb-08	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	
		27-Mar-08	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		25-Apr-08	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		29-May-08	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	
		27-Jun-08	0.206	U	0.210	U	0.206	U	0.206	U	0.210	U	0.210	U	1.300	U	0.210	U	0.206	U	0.206	U	
		31-Jul-08	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		28-Aug-08	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		30-Sep-08	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	
		27-Oct-08	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	
		25-Nov-08	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	
		18-Dec-08	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	
		21-Jan-09	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	
		25-Feb-09	0.410	U	0.410	U	0.410	U	NS	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	0.410	U	
		26-Mar-09	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		29-Apr-09	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		22-Jul-09	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		9-Oct-09	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		15-Jan-10	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		21-Apr-10	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		16-Jul-10	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		15-Oct-10	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		30-Nov-10	NS	0.206	U	0.206	U	NS	U	NS	U	NS	U	0.206	U	NS	U	NS	U	NS	U	NS	U
		26-Jan-11	0.353	U	0.351	U	0.352	U	0.352	U	0.353	U	0.351	U	0.351	U	0.353	U	0.351	U	0.351	U	
		26-Jan-11**	NS	0.540	U	0.520	U	NS	U	NS	U	NS	U	0.520	U	NS	U	NS	U	NS	U	NS	U
		27-Apr-11	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	0.206	U	
		26-Jul-11	0.207	U	0.207	U	0.207	U	0.207	U	0.207	U	0.207	U	0.207	U	0.207	U	0.207	U	0.207	U	
		28-Oct-11	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	
		23-Jan-12	0.360	U	0.360	U	0.360	U	0.360	U	0.360	U	0.360	U	0.360	U	0.360	U	0.360	U	0.360	U	
		13-Apr-12	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	0.310	U	
		2-Jul-12 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		20-Jun-12	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	
		1-Nov-12	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	
		1-Feb-13	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	
		29-Apr-13	0.210	U	0.210	U	0.21																

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																									
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)				
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual					
2-Butanone	500.0	8-Feb-08	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U				
		27-Mar-08	8.560		6.540		5.650		5.140		3.950		4.440		0.360		5.680						1.470	U		
		25-Apr-08	2.140		1.470		3.170		1.470		1.470		1.470		1.470		1.470		1.470		1.470		1.470	U		
		29-May-08	1.470	U	1.470	U	2.840		2.240		1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U		
		27-Jun-08	7.850		2.520		3.810		3.890		3.050		2.420		2.840		2.340							3.080	U	
		31-Jul-08	2.080		1.720		3.080		1.650		2.080		2.160		1.470		1.470		1.490					1.470	U	
		30-Sep-08	2.280		1.790		3.980		3.980		1.470	U	1.470	U	1.470	U	1.470	U	1.470	U				1.650	U	
		30-Sep-08	1.500	U	1.500	U	1.500	U	1.500	U	2.200		1.500		1.500	U	6.100							1.500	U	
		27-Oct-08	1.900		3.200		1.500		3.600		1.500	U	2.000		1.500		2.300							2.800	U	
		25-Nov-08	2.600		1.500		1.500		1.900		1.500	U	1.500		2.900		1.500							1.600	U	
		18-Dec-08	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U				1.500	U	
		21-Jan-09	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U	1.500	U				1.500	U	
		25-Feb-09	1.500	U	1.500	U	0.079	U	NS		1.500	U	1.500	U	1.500	U	1.500	U	1.500	U				1.500	U	
		26-Mar-09	2.410		1.560		1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U	1.470	U				1.470	U	
		29-Apr-09	1.470	U	1.470	U	1.470	U	1.460	U	1.470	U	1.470	U	1.740	U	1.470	U	1.470	U				1.470	U	
		22-Jul-09	1.470	U	1.470	U	4.750		1.470		2.070		21.900		1.740		1.480								4.360	U
		9-Oct-09	1.470	U	1.470	U	1.540		1.640		1.470	U	1.470	U	1.470	U	1.470	U	1.470	U				1.470	U	
		15-Jan-10	6.610		1.470		1.470		1.470		1.470		1.470		1.470		1.470		1.470					1.470	U	
		21-Apr-10	1.850		1.470		2.770		1.590		1.480		1.470		1.470		1.470		1.470					1.470	U	
		16-Jul-10	2.520		1.900		2.100		2.210		3.180		2.800		24.600		1.870								1.630	U
		15-Oct-10	4.300		1.470		1.470		1.470		1.470		1.470		1.470		1.470		1.470					0.021	I	
		30-Nov-10	NS		1.470		1.470		NS		NS		NS		1.470		NS							NS	U	
		26-Jan-11	2.720		3.190		2.510		2.510		2.520		2.500		2.640		2.710		2.500	U	2.510	U	2.500	U		
		26-Jan-11**	NS		2.300		2.100		NS		NS		1.600				NS								NS	U
		27-Apr-11	1.470	U	1.470	U	2.220		1.470		1.470	U	1.470	U	1.470	U	1.470	U	1.470	U				1.470	U	
		26-Jul-11	1.600		1.470		2.320		1.520		1.470		1.470		1.470		1.470		3.010						1.470	U
		28-Oct-11	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U				2.400	U	
		23-Jan-12	4.100	U	4.100	U	4.100	U	4.100	U	4.100	U	4.100	U	4.100	U	4.100	U	4.100	U				4.100	U	
		13-Apr-12	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U	3.500	U				4.700	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	U		
		20-Jun-12	2.600		2.400		3.300		2.700		2.800		2.400		2.400		2.400		2.400					2.400	U	
		1-Nov-12	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U				2.400	U	
		1-Feb-13	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U	2.400	U				2.400	U	
		29-Apr-13	5.100		3.50																					

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.500		0.480		0.440		0.450		0.460		0.470		0.470		0.470		0.470		0.470		0.470
		27-Mar-08	0.540		0.541		0.547		0.537		0.580		0.577		0.552		0.586						0.565
		25-Apr-08	0.436		0.439		0.405		0.441		0.448		0.439		0.465		0.450						0.416
		29-May-08	0.470		0.470		0.450		0.470		0.480		0.490		0.520		0.460						0.460
		27-Jun-08	0.544		0.535		0.526		0.534		0.526		0.538		0.555		0.547						0.537
		31-Jul-08	0.526		0.532		0.528		0.554		0.554		0.542		0.564		0.551						0.557
		28-Aug-08	0.552		0.548		0.551		0.545		0.566		0.559		0.556		0.572						0.551
		30-Sep-08	0.489		0.446		0.404		0.497		0.461		0.250		0.491		0.531						0.547
		27-Oct-08	0.370		0.510		0.260		0.450		0.280		0.510		0.270		0.480						0.460
		25-Nov-08	0.400		0.400		0.400		0.440		0.420		0.350		0.370		0.470						0.470
		18-Dec-08	0.350		0.330		0.440		0.410		0.420		0.350		0.340		0.310						0.520
		21-Jan-09	0.490		0.460		0.570		0.460		0.500		0.490		0.570		0.540						0.620
		25-Feb-09	0.360		0.190		0.380		NS		4.000		0.400		0.410		0.400						0.440
		26-Mar-09	0.568		0.592		0.542		0.561		0.584		0.561		0.566		0.542						0.604
		29-Apr-09	0.534		0.522		0.597		0.534		0.528		0.622		0.578		0.559						0.515
		22-Jul-09	0.597		0.591		0.585		0.597		0.585		0.585		0.578		0.585						0.591
		9-Oct-09	0.503		0.566		0.471		0.497		0.471		0.497		0.478		0.484						0.478
		15-Jan-10	0.585		0.603		0.578		0.597		0.585		0.610		0.616		0.610						0.635
		21-Apr-10	0.490		0.547		0.559		0.484		0.126		0.459		0.530		0.490						0.484
		16-Jul-10	0.497		0.503		0.484		0.528		0.465		0.547		0.484		0.484						0.541
		15-Oct-10	0.459		0.427		0.509		0.434		0.440		0.408		0.453		0.446						0.503
		30-Nov-10	NS		0.478		0.559		NS		NS		NS		0.484		NS						NS
		26-Jan-11	0.558		0.502		0.504		0.567		0.472		0.566		0.481		0.558		0.481		0.557		0.481
		26-Jan-11**	NS		0.540		0.500		NS		NS		NS		0.500		NS						NS
		27-Apr-11	0.371		0.358		0.364		0.408		0.352		0.364		0.358		0.358						0.434
		26-Jul-11	0.409		0.442		0.409		0.428		0.402		0.421		0.402		0.421						0.459
		28-Oct-11	0.410		0.380		0.430		0.430		0.420		0.410		0.430		0.430						0.440
		23-Jan-12	0.490		0.490		0.480		0.480		0.470		0.460		0.490		0.460						0.480
		13-Apr-12	0.480		0.490		0.420		0.460		0.450		0.460		0.470		0.460						0.300
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		0.390				0.400
		20-Jun-12	0.560		0.610		0.520		0.530		0.590		0.500		0.550		0.570						0.490
		1-Nov-12	0.510		0.520		0.480		0.400		0.480		0.490		0.520		0.490						0.530
		1-Feb-13	0.520		0.510		0.520		0.510		0.550		0.510		0.520		0.510						0.540
		29-Apr-13	0.540		0.530		0.530		0.510		0.490		0.470		0.490		0.480						0.500
		9-Jul-13	0.430		0.440		0.430		0.430		0.370		0.440		0.450		0.440						0.440
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.516		NS		NS		NS						0.500
		18-Oct-13	0.450		0.450		0.450		0.440		0.420		0.420		0.440		0.440						0.440
		9-Jan-14	0.400		0.430		0.450		0.450		0.400		0.450		0.430		0.430						0.480
		24-Apr-14	0.430		0.270		0.410		0.430		0.400		0.440		0.350		0.500						0.430
		1-Aug-14	0.570		0.700		0.510		0.460		0.410		0.410		0.440		0.430						0.420
		12-Sept-14 resample	NS		NS		NS		NS		NS		NS		0.470		NS						NS
		22-Oct-14	0.430		0.410		0.430		0.370		0.460		0.460		0								

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/ Interim RIDEM-Approved Action Level																						
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
Chlorobenzene	37.0	8-Feb-08	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	
		27-Mar-08	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		25-Apr-08	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		29-May-08	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	
		27-Jun-08	0.092	U	0.090	U	0.090	U	0.092	U	0.090	U	0.090	U	0.090	U	0.092	U	0.092	U	0.092	U	
		31-Jul-08	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		28-Aug-08	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		30-Sep-08	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	
		27-Oct-08	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	
		25-Nov-08	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	
		18-Dec-08	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	
		21-Jan-09	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	
		25-Feb-09	2.300	U	2.300	U	2.300	U	NS		2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	2.300	U	
		26-Mar-09	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		29-Apr-09	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		22-Jul-09	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		9-Oct-09	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		15-Jan-10	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		21-Apr-10	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		16-Jul-10	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		15-Oct-10	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		30-Nov-10	NS	0.092	U	0.092	U	NS		NS		NS		0.092	U	NS		NS		NS		NS	
		26-Jan-11	0.157	U	0.156	U	0.157	U	0.157	U	0.156	U	0.156	U	0.156	U	0.157	U	0.156	U	0.156	U	
		26-Jan-11**	NS	0.230	U	0.230	U	NS		NS		NS		0.230	U	NS		NS		NS		NS	
		27-Apr-11	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		28-Oct-11	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	
		23-Jan-12	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	
		13-Apr-12	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	
		2-Jul-12 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		20-Jun-12	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		1-Nov-12	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		1-Feb-13	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		29-Apr-13	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	
		9-Jul-13	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		9-Jul-13 RIDEM	NS	NS	NS	NS	NS	NS	NS	J	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		18-Oct-13	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		9-Jan-14	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		24-Apr-14	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	0.046	U	
		1-Aug-14	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		12-Sep-14 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		22-Oct-14	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	
		20-Jan-15	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		30-Mar-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		22-Apr-15	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		21-Jul-15	0.200	U	0.200 ^A	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	
		23-Sep-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		29-Oct-15	0.300	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	
		4-Dec-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		27-Jan-16	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		20-Apr-16 ³	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	0.092	U	
		20-Jul-16	0.11	U	0.14	U	0.10	U	0.11	U	0.11	U	0.11	U	0.11	U	0.12	U	0.10	U	0.14	U	
		21-Oct-16	0.092	U	0.092	U	0.09	U	0.092														

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
		8-Feb-08	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
		27-Mar-08	0.062	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		25-Apr-08	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		29-May-08	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
		27-Jun-08	0.053	U	0.050	U	0.053	U	0.053	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.053	U
		31-Jul-08	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		28-Aug-08	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		30-Sep-08	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U
		27-Oct-08	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U
		25-Nov-08	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U
		18-Dec-08	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U
		21-Jan-09	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U
		25-Feb-09	1.300	U	1.300	U	1.300	U	NS	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U	1.300	U
		26-Mar-09	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		29-Apr-09	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		22-Jul-09	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		9-Oct-09	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		15-Jan-10	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		21-Apr-10	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		16-Jul-10	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		15-Oct-10	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		30-Nov-10	NS		0.053	U	0.053	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U
		26-Jan-11	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U
		26-Jan-11**	NS		0.130	U	0.130	U	NS	U	NS	U	0.130	U	NS	U	NS	U	NS	U	NS	U
		27-Apr-11	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		26-Jul-11	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		28-Oct-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		23-Jan-12	0.093	U	0.093	U	0.093	U	0.093	U	0.093	U	0.093	U	0.093	U	0.093	U	0.093	U	0.093	U
		13-Apr-12	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.110	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.072		0.150		0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		1-Nov-12	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.061	U	0.053	U	0.053	U	0.053	U
		1-Feb-13	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U
		29-Apr-13	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U
		9-Jul-13	0.053	U	0.053	U	0.053	U	0.053	U	0.053	U	0.092	U	0.053	U	0.053	U	0.053	U	0.053	U
		18-Oct-13	0.053																			

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.110		0.110		0.100	U	0.100	U	0.100	U	0.100	U	0.100	U				0.100	U		
		27-Mar-08	0.840		0.690		0.593		0.523		0.410		0.337		0.605		0.503			0.098	U		
		25-Apr-08	0.186		0.210		0.193		0.122		0.125		0.134		0.110		0.130			0.098	U		
		29-May-08	0.110		0.110		0.100		0.110		0.100		0.100		0.100		0.100			0.100	U		
		27-Jun-08	0.238		0.257		0.202		0.207		0.196		0.227		0.098		0.106			0.167			
		31-Jul-08	0.230		0.151		0.136		0.194		0.204		0.262		0.269		0.271			0.098	U		
		28-Aug-08	0.342		0.373		0.298		0.312		0.269		0.240		0.240		0.240			0.295			
		30-Sep-08	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U		0.490	U		
		27-Oct-08	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U	0.490	U		0.490	U		
		25-Nov-08	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U		0.240	U		
		18-Dec-08	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U		0.240	U		
		21-Jan-09	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U		0.240	U		
		25-Feb-09	0.240	U	0.240	U	0.240	U	NS		0.240	U	0.240	U	0.240	U	0.240	U		0.240	U		
		26-Mar-09	0.236		0.142		0.110		0.115		0.133		0.119		0.098		0.109			0.108			
		29-Apr-09	0.190		0.122		0.098	U	0.102		0.102		0.098	U	0.146		0.098	U		0.098	U		
		22-Jul-09	0.229		0.151		0.166		0.141		0.205		0.180		0.146		0.171			0.439			
		9-Oct-09	0.576		0.098	U	0.283		0.302		0.283		0.307		0.322		0.302			0.171			
		15-Jan-10	0.527		0.473		0.122		0.132		0.112		0.117		0.117		0.180			1.070			
		21-Apr-10	0.156		0.790		0.205		0.771		0.136		0.141		1.460		0.224			0.098	U		
		16-Jul-10	0.317		0.249		0.141		0.161		0.190		0.141		0.258		0.156			0.132			
		15-Oct-10	0.263		0.195		0.098	U	0.102		0.098	U	0.098	U	0.107		0.098	U		0.098			
		30-Nov-10	NS		0.234		0.112		NS		NS		0.098	U	0.098	U	NS			NS			
		26-Jan-11	0.350		0.340		0.166	U	0.241		0.166		0.182		0.166		0.166		0.166	U			
		26-Jan-11**	NS		0.380		0.240	U	NS		NS		0.240		0.240		NS			NS			
		27-Apr-11	0.098	U	0.220		0.098	U	0.141		0.098	U	0.098	U	0.098	U	0.098	U		0.098	U		
		26-Jul-11	0.230		0.249		0.166		0.986		0.166		0.127		0.244		0.156			0.146			
		28-Oct-11	0.120		0.110		0.085		0.097		0.079		0.082		0.082		0.082			0.049	U		
		23-Jan-12	0.170	U	0.240		0.170	U	0.170		0.170		0.170		0.170		0.170			0.170	U		
		13-Apr-12	0.270		0.420		0.140		0.270		0.130		0.130		0.130		0.280			0.098	U		
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.100			0.094			
		20-Jun-12	0.210		0.520		0.140		0.220		0.180		0.140		0.140		0.580			0.110			
		1-Nov-12	0.098		0.140		0.082		0.100		0.088		0.110		0.110		0.100			0.072			
		1-Feb-13	0.390		0.240		0.088		0.120		0.088		0.092		0.092		0.088			0.098			
		29-Apr-13	0.180		0.140		0.140		0.160		0.140		0.120		0.140		0.140			0.082			
		9-Jul-13	0.260		0.240		0.170		0.300		0.310		0.200		0.200		0.200			0.200			
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.217		NS		NS		NS			0.175			
		18-Oct-13	0.098	U	0.300		0.098	U	0.130		0.098	U	0.110		0.110		0.120			0.098	U		
		9-Jan-14	0.120		0.140		0.098	U	0.120		0.098	U	0.120		0.120		0.120			0.140			
		24-Apr-14	0.670		0.160		0.310		0.120		0.098	U	0.120		0.049	U	0.120			0.049	U		
		1-Aug-14	3.400		5.100		1.400		1.200		0.450		0.330		0.870		0.410			6.000			
		12-Sep-14 resample	NS		NS		NS		NS		NS		0.110		NS					NS			
		22-Oct-14	0.073	U	0.073	U	0.073	U	0.190		0.073		0.150		0.073	U	0.073	U		0.160			
		20-Jan-15	0.120		0.120		0.049	U	0.100		0.110		0.130	</td									

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
Chloromethane	14.0	8-Feb-08	2.440	U	2.440	U	2.440	U	2.440	U	2.460	U	2.440	U	2.440	U	2.440	U	2.440	U	2.440	U	
		27-Mar-08	2.830		3.070		2.680		2.440		2.830		2.440		2.480		2.440		2.440		2.440		
		25-Apr-08	2.820		2.440		2.440		2.440		2.440		3.000		2.440		3.140		2.440		2.440		
		29-May-08	2.790		3.000		7.100		11.000		2.940		6.280		6.420		2.770		2.440		2.440		
		27-Jun-08	2.650		2.440		2.440		2.830		3.260		2.620		2.440		2.500		2.440		2.440		
		31-Jul-08	3.580		3.880		3.330		4.370		3.440		3.740		2.440		2.440		2.440		2.440		
		28-Aug-08	2.440		3.140		5.310		6.880		3.150		2.440		2.540		2.540		2.440		2.440		
		30-Sep-08	1.400		1.300		1.100		1.400		1.000		1.700		1.600		1.000		1.200		1.000		
		27-Oct-08	1.000	U	1.000	U	1.000	U	1.000	U	1.000	U	1.200		1.000		1.000		1.000		1.000		
		25-Nov-08	1.000	U	1.000	U	1.000	U	1.000	U	1.000	U	1.000	U	1.000	U	1.000	U	1.000	U	1.000		
		18-Dec-08	1.000	U	1.000	U	1.000	U	1.400		1.000		1.000		1.000		1.300		1.000		1.000		
		21-Jan-09	1.000	U	1.000	U	1.000	U	1.500		1.000		1.000		1.400		1.100		1.200		1.000		
		25-Feb-09	1.000	U	1.000	U	1.000	U	NS		1.000		1.000		1.000		1.100		1.000		1.000		
		26-Mar-09	2.490		2.680		2.550		2.920		2.910		2.440		2.440		2.440		2.440		2.440		
		29-Apr-09	2.710		2.910		3.600		3.730		3.130		2.660		3.390		2.960		3.510		2.440		
		22-Jul-09	2.670		2.520		2.660		2.540		2.440		2.780		3.390		3.320		2.440		2.440		
		9-Oct-09	3.450		2.740		2.440		2.440		2.440		2.440		2.440		2.440		2.440		2.440		
		15-Jan-10	3.850		3.690		2.820		3.180		3.240		3.630		3.120		3.750		2.600		2.460		
		21-Apr-10	2.550		2.440		2.440		2.440		2.440		2.400		2.520		2.440		2.440		2.440		
		16-Jul-10	1.510		1.660		1.050		1.090		1.680		1.110		1.300		1.100		1.510		1.510		
		15-Oct-10	1.080		1.080		1.030		1.050		1.030		1.030		1.030		1.030		1.030		1.030		
		30-Nov-10	NS		1.030		1.030		NS		NS		NS		1.030		NS		NS		NS		
		26-Jan-11	1.760	U	1.750	U	1.760	U	1.760	U	1.750	U	1.750	U	1.750	U	1.750	U	1.750	U	1.750	U	
		26-Jan-11**	NS		1.100		1.000		NS		NS		NS		1.000		NS		NS		NS		
		27-Apr-11	1.050		1.660		1.400		2.160		1.440		1.510		1.740		1.460		1.270		1.270		
		26-Jul-11	1.160		1.600		1.030		1.120		1.030		1.030		1.030		1.030		1.030		1.030		
		28-Oct-11	1.400		1.000		1.300		1.500		1.300		0.960		1.000		1.100		1.300		1.300		
		23-Jan-12	1.300		1.100		1.100		1.200		1.400		1.900		1.400		1.500		1.100		1.100		
		13-Apr-12	1.300		1.400		1.400		1.500		1.100		1.000		1.000		1.200		0.840		0.840		
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		1.500		1.100		1.100		
		20-Jun-12	1.700		0.041		U		0.041		U		0.041		U		1.500		0.041		1.300		
		1-Nov-12	1.100		1.100		0.910		1.200		1.000		1.200		1.100		1.100		0.990		0.990		
		1-Feb-13	1.200		1.300		1.200		1.200		1.200		1.400		1.300		1.100		1.100		1.100		
		29-Apr-13	1.300		1.300		1.300		1.200		1.800		1.100		1.300		1.300		1.100		1.100		
		9-Jul-13	1.100		1.100		0.900		1.100		2.200		1.000		0.980		1.100		1.000		1.000		
		9-Jul-13 RIDEM	NS		NS		NS		NS		1.142		NS		NS		NS		1.164		NS		
		18-Oct-13	0.880		1.100		1.200		1.100		1.200		1.200		1.300		1.300		1.100		1.100		
		9-Jan-14	0.900		0.950		1.000		1.100		1.000		1.100		1.100		1.200		1.100		1.100		
		24-Apr-14	1.100		1.300		1.100		1.100		1.100		1.100		1.400		1.600		0.940		0.940		
		1-Aug-14	0.083	U	0.083	U	0.083	U	0.120	U	0.083	U	0.083	U	0.083	U	0.083	U	0.083	U	0.083	U	
		12-Sep-14 resample	NS		NS		NS		NS		NS		NS		1.100 L<								

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U			0.100	U	
		27-Mar-08	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		25-Apr-08	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		29-May-08	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U			0.100	U	
		27-Jun-08	0.100	U	0.100	U	0.100	U	0.100	U	0.096	U	0.100	U	0.308	U	0.100	U			0.096	U	
		31-Jul-08	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		28-Aug-08	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		30-Sep-08	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U			4.200	U	
		27-Oct-08	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U			4.200	U	
		25-Nov-08	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U			4.200	U	
		18-Dec-08	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U			4.200	U	
		21-Jan-09	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U	4.200	U			4.200	U	
		25-Feb-09	4.200	U	4.200	U	4.200	U	NS		4.200	U	4.200	U	4.200	U	4.200	U			4.200	U	
		26-Mar-09	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		29-Apr-09	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		22-Jul-09	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		9-Oct-09	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		15-Jan-10	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		21-Apr-10	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U	0.096	U			0.096	U	
		16-Jul-10	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		15-Oct-10	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		30-Nov-10	NS		0.170	U	0.170	U	NS		NS		0.170	U	NS		NS				NS		
		26-Jan-11	0.291	U	0.289	U	0.290	U	0.290	U	0.291	U	0.289	U	0.289	U	0.291	U	0.289	U	0.289	U	
		26-Jan-11**	NS		0.430	U	0.430	U	NS		NS		0.430	U	NS		NS				NS		
		27-Apr-11	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		26-Jul-11	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		28-Oct-11	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U			0.170	U	
		23-Jan-12	0.300	U	0.300	U	0.300	U	0.300	U	0.300	U	0.300	U	0.300	U	0.300	U			0.300	U	
		13-Apr-12	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U	0.260	U			0.340	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.130	U			0.130	U	
		20-Jun-12	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		1-Nov-12	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U			0.085	U	
		1-Feb-13	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		29-Apr-13	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U			0.085	U	
		9-Jul-13	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		18-Oct-13	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		9-Jan-14	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U	0.170	U			0.170	U	
		24-Apr-14	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U	0.085	U			0.085	U	
		1-Aug-14	0.170	U	0.170	U	0.170</																

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
		8-Feb-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		27-Mar-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		25-Apr-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		29-May-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		27-Jun-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		31-Jul-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		28-Aug-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		30-Sep-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		27-Oct-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		25-Nov-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		18-Dec-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		21-Jan-09	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		25-Feb-09	3.000	U	3.000	U	3.000	U	NS		3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		26-Mar-09	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		29-Apr-09	0.120	U	0.120	U	0.100	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		22-Jul-09	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		9-Oct-09	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		15-Jan-10	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		21-Apr-10	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		16-Jul-10	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		15-Oct-10	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		30-Nov-10	NS		0.120	U	0.120	U	NS		NS		NS		0.120	U	NS		NS		NS	
		26-Jan-11	0.205	U	0.204	U	0.205	U	0.205	U	0.204	U	0.204	U	0.205	U	0.204	U	0.205	U	0.204	U
		26-Jan-11**	NS		0.300	U	0.300	U	NS		NS		NS		0.300	U	NS		NS		NS	
		27-Apr-11	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		26-Jul-11	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		28-Oct-11	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U
		23-Jan-12	0.220	U	0.210	U	0.400	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U	0.210	U
		13-Apr-12	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		1-Nov-12	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		1-Feb-13	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		29-Apr-13	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		9-Jul-13	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		18-Oct-13	0.120	U																		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/ Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date		Qual		Qual		Qual		Qual		Qual		Qual		Qual		Qual		Qual		Qual
1,4-Dichlorobenzene	24.0	8-Feb-08	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U	0.120	U
		27-Mar-08	0.292		0.272		0.206		0.596		0.728		0.793		0.228		0.237		0.120		0.120	
		25-Apr-08	0.415		0.287		0.126		0.247		0.261		0.245		0.205		0.220		0.222		0.222	
		29-May-08	0.230		0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		27-Jun-08	0.506		0.176		0.391		0.315		0.323		0.458		0.669		0.272		0.320		0.259	
		31-Jul-08	0.309		0.524		0.254		0.216		0.262		0.205		0.211		0.202		0.222		0.213	
		28-Aug-08	0.198		0.252		0.216		U		0.130		U		0.273		1.340		0.582		0.132	
		30-Sep-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		27-Oct-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		25-Nov-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		18-Dec-08	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		21-Jan-09	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		25-Feb-09	3.000	U	3.000	U	3.000	U	NS		3.000	U	3.000	U	3.000	U	3.000	U	3.000	U	3.000	U
		26-Mar-09	0.149		0.129		0.120		U		0.193		0.146		0.204		0.150		0.120		0.120	
		29-Apr-09	0.246		0.144		0.180		1.740		0.210		0.168		0.144		0.168		0.366		0.444	
		22-Jul-09	0.198		0.120		0.553		0.120		U		0.174		0.204		0.144		0.270		0.186	
		9-Oct-09	0.360		0.402		0.336		0.360		0.354		0.487		0.324		0.366		0.138		0.138	
		15-Jan-10	0.156		0.186		0.120		U		0.432		0.150		0.198		0.144		0.120		0.120	
		21-Apr-10	0.120	U	0.180		0.120		U		0.156		0.150		0.156		0.126		0.120		0.200	
		16-Jul-10	1.580		0.493		0.637		0.306		0.499		0.655		11.400		0.553		0.384		0.384	
		15-Oct-10	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		30-Nov-10	NS		0.282		0.318		NS		NS		NS		0.120		U		NS		0.120	
		26-Jan-11	0.205	U	0.470		0.205		U		0.205		U		0.316		0.204		0.205		0.204	
		26-Jan-11**	NS		0.740		0.300		U		NS		NS		0.300		U		NS		0.120	
		27-Apr-11	0.120	U	0.174		0.120		U		0.222		0.120		0.120		U		0.120		0.120	
		26-Jul-11	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		28-Oct-11	0.190		0.180		0.180		U		0.180		U		0.180		U		0.180		0.120	
		23-Jan-12	0.210	U	0.210		0.210		U		0.210		U		0.210		U		0.210		0.210	
		13-Apr-12	0.180	U	0.180		0.180		U		0.180		U		0.180		U		0.180		0.240	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		0.180		0.180	
		20-Jun-12	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		1-Nov-12	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		1-Feb-13	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		29-Apr-13	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		9-Jul-13	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		9-Jul-13 RIDEM	NS		NS		NS		NS		NS		0.038	J	NS		NS		NS		0.030	J
		18-Oct-13	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		9-Jan-14	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		24-Apr-14	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		1-Aug-14	0.120	U	0.120		0.120		U		0.180		U		0.120		U		0.120		0.120	
		12-Sept-14 resample	NS		NS		NS		NS		NS		NS		0.120		U		NS		0.180	
		22-Oct-14	0.180	U	0.180		0.180		U		0.180		U		0.180		U		0.180		0.180	
		20-Jan-15	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.180	
		30-Mar-15 resample	NS		NS		NS		NS		NS		NS		NS		NS		0.140		NS	
		22-Apr-15	0.120	U	0.120		0.120		U		0.120		U		0.120		U		0.120		0.120	
		21-Jul-15	0.300	U	0.300 ^A	U	0.300	U	0.300	U	0.300	U	0.300	U	0.300	U	0.400	U	0.300	U	0.300	U
		23-Sept-15 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		29-Oct-15	0.300	U	0.300		0.170 ^J		0.300		U		0.300		0.210 ^J		0.300		0.300		0.400	
		4-Dec-15 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		27-Jan-16	0.12	U	0.13		0.12		U		0.14		0.12		U		0.61		0.12		0.12	
		20-Apr-16 ³	0.12	U	0.12		0.12		U		0.12		U		0.12		U		0.12		0.12	
		20-Jul-16	0.14	U	0.19		0.13		U		0.15		U		0.14		U		0.24		0.18	
		21-Oct-16	0.12	U	0.14		0.12		U		0.16		U		0.12		U		0.14		0.12	
		31-Jan-17	0.12	U	0.12		0.12		U		0.12		U		0.12		U		0.12		0.12	
		17-Apr-17 ⁴	0.18	U	0.18		0.18		U		0.18		U		1.1		0.18		0.18		0.18	
		26-Jul-17	0.12	U	0.12		0.12		U		0.12		U		2.4		0.12		0.12		0.12	
		12-Oct-17	0.12	U	0.12		0.12		U		0.12		U		0.36		0.12		0.12		0.12	
		10-Jan-18	0.12	U	0.12		0.12		U		0.12		U		0.13		0.12		0.			

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		27-Mar-08	2.420		2.380		2.280		2.110		2.600		2.560		2.700		2.070		2.070		2.210		2.210
		25-Apr-08	2.060		2.100		2.010		2.170		2.030		1.990		2.080		2.030		1.860		1.560		1.560
		29-May-08	1.700		1.630		1.540		1.760		1.630		1.610		1.780		1.600		1.600		2.220		2.220
		27-Jun-08	2.280		2.280		2.370		2.330		2.240		2.220		2.250		2.250		2.250		2.770		2.770
		31-Jul-08	2.030		2.020		1.970		1.970		1.910		1.920		1.920		1.900		1.850				
		28-Aug-08	3.600		2.870		2.920		2.870		2.920		2.800		2.800		2.980		2.500		2.500		U
		30-Sep-08	2.500		2.700		2.500		U		2.500		U		2.800		2.500		2.500		2.500		U
		27-Oct-08	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	
		25-Nov-08	2.500	U	2.500	U	2.500	U	2.500	U	3.400	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	
		18-Dec-08	2.700		2.500		2.500		U		2.500		U		2.500		U		2.500		2.500		U
		21-Jan-09	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	
		25-Feb-09	2.500	U	2.500	U	2.500	U	NS		2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	
		26-Mar-09	2.220		2.190		2.120		2.090		2.220		2.180		2.080		2.120		2.130				
		29-Apr-09	2.500		2.260		2.460		2.320		2.260		2.320		2.380		2.360		2.160				
		22-Jul-09	3.140		3.120		2.920		3.090		2.780		3.170		2.690		2.960		3.130				
		9-Oct-09	2.290		2.560		2.300		2.320		2.300		2.280		2.300		2.290		2.210				
		15-Jan-10	27.800		2.550		2.480		2.590		2.410		2.540		2.450		2.410		2.430				
		21-Apr-10	2.340		2.320		2.520		2.330		2.330		2.260		2.320		2.330		2.240				
		16-Jul-10	2.480		2.560		2.430		2.520		3.690		2.480		2.550		2.480		2.740				
		15-Oct-10	2.460		2.410		2.560		2.400		2.470		2.410		2.450		2.450		2.630				
		30-Nov-10	NS		2.480		2.550		NS		NS		NS		2.390		NS		NS				
		26-Jan-11	2.680		2.640		2.340		2.660		2.150		2.580		2.370		2.560		2.230		2.480		2.440
		26-Jan-11**	NS		2.800		2.700		NS		NS		NS		2.600		NS		NS				
		27-Apr-11	2.070		2.820		2.200		2.450		2.160		2.210		2.220		2.210		2.460				
		26-Jul-11	2.290		2.270		2.270		2.360		2.260		2.340		2.250		2.260		2.350				
		28-Oct-11	2.700		2.400		2.800		2.600		2.800		2.500		2.600		2.800		2.500				
		23-Jan-12	1.700		1.800		1.600		1.500		2.000		2.000		1.800		1.900		2.000				
		13-Apr-12	2.100		2.100		2.000		2.000		1.800		1.900		1.700		1.700		1.300				
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		2.700		2.500		2.500
		20-Jun-12	2.500		2.600		2.500		2.400		2.700		2.300		2.500		2.500		2.300				
		1-Nov-12	2.000		2.200		2.100		2.200		2.000		2.100		2.100		2.000		2.100				
		1-Feb-13	1.600		1.600		1.600		1.600		1.600		1.600		1.600		1.700		1.600				
		29-Apr-13	2.400		2.600		2.600		2.400		2.400		2.300		2.400		2.400		2.400				
		9-Jul-13	0.950		0.980		0.930		0.960		0.990		1.000		0.980		0.970		1.000				
		18-Oct-13	2.000		2.200		1.900		2.000		1.900		2.000		1.900		2.000		2.000				
		9-Jan-14	1.400		1.500		1.400		1.400		1.500		1.500		1.500		1.600		1.600				
		24-Apr-14	2.300		2.400		2.300		2.400		2.800		2.400		2.500		2.400		2.500		2.500		2.500
		1-Aug-14	1.500		1.600		1.500		1.600		1.500		1.600		1.600		1.500		1.700				
		12-Sept-14 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		
	Dichlorodifluoromethane	91.0	22-Oct-14	1.400	1.400	1.400	1.500	1.400	1.400	1.400	1.500	1.500	1.500	1.400	1.400	1.400	1.300	1.500	1.500				
		20-Jan-15	1.400		1.500																		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
		8-Feb-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Mar-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		25-Apr-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		29-May-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Jun-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		31-Jul-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		28-Aug-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		30-Sep-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		27-Oct-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		25-Nov-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		18-Dec-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		21-Jan-09	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		25-Feb-09	2.000	U	2.000	U	2.000	U	NS		2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		26-Mar-09	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		29-Apr-09	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		22-Jul-09	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		9-Oct-09	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		15-Jan-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		21-Apr-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		16-Jul-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		15-Oct-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		30-Nov-10	NS		0.081	U	0.081	U	NS		NS		NS		NS		NS		NS		NS	
		26-Jan-11	0.138	U	0.138	U	0.138	U	0.138	U	0.137	U	0.138	U	0.138	U	0.138	U	0.138	U	0.138	U
		26-Jan-11**	NS		0.200	U	0.200	U	NS		NS		NS		NS		NS		NS		NS	
		27-Apr-11	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		26-Jul-11	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		28-Oct-11	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U
		23-Jan-12	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		13-Apr-12	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		1-Nov-12	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		1-Feb-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		29-Apr-13	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		9-Jul-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		9-Jul-13 RIDEM	NS		NS		NS		NS													

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
		8-Feb-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Mar-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		25-Apr-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		29-May-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Jun-08	0.080	U	0.081	U	0.080	U	0.084	U	0.080	U	0.080	U	0.178	U	0.080	U	0.081	U	0.081	U
		31-Jul-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		28-Aug-08	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		30-Sep-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.081	U	0.081	U	0.080	U
		27-Oct-08	0.080	U	0.150	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		25-Nov-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		18-Dec-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		21-Jan-09	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		25-Feb-09	0.080	U	0.080	U	0.080	U	NS	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		26-Mar-09	0.102	U	0.084	U	0.087	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		29-Apr-09	0.081	U	0.081	U	0.081	U	0.081	U	0.089	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		22-Jul-09	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		9-Oct-09	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		15-Jan-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		21-Apr-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		16-Jul-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		15-Oct-10	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		30-Nov-10	NS		0.081	U	0.081	U	NS	U	NS	U	NS	U	0.081	U	NS	U	NS	U	NS	U
		26-Jan-11	0.138	U	0.138	U	0.138	U	0.138	U	0.137	U	0.138	U	0.138	U	0.138	U	0.138	U	0.138	U
		26-Jan-11**	NS		0.200	U	0.200	U	NS	U	NS	U	0.200	U	NS	U	NS	U	NS	U	NS	U
		27-Apr-11	0.081	U	0.081	U	0.081	U	0.081	U	0.093	U	0.081	U	0.081	U	0.089	U	0.081	U	0.081	U
		26-Jul-11	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U
		28-Oct-11	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U	0.061	U
		23-Jan-12	0.071	U	0.071	U	0.071	U	0.071	U	0.071	U	0.091	U	0.071	U	0.071	U	0.071	U	0.071	U
		13-Apr-12	0.066	U	0.068	U	0.061	U	0.061	U	0.063	U	0.063	U	0.061	U	0.075	U	0.081	U	0.081	U
		2-Jul-12 resample	NS		NS		NS		NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U
		20-Jun-12	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.080	U	0.081	U	0.081	U	0.081	U	0.081	U
		1-Nov-12	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		1-Feb-13	0.076		0.084		0.083		0.086		0.089		0.089		0.079		0.099		0.110		0.084	
		29-Apr-13	0.094		0.099		0.099		0.096		0.160		0.099		0.091		0.092		0.084		0.084	
		9-Jul-13	0.058		0.060		0.047		0.052		0.081		0.049		0.053		0.047		0.047		0.051	
		9-Jul-13 RIDEM	NS		NS		NS		NS	U												

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
		8-Feb-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Mar-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		25-Apr-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		29-May-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Jun-08	0.079	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		31-Jul-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		28-Aug-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		30-Sep-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		27-Oct-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		25-Nov-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		18-Dec-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		21-Jan-09	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		25-Feb-09	2.000	U	2.000	U	2.000	U	NS		2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		26-Mar-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		29-Apr-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		22-Jul-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.111	U	0.079	U	0.079	U	0.079	U	0.079	U
		9-Oct-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		15-Jan-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		21-Apr-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		16-Jul-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		15-Oct-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		30-Nov-10	NS		0.079	U	0.079	U	NS		NS		NS		NS		NS		NS		NS	
		26-Jan-11	0.135	U	0.135	U	0.135	U	0.135	U	0.134	U	0.135	U	0.135	U	0.135	U	0.135	U	0.135	U
		26-Jan-11**	NS		0.200	U	0.200	U	NS		NS		NS		0.200	U	NS		NS		NS	
		27-Apr-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		26-Jul-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		28-Oct-11	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.040	U
		23-Jan-12	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		13-Apr-12	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.079	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		1-Nov-12	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		1-Feb-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		29-Apr-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		9-Jul-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		9-Jul-13 RIDEM	NS		NS		NS															

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
cis-1,2-Dichloroethene*	18.0	8-Feb-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U			0.080	U
		27-Mar-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U			0.080	U
		25-Apr-08	0.080	U	0.080	U	0.080	U	0.100	U	0.080	U	0.080	U	0.080	U	0.080	U			0.080	U
		29-May-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U			0.080	U
		27-Jun-08	0.080	U	0.079	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U			0.079	U
		31-Jul-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		28-Aug-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.092	U	0.079	U			0.090	U
		30-Sep-08	5.900	U	5.900	U	5.900	U	5.900	U	5.900	U	5.900	U	5.900	U	5.900	U			5.900	U
		27-Oct-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U			2.000	U
		25-Nov-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U			2.000	U
		18-Dec-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U			2.000	U
		21-Jan-09	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U			2.000	U
		25-Feb-09	2.000	U	2.000	U	2.000	U	NS	U	2.000	U	2.000	U	2.000	U	2.000	U			2.000	U
		26-Mar-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		29-Apr-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		22-Jul-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		9-Oct-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		15-Jan-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		21-Apr-10	0.079	U	0.780	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		16-Jul-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		15-Oct-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		30-Nov-10	NS		0.079	U	0.079	U														
		26-Jan-11	0.135	U	0.135	U	0.135	U	0.135	U	0.134	U	0.135	U	0.135	U	0.135	U	0.135	U	0.135	U
		26-Jan-11**	NS		0.200	U	0.200	U														
		27-Apr-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		26-Jul-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		28-Oct-11	0.069	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U			0.040	U
		23-Jan-12	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U			0.140	U
		13-Apr-12	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U			0.079	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		1-Nov-12	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U			0.040	U
		1-Feb-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U			0.040	U
		29-Apr-13	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U			0.079	U
		9-Jul-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U			0.040	U

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/ Interim RIDEM-Approved Action Level	Sample Date	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
			Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual
trans-1,2-Dichloroethene	37.0	8-Feb-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Mar-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		25-Apr-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		29-May-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		27-Jun-08	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U	0.080	U
		31-Jul-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		28-Aug-08	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		30-Sep-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		27-Oct-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		25-Nov-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		18-Dec-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		21-Jan-09	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		25-Feb-09	2.000	U	2.000	U	2.000	U	NS		2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U
		26-Mar-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		29-Apr-09	0.079	U	0.079	U	0.091	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		22-Jul-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		9-Oct-09	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		15-Jan-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		21-Apr-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		16-Jul-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		15-Oct-10	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		30-Nov-10	NS		0.079	U	0.079	U	NS		NS		NS		NS		NS		NS		NS		NS	
		26-Jan-11	0.135	U	0.135	U	0.135	U	0.135	U	0.134	U	0.134	U	0.135	U	0.135	U	0.135	U	0.135	U	0.135	U
		26-Jan-11**	NS		0.200	U	0.200	U	NS		NS		NS		0.200	U	NS		NS		NS		NS	
		27-Apr-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		26-Jul-11	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		28-Oct-11	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.040	U
		23-Jan-12	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		13-Apr-12	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		1-Nov-12	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		1-Feb-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		29-Apr-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		9-Jul-13	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		18-Oct-13	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		9-Jan-14	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U
		24-Apr-14	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		1-Aug-14	0.079	U	0.079	U	0.079	U	0.120	U	0.250	U	0.079	U	0.079	U	0.079	U	0.079	U	0.079	U	0.090	U
		12-Sept-14 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		22-Oct-14	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U	0.059	U
		20-Jan-15	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		30-Mar-15 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		22-Apr-15	0.040	U	0.040	U	0.040 ^v	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U	0.040	U
		21-Jul-15	0.200	U	0.200 ^A	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U
		23-Sept-15 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		29-Oct-15	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U
		4-Dec-15 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/ Interim RIDEM-Approved Action Level	Sample Date	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)		
			Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	Room	Qual	
cis-1,3-Dichloropropene	None	8-Feb-08	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	
		27-Mar-08	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		25-Apr-08	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		29-May-08	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	
		27-Jun-08	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.185	U	0.090	U	0.090	U	0.091	U	
		31-Jul-08	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		28-Aug-08	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		30-Sep-08	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	
		27-Oct-08	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	
		25-Nov-08	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	
		18-Dec-08	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	
		21-Jan-09	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	
		25-Feb-09	0.180	U	0.180	U	0.180	U	NS	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	0.180	U	
		26-Mar-09	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		29-Apr-09	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		22-Jul-09	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		9-Oct-09	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		15-Jan-10	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		21-Apr-10	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		16-Jul-10	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		15-Oct-10	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		30-Nov-10	NS	U	0.091	U	0.091	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		26-Jan-11	0.155	U	0.154	U	0.155	U	0.154	U	0.155	U	0.154	U	0.154	U	0.154	U	0.155	U	0.154	U	0.155	U	
		26-Jan-11**	NS	U	0.230	U	0.230	U	NS	U	NS	U	NS	U	NS	U	0.230	U	NS	U	NS	U	NS	U	
		27-Apr-11	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		26-Jul-11	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		28-Oct-11	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	
		23-Jan-12	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	0.160	U	
		13-Apr-12	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	
		2-Jul-12 resample	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		20-Jun-12	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		1-Nov-12	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	
		1-Feb-13	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	
		29-Apr-13	0.045	U	0.250	U	0.045	U	0.045	U	0.250	U	0.045	U	0.045	U	0.450	U	0.045	U	0.045	U	0.045	U	
		9-Jul-13	0.045	U	0.250	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	
		9-Jul-13 RIDEM	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		18-Oct-13	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		9-Jan-14	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		24-Apr-14	0.045	U	0.045	U	0.045	U	0.040	U	0.040	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	
		1-Aug-14	0.091	U	0.091	U	0.091	U	0.140	U	0.140	U	1.000	U	0.091	U	0.091	U	0.091	U	0.091	U	0.091	U	
		12-Sept-14 resample	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		22-Oct-14	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	0.068	U	
		20-Jan-15	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	
		30-Mar-15 resample	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		22-Apr-15	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	0.045	U	
		21-Jul-15	0.200	^	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.300	U	0.300	U	0.300	U	0.300	U
		23-Sept-15 resample	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		29-Oct-15	0.300	U	0.200	U	0.200	U	0.300	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.200	U	0.300	U	
		4-Dec-15 resample	NS	U	0.200	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	
		27-Jan-16	0.045	U																					

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level			Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
Ethylbenzene	53.0	8-Feb-08	0.260		0.230		0.620		0.450		0.250		0.170		0.160		0.180		0.220		0.096		0.087	U	
		27-Mar-08	0.841		0.669		1.020		0.869		0.894		1.000		0.712		0.705		0.650		0.090		0.255	U	
		25-Apr-08	0.770		0.637		2.200		0.711		0.678		0.120		0.160		0.150		0.110		0.369		0.944	U	
		29-May-08	0.140		0.120		1.310		0.620		0.478		0.400		0.491		0.262		0.216		0.255		0.200	U	
		27-Jun-08	0.555		0.412		1.080		0.987		0.426		0.761		0.854		0.870		0.783		0.944		0.200	U	
		31-Jul-08	0.553		0.449		1.140		0.424		0.426		0.200		0.200		0.200		0.200		0.200		0.200	U	
		28-Aug-08	0.868		1.150		3.010		2.820		0.761		0.200		0.200		0.200		0.200		0.200		0.200	U	
		30-Sep-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		27-Oct-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		25-Nov-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		18-Dec-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		21-Jan-09	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		25-Feb-09	2.200	U	2.200	U	3.600	NS			2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		26-Mar-09	0.932		0.803		1.120		1.060		0.511		0.648		0.738		0.589		0.727		0.152		0.178		
		29-Apr-09	0.195		0.234		0.633		0.538		0.195		0.139		0.139		0.152		0.180		0.542		0.286		
		22-Jul-09	0.442		0.212		1.090		0.291		0.551		0.625		0.807		0.542		0.161		0.143		0.143	U	
		9-Oct-09	0.859		0.759		1.090		1.030		0.794		0.681		0.668		0.633		0.746		0.255		0.255	U	
		15-Jan-10	0.447		0.334		0.386		0.351		0.321		0.256		0.273		0.252		0.286		0.121		0.121	U	
		21-Apr-10	0.468		0.716		1.280		0.612		0.681		0.603		0.542		0.538		0.087		0.170		0.170	U	
		16-Jul-10	0.334		0.226		0.416		0.408		0.573		0.286		0.872		0.260		0.130		0.130		0.130		
		15-Oct-10	0.252		0.308		0.412		0.152		0.126		0.087		0.200		0.087		0.121		0.121		0.121		
		30-Nov-10	NS		0.217		0.338		NS		NS		0.108		NS		NS		NS		NS		NS		
		26-Jan-11	1.040		1.000		1.100		1.220		1.000		1.100		0.951		1.320		0.988		0.466		1.300		
		26-Jan-11**	NS		1.600		1.800		NS		NS		1.800		NS		NS		NS		NS		NS		
		27-Apr-11	0.108		0.139		0.625		0.221		0.837		0.087		0.200		0.087		U		0.091		0.091		
		26-Jul-11	0.473		1.020		0.873		0.417		0.300		0.191		0.356		0.178		0.161		0.161		0.161		
		28-Oct-11	0.600		0.320		0.400		0.230		0.480		0.490		0.490		0.420		0.130		0.130		0.130		
		23-Jan-12	0.610		0.480		0.470		0.660		0.580		0.500		0.560		0.560		0.130		0.130		0.130		
		13-Apr-12	0.300		0.250		0.300		0.240		0.250		0.280		0.240		0.200		0.170		0.170		0.170		
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		U		0.130		0.130		
		20-Jun-12	0.490		0.500		0.490		0.560		0.550		0.460		0.530		0.530		0.470		0.470		0.470		
		1-Nov-12	0.760		0.440		0.330		0.530		0.450		0.730		0.810		0.630		0.130		0.130		0.130		
		1-Feb-13	0.130		0.087		U		0.087		0.110		0.089		0.190		0.087		U		0.130		0.130		
		29-Apr-13	0.760		0.540		0.540		0.540		0.670		0.430		1.600		0.530		0.150		0.310		0.310		
		9-Jul-13	0.340		0.320		0.310		0.330		0.390		0.310		0.350		0.320		NS		0.330		0.330		
		9-Jul-13 RIDEM	NS		NS		NS		NS		NS		0.464		NS		NS		NS		NS		NS		
		18-Oct-13	0.710		0.096		0.110		0.540		0.770		0.120		1.400		0.900		0.430		0.210		0.210		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		27-Mar-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		25-Apr-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		29-May-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		27-Jun-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		31-Jul-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		28-Aug-08	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		30-Sep-08	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	12.700	U	4.900	U	4.900	U	
		27-Oct-08	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	
		25-Nov-08	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	
		18-Dec-08	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	
		21-Jan-09	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	
		25-Feb-09	4.900	U	4.900	U	2.460	U	NS		4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	4.900	U	
		26-Mar-09	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		29-Apr-09	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		22-Jul-09	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		9-Oct-09	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		15-Jan-10	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		21-Apr-10	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		16-Jul-10	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	0.043	I	2.460	U	2.460	U	
		15-Oct-10	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		30-Nov-10	NS		2.460	U	2.460	U	NS		NS		2.460	U	NS		NS		NS		NS		
		26-Jan-11	4.190	U	4.180	U	4.190	U	4.180	U	4.190	U	4.170	U	4.180	U	4.190	U	4.180	U	4.180	U	
		26-Jan-11**	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		
		27-Apr-11	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		26-Jul-11	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	2.460	U	
		28-Oct-11	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.250	U	0.250	U	
		23-Jan-12	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	0.440	U	
		13-Apr-12	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.370	U	0.500	U	0.500	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS		
		20-Jun-12	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		1-Nov-12	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		1-Feb-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		29-Apr-13	0.250	U	0.250	U	0.250	U	0.250	U	0.051	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		9-Jul-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.050	J	NS		NS		NS		0.024	J	NS		
		18-Oct-13	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	0.250	U	
		9-Jan-14	0.250	U	0.390																		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date																				
		8-Feb-08	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U
		27-Mar-08	0.440		0.102		0.102		0.091		0.095		0.098		0.102		0.090		0.072		0.072	
		25-Apr-08	0.116		0.116		0.107		0.127		0.126		0.121		0.131		0.113		0.072		0.072	
		29-May-08	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U	0.070	U
		27-Jun-08	0.072	U	0.070	U	0.070	U	0.074		0.070	U	0.070	U	0.070	U	0.070	U	0.072		0.072	U
		31-Jul-08	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072		0.072	U
		28-Aug-08	0.095		0.130		0.123		0.123		0.091		0.106		0.115		0.089		0.094		0.094	
		30-Sep-08	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U
		27-Oct-08	1.800	U	1.800	U	1.800	U	1.800	U	2.600		2.300		1.800		1.800		1.800		1.800	
		25-Nov-08	2.100		1.800		1.800		1.800		2.800		1.800		1.800		1.800		1.800		1.800	
		18-Dec-08	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U
		21-Jan-09	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U	1.800	U
		25-Feb-09	1.800	U	2.700	U	1.800	U	NS		1.800	U	2.700		1.800		1.800	U	1.800	U	1.800	U
		26-Mar-09	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		29-Apr-09	0.072	U	0.072	U	2.350		0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		22-Jul-09	0.072	U	0.072	U	0.223		0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.169	
		9-Oct-09	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		15-Jan-10	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		21-Apr-10	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		16-Jul-10	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		15-Oct-10	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		30-Nov-10	NS		0.072	U	0.072	U	NS		NS		NS		0.072	U	NS		NS		NS	
		26-Jan-11	0.123	U	0.122	U	0.123	U	0.123	U	0.123	U	0.122	U	0.122	U	0.123	U	0.122	U	0.122	U
		26-Jan-11**	NS		0.180	U	0.180	U	NS		NS		0.180	U	NS		NS		NS		NS	
		27-Apr-11	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		26-Jul-11	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		28-Oct-11	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U
		23-Jan-12	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U	0.130	U
		13-Apr-12	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.140	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		1-Nov-12	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		1-Feb-13	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		29-Apr-13	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		9-Jul-13	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U	0.072	U
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.041	J	NS		NS		NS		NS		0.200	U
		18-Oct-13	0.072	U	0.072	U	0.072	U</														

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
Methylene chloride	3.0	8-Feb-08	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		27-Mar-08	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		25-Apr-08	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	2.210				1.740	U	
		29-May-08	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		27-Jun-08	1.740	U	1.740	U	1.740	U	3.210	U	1.740	U	6.940	U	1.740	U	1.740	U			19.000		
		31-Jul-08	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		28-Aug-08	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		30-Sep-08	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U			1.700	U	
		27-Oct-08	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U			1.700	U	
		25-Nov-08	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U			1.700	U	
		18-Dec-08	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U			1.700	U	
		21-Jan-09	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U	1.700	U			1.700	U	
		25-Feb-09	1.700	U	1.700	U	1.700	U	NS		1.700	U	1.700	U	1.700	U	1.700	U			1.700	U	
		26-Mar-09	7.540		1.870		4.010		2.100		1.850		3.230		4.060		1.990				11.600		
		29-Apr-09	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	0.147	U	1.740	U	1.740	U			1.740	U	
		22-Jul-09	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		9-Oct-09	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		15-Jan-10	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		21-Apr-10	5.410		1.740		1.740	U	1.740	U	1.740	U	1.740	U	1.740	U	1.740	U			1.740	U	
		16-Jul-10	18.400		23.300		16.900		13.900		19.900		48.200		46.700		22.200				20.600		
		15-Oct-10	3.470	U	4.440		4.510		3.470		3.470		3.470		5.840		3.470		3.470		3.470	U	
		30-Nov-10	NS		3.570		11.600		NS		NS		NS		5.770		NS		NS		NS		
		26-Jan-11	4.530		2.950		2.960	U	2.960		2.950		2.950	U	5.290		2.960	U	4.880	2.960	2.950	U	
		26-Jan-11**	NS		2.500		1.700		NS		NS		NS		1.600		NS		NS		NS		
		27-Apr-11	3.470	U	3.470	U	3.470	U	3.470	U	3.470	U	3.470	U	5.040		3.470	U			3.470	U	
		26-Jul-11	3.470	U	5.800		4.240		3.470		3.470		3.470		3.510		10.200				5.380		
		28-Oct-11	1.900		1.900		1.800		1.900		1.000		1.200		5.700		5.500				0.690		
		23-Jan-12	2.500		1.200		2.300		2.200		2.500		6.300		1.900		1.200				1.900		
		13-Apr-12	5.800		4.600		3.100		1.100		1.000		1.700		1.000		50.000				53.000		
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		1.000		1.000				1.000		
		20-Jun-12	0.920		1.600		0.880		1.300		1.200		1.400		1.100		1.400				1.700		
		1-Nov-12	0.690	U	1.200		0.750		0.690	U	0.690	U	0.760		1.200		0.690	U			1.200		
		1-Feb-13	0.800		0.690		0.690		0.810		0.810		2.200		0.810		0.760				0.690		
		29-Apr-13	1.400		0.950		0.950		1.200		1.200		1.100		1.400		1.100				1.500		
		9-Jul-13	1.100		0.730		0.990		1.800		0.890		1.300		1.800		0.850				1.200		
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.298		NS		NS		NS				0.477		
		18-Oct-13	0.730		0.780		0.690	U	0.760		0.690	U	0.740		0.840		0.690	U			0.710		
		9-Jan-14	0.690	U	0.880		0.690	U	2.000		0.690	U	1.100		1.400		0.810				3.700		
		24-Apr-14	0.690	U	0.690	U	3.000		0.690	U	3.000		0.690	U	260 ^b						0.690		
		1-Aug-14	2.800		1.500		1.300		1.900		4.300		1.800		1.600		2.000				2.200		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		27-Mar-08	2.050	U	2.105	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		25-Apr-08	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		29-May-08	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		27-Jun-08	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		31-Jul-08	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		28-Aug-08	2.050	U	2.050	U	2.050	U	2.540	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		30-Sep-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	
		27-Oct-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	
		25-Nov-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	
		18-Dec-08	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	
		21-Jan-09	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	
		25-Feb-09	2.000	U	2.000	U	2.000	U	NS	U	2.600	U	2.000	U	2.000	U	2.000	U	2.000	U	2.000	U	
		26-Mar-09	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		29-Apr-09	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		22-Jul-09	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		9-Oct-09	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		15-Jan-10	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		21-Apr-10	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.250	U	2.050	U	2.050	U	
		16-Jul-10	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		15-Oct-10	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		30-Nov-10	NS	2.050	U	2.050	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U	NS	U		
		26-Jan-11	3.490	U	3.480	U	3.490	U	3.480	U	3.490	U	59.500	U	3.480	U	6.760	U	3.480	U	3.480	U	
		26-Jan-11**	NS	0.200	U	0.200	U	NS	U	NS	U	0.200	U	NS	U	0.200	U	NS	U	0.200	U		
		27-Apr-11	2.050	U	2.050	U	2.050	U	2.050	U	2.930	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		26-Jul-11	11.700	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	2.050	U	
		28-Oct-11	2.100	U	0.490	U	0.840	U	0.560	U	0.800	U	0.930	U	1.500	U	1.200	U	0.390	U	0.390	U	
		23-Jan-12	0.140	U	0.140	U	0.210	U	0.190	U	26.000	U	2.900	U	0.230	U	270.000	U	0.540	U	0.540	U	
		13-Apr-12	0.120	U	0.120	U	0.200	U	0.120	U	0.150	U	0.230	U	0.120	U	0.140	U	0.160	U	0.120	U	
		2-Jul-12 resample	NS	NS	NS	NS	NS	NS	NS	U	NS	U	NS	U	NS	U	0.140	U	0.120	U	0.120	U	
		20-Jun-12	0.230	U	0.082	U	0.460	U	0.250	U	0.320	U	0.270	U	0.190	U	0.320	U	0.120	U	0.120	U	
		1-Nov-12	0.082	U	0.260	U	0.180	U	0.420	U	0.500	U	0.650	U	0.082	U	0.220	U	0.170	U	0.170	U	
		1-Feb-13	0.093	U	0.100	U	0.120	U	0.082	U	0.190	U	0.280	U	0.082	U	0.082	U	0.095	U	0.095	U	
		29-Apr-13	2.900	U	0.290	U	0.290	U	0.420	U	0.510	U	0.320	U	0.450	U	0.400	U	0.390	U	0.390	U	
		9-Jul-13	0.250	U	0.320	U	0.300	U	0.320	U	0.350	U	0.400	U	0.270	U	0.280	U	0.220	U	0.220	U	
		18-Oct-13	1.800	U	0.220	U	0.190	U	1.500	U	2.200	U	0.850	U	3.300	U	2.400	U	1.500	U	1.500	U	
		9-Jan-14	0.082	U	0.082	U	0.110	U	0.130	U	0.150	U											

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
Styrene	52.0	8-Feb-08	0.710		0.130		0.090	U	0.090	U	0.090	U	0.090	U	0.090	U	0.090	U			0.090	U	
		27-Mar-08	1.200		0.118		0.120		0.165		0.140		0.175		0.114		0.139				0.085	U	
		25-Apr-08	0.856		0.156		0.180		0.184		0.137		0.137		0.158		0.124				0.085	U	
		29-May-08	0.550		0.085	U	0.130		0.260		0.090	U	0.110		0.090		0.090	U			0.090	U	
		27-Jun-08	1.830		0.085	U	0.112		0.186		0.191		0.085	U	0.481		0.090	U			0.085	U	
		31-Jul-08	1.890		0.254		0.153		0.266		0.285		0.288		0.109		0.090				0.085	U	
		28-Aug-08	0.654		0.368		0.262		0.392		0.203		0.165		0.169		0.140				0.108		
		30-Sep-08	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U			2.100	U	
		27-Oct-08	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U			2.100	U	
		25-Nov-08	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U			2.100	U	
		18-Dec-08	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U			2.100	U	
		21-Jan-09	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U	2.100	U			2.100	U	
		25-Feb-09	2.100	U	2.100	U	2.100	U	NS		2.100	U	2.100	U	2.100	U	2.100	U			2.100	U	
		26-Mar-09	0.814		0.113		0.110		0.110		0.125		0.111		0.128		0.138				0.122		
		29-Apr-09	0.515		0.085	U	0.136	U	0.085	U	0.136		0.085	U	0.085	U	0.085	U			0.085	U	
		22-Jul-09	1.280		0.085	U	0.153		0.085	U	0.285		0.272		0.213		0.217				0.187		
		9-Oct-09	0.838		0.153		0.149		0.174		0.566		0.179		0.140		0.149				0.140		
		15-Jan-10	1.100		0.221		0.085	U	0.089		0.196		0.098		0.085	U	0.085	U			0.085	U	
		21-Apr-10	0.281		0.204		0.289		0.187		0.328		0.174		0.145		0.140				0.085	U	
		16-Jul-10	0.702		0.085	U	0.085	U	0.085	U	0.779		0.085	U	0.085	U	0.085	U			0.085	U	
		15-Oct-10	0.549		0.085	U	0.085	U	0.085	U	0.098		0.805	U	0.085	U	0.085	U			0.085	U	
		30-Nov-10	NS		0.149		0.119		NS		NS		NS		0.085	U	NS				NS		
		26-Jan-11	0.327		0.224		0.174		0.217		0.182		0.202		0.145	U	0.182	0.174	0.145	U	0.188		
		26-Jan-11**	NS		0.510		0.370		NS		NS		0.370		NS		NS				NS		
		27-Apr-11	0.166		0.166		0.170		0.192		0.277		0.085	U	0.145		0.085	U			0.085	U	
		26-Jul-11	0.677		2.460		0.132		11.700		0.315		1.320		0.200		0.085	U			0.085	U	
		28-Oct-11	0.300		0.130	U	0.130	U	0.130	U	0.330		0.130	U	0.130	U	0.130	U			0.085	U	
		23-Jan-12	0.820		0.250		0.410		0.480		0.270		0.510		0.150	U	0.150	U			0.150	U	
		13-Apr-12	0.560		0.140		0.130	U	0.130	U	0.550		0.280		0.130	U	0.130	U			0.170	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS				0.130	U	
		20-Jun-12	0.720		0.300		0.240		1.200		0.430		0.150		0.085	U	0.200				0.200		
		1-Nov-12	0.280		0.140		0.085	U	0.130		0.150		0.160		0.180		0.160				0.085	U	
		1-Feb-13	0.870		0.085	U	0.085	U	0.085	U	0.095		0.085	U	0.085	U	0.085	U			0.085	U	
		29-Apr-13	1.600		0.230		0.230		0.200		0.740		0.150		0.520		0.210				0.085	U	
		9-Jul-13	0.410		0.120		0.085	U	0.140		0.410		0.085	U	0.110		0.085	U			0.085	J	
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.420		NS		NS		NS				0.039	J	
		18-Oct-13	0.200		0.085	U	0.085	U	0.130		0.270		0.110		0.340		0.290				0.130		
		9-Jan-14	0.260		0.260		0.085	U	0.085	U	0.085	U	0.085	U	0.120		0.085	U			0.085	U	
		24-Apr-14	1.100		0.085	U	0.085	U	0.085	U	0.085	U	0										

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		27-Mar-08	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		25-Apr-08	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		29-May-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		27-Jun-08	0.140	U	0.140	U	0.140	U	0.137	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		31-Jul-08	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		28-Aug-08	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		30-Sep-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		27-Oct-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		25-Nov-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		18-Dec-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		21-Jan-09	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		25-Feb-09	0.140	U	0.140	U	0.140	U	NS		0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		26-Mar-09	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		29-Apr-09	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		22-Jul-09	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		9-Oct-09	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		15-Jan-10	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		21-Apr-10	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		16-Jul-10	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		15-Oct-10	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		30-Nov-10	NS		0.137	U	0.137	U	NS		NS		NS		NS		NS		NS		NS	
		26-Jan-11	0.234	U	0.234	U	0.234	U	0.234	U	0.233	U	0.233	U	0.234	U	0.233	U	0.234	U	0.233	U
		26-Jan-11**	NS		0.340	U	0.340	U	NS		NS		0.340	U	NS		0.340	U	NS		0.340	U
		27-Apr-11	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		26-Jul-11	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U	0.137	U
		28-Oct-11	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U
		23-Jan-12	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U	0.240	U
		13-Apr-12	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U	0.100	U
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS		NS		NS	
		20-Jun-12	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		1-Nov-12	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U
		1-Feb-13	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U
		29-Apr-13	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U	0.069	U
		9-Jul-13	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U
		9-Jul-13 RIDEM	NS		NS		NS</															

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																					
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)
		Sample Date																				
		8-Feb-08	0.140		0.140	U	0.140	U	0.150		0.140	U	0.140	U	0.140	U	0.140	U	0.140		0.350	
		27-Mar-08 ²	12,500		6,680		13,300		16,100		26,000		7,730		23,300		4,310				0.153	
		25-Apr-08	0.180		0.254		0.179		0.282		0.231		0.276		0.228		0.298				0.136	U
		29-May-08	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U	0.140	U			0.140	U
		27-Jun-08	0.249		0.449		0.397		0.459		0.424		0.243		0.460		0.246				0.216	
		31-Jul-08	1,030		1,000		0.877		0.880		0.795		0.872		0.252		0.287				0.154	
		28-Aug-08	0.321		0.367		0.283		0.323		0.274		0.434		0.294		0.282				0.445	
		30-Sep-08	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U			3,400	U
		27-Oct-08	4,200	U	4,200	U	4,200	U	4,200	U	4,200	U	4,200	U	4,200	U	4,200	U			4,200	U
		25-Nov-08	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U			3,400	U
		18-Dec-08	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U			3,400	U
		21-Jan-09	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U	3,400	U			3,400	U
		25-Feb-09	3,400	U	3,400	U	3,400	U	NS		3,400	U	3,400	U	3,400	U	3,400	U			3,400	U
		26-Mar-09	1,530		1,210		1,170		0.980		1,080		1,320		1,420		1,890				1,380	
		29-Apr-09	0.136	U	0.136	U	0.697		0.136	U	0.136	U	0.136	U	0.136	U	0.136	U			0.136	U
		22-Jul-09	0.291		0.190		0.224		0.196		0.196		0.196		0.183		0.210				0.535	
		9-Oct-09	2,250		1,550		1,580		1,580		1,380		1,700		2,080		1,960				0.779	
		15-Jan-10	0.359		0.346		0.339		0.373		0.312		3,460		0.346		0.312				2,450	
		21-Apr-10	0.637		0.752		0.440		0.650		0.508		0.447		0.407		0.474				0.562	
		16-Jul-10	0.318		0.420		0.420		0.427		0.501		0.230		0.447		0.474				0.230	
		15-Oct-10	0.136	U	0.136	U	0.136	U	0.136	U	0.136	U	0.136	U	0.136	U	0.136	U			0.142	
		30-Nov-10	NS		0.461		0.291		NS		NS		0.169		NS		NS				NS	
		26-Jan-11	0.636		0.484		0.370		0.566		0.440		0.725		0.346		0.578		0.428		0.426	
		26-Jan-11**	NS		0.580		0.490		U		NS		NS		0.480		NS				NS	
		27-Apr-11	0.142		0.176		0.176		0.352		0.176		0.136		0.149		0.136		U		0.285	
		26-Jul-11	0.529		0.563		0.522		0.631		0.549		0.325		0.739		0.461				0.224	
		28-Oct-11	0.100	U	0.140	U	0.100	U	0.100	U	0.100	U	0.110	U	0.100	U	0.100	U			0.068	U
		23-Jan-12	0.240	U	0.240	U	0.240	U	0.590		0.320		0.510		0.260		0.410				0.260	
		13-Apr-12	0.150		0.110		0.120		0.250		0.150		0.160		0.190		0.190				0.140	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.190				0.130	
		20-Jun-12	0.390		0.800		0.310		0.370		0.390		0.400		0.410		0.440				0.240	
		1-Nov-12	0.360		0.460		0.400		0.730		0.470		0.770		0.600		0.560				0.120	
		1-Feb-13	0.130		0.095		0.073		0.120		0.090		0.210		0.440		0.092				0.140	
		29-Apr-13	0.610		0.560		0.560		0.630		0.880		0.046		0.650		0.580				0.320	
		9-Jul-13	0.270		0.240		0.230		0.260		0.250		0.320		0.440		0.280				0.280	
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.279		NS		NS		NS				0.281	
		18-Oct-13	0.140	U	0.140	U	0.150	U	0.140	U	0.180	U	0.210	U	0.170	U	0.180	U			0.140	U
		9-Jan-14	0.140		0.190		0.140		0.160		0.190		0.190		0.160		0.520				0.190	
		24-Apr-14	0.068	U	0.068	U	0.068	U	0.068	U	0.140	U	0.068	U	0.068	U	0.140	U			0.068	U
		1-Aug-14	0.590		0.510		0.240		0.970		3											

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level			Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	1.240		1.140			1.120		1.150		1.240		0.990		0.910		1.030						1.480	
		27-Mar-08	6.470		4.040			4.520		4.150		5.920		5.570		4.210		4.040						1.560	
		25-Apr-08	4.800		4.000			2.810		3.900		3.790		4.070		4.010		3.660						0.465	
		29-May-08	0.930		0.790			1.650		1.330		0.870		1.060		1.020		0.670						0.320	
		27-Jun-08	3.870		3.060			3.200		3.850		4.110		3.840		4.520		3.020						2.410	
		31-Jul-08	2.760		2.020			2.690		1.990		2.720		2.200		1.680		1.440						1.850	
		28-Aug-08	5.230		5.960			7.800		7.530		5.920		5.640		5.680		5.240						6.050	
		30-Sep-08	1.900	U	1.900	U		2.500		1.900	U	5.000		1.900	U	1.900	U	2.300						1.900	U
		27-Oct-08	6.700		6.300			3.500		6.100		2.300		5.500		3.800		6.600						8.400	
		25-Nov-08	5.500		1.900	U		1.900	U	2.000		1.900	U	1.900	U	1.900	U	1.900	U					1.900	U
		18-Dec-08	1.900	U	1.900	U		1.900	U	1.900	U	1.900	U	1.900	U	1.900	U	1.900	U					1.900	U
		21-Jan-09	1.900	U	1.900	U		1.900	U	1.900	U	1.900	U	1.900	U	1.900	U	1.900	U					1.900	U
		25-Feb-09	1.900	U	1.900	U		1.900	U	NS		1.900	U	1.900	U	1.900	U	1.900	U					1.900	U
		26-Mar-09	6.110		4.060			3.990		3.540		3.900		4.730		5.870		6.080						5.310	
		29-Apr-09	0.779		0.595			0.079	U	0.704		1.050		0.595		0.614		0.610						0.953	
		22-Jul-09	1.550		1.010			2.540		1.130		3.150		3.410		3.880		7.670						6.850	
		9-Oct-09	4.740		3.690			4.190		3.900		4.500		4.170		4.220		4.090						4.580	
		15-Jan-10	1.920		1.580			1.520		1.690		1.690		1.540		1.620		1.630						2.860	
		21-Apr-10	4.770		8.610			5.220		7.430		4.490		4.140		4.030		3.900						0.414	
		16-Jul-10	2.070		1.210			1.180		1.360		2.250		1.570		3.760		1.330						0.787	
		15-Oct-10	7.230		0.618			0.565		0.715		0.501		0.358		0.565		0.312						0.625	
		30-Nov-10	NS		1.280			1.200		NS		NS		NS		0.825		NS						NS	
		26-Jan-11	5.860		5.970			5.640		6.490		5.840		6.050		5.830		7.230		5.650		4.000		7.210	
		26-Jan-11**	NS		7.700			8.400		NS		NS		NS		8.300		NS						NS	
		27-Apr-11	0.764		0.855			1.070		1.070		1.030		0.840		0.783		0.625						0.648	
		26-Jul-11	2.040		3.920			1.590		1.210		1.620		1.060		1.400		0.934						0.652	
		28-Oct-11	6.700		2.800			2.900		1.800		2.500		3.600		5.200		3.100						1.400	
		23-Jan-12	3.200		2.500			0.130		2.700		2.800		3.000		2.700		3.000						3.600	
		13-Apr-12	1.800		1.500			1.300		1.400		1.400		1.500		1.400		1.200						0.320	
Toluene	210.0	2-Jul-12 resample	NS	NS	NS	NS		NS		NS		NS		NS		NS		0.550						0.550	
		20-Jun-12	2.200		2.500			1.800		2.300		2.300		2.000		2.200		2.400						2.600	
		1-Nov-12	4.300		2.500			1.800		3.000		2.400		4.000		4.600		3.500						0.750	
		1-Feb-13	0.810		0.460			0.430		0.520		0.650		0.780		0.950		0.510						0.460	
		29-Apr-13	3.900		3.100			3.100		3.100		2.700		2.200		5.000		2.600						0.690	
		9-Jul-13	2.300		2.100			1.900		2.300		2.300		2.200		2.500		2.200						2.500	
		18-Oct-13	0.970		0.510			0.470		0.800		1.200		0.670		2.300		1.200						0.660	
		9-Jan-14	12.000		15.000			0.840		0.990		0.830		0.870		1.200		1.100						0.810	
		24-Apr-14	0.770		0.340			0.360		0.330		0.280		0.320		0.590		0.770						0.280	

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																						
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
1,1,2-Trichloroethane	2.2	8-Feb-08	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		27-Mar-08	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.112	U	0.109	U	0.109	U	0.109	U	
		25-Apr-08	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		29-May-08	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		27-Jun-08	0.109	U	0.109	U	0.109	U	0.110	U	0.110	U	0.110	U	0.302	U	0.109	U	0.110	U	0.110	U	
		31-Jul-08	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		28-Aug-08	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		30-Sep-08	0.110	U	0.110	U	0.300	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		27-Oct-08	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		25-Nov-08	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		18-Dec-08	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		21-Jan-09	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		25-Feb-09	0.110	U	0.110	U	0.110	U	NS	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		26-Mar-09	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		29-Apr-09	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		22-Jul-09	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		9-Oct-09	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		15-Jan-10	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		21-Apr-10	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		16-Jul-10	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		15-Oct-10	0.109	U	1.090	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		30-Nov-10	NS	0.109	U	0.109	U	NS	U	NS	U	NS	U	0.109	U	NS	U	NS	U	NS	U	NS	U
		26-Jan-11	0.186	U	0.185	U	0.186	U	0.186	U	0.185	U	0.185	U	0.186	U	0.185	U	0.186	U	0.185	U	
		26-Jan-11**	NS	0.270	U	0.270	U	NS	U	NS	U	0.270	U	NS	U	NS	U	NS	U	NS	U	NS	U
		27-Apr-11	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		26-Jul-11	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	0.109	U	
		28-Oct-11	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	
		23-Jan-12	0.190	U	0.190	U	0.190	U	0.190	U	0.190	U	0.190	U	0.190	U	0.190	U	0.190	U	0.190	U	
		13-Apr-12	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	0.082	U	
		2-Jul-12 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	
		20-Jun-12	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	
		1-Nov-12	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	
		1-Feb-13	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	0.055	U	
		29-Apr-13	0.055	U	0.055</td																		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level																						
		Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual		
		8-Feb-08	0.110		0.120		0.110	U	0.107	U	0.110	U	0.110	U	0.350		0.110	U			0.110	U	
		27-Mar-08	0.239		0.233		0.218		0.226		0.325		0.308		0.217		0.170				0.107	U	
		25-Apr-08	0.107	U	0.164		0.147		0.272		0.151		0.152		0.158		0.229				0.107	U	
		29-May-08	0.110	U	0.110	U	0.110	U	0.107	U	0.110	U	0.110	U	0.110		0.110	U			0.110	U	
		27-Jun-08	0.110	U	0.110	U	0.110	U	0.107	U	0.110	U	0.107	U	0.143		0.195				0.107	U	
		31-Jul-08	0.113		0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U			0.107	U	
		28-Aug-08	0.193		0.116		0.107	U	0.107	U	0.146		0.134		0.110		0.107	U			0.838		
		30-Sep-08	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U			0.800	U	
		27-Oct-08	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U	0.800	U			0.800	U	
		25-Nov-08	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U			0.540	U	
		18-Dec-08	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U			0.540	U	
		21-Jan-09	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U	0.540	U			0.540	U	
		25-Feb-09	0.110	U	0.110	U	0.110	U	NS		0.110	U	0.110	U	0.110	U	0.110	U			0.130		
		26-Mar-09	4.000		0.326		1.510		0.438		0.639		1.180		1.610		0.450				6.870		
		29-Apr-09	0.107	U	0.107	U	1.340		0.107	U	0.107	U	0.107	U	0.107	U	0.107	U			0.107	U	
		22-Jul-09	0.177		0.107		0.188		0.123		0.193		0.709		0.140		0.177				0.209		
		9-Oct-09	0.231		0.215		0.182		0.193		0.242		0.156		0.156		0.156				0.107	U	
		15-Jan-10	0.107		0.107		0.113		0.107	U	0.107	U	0.107	U	0.107	U	0.107	U			0.107	U	
		21-Apr-10	0.247		0.580		0.279		0.505		0.376		0.360		0.419		0.456				0.107	U	
		16-Jul-10	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U			0.107	U	
		15-Oct-10	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U			0.107	U	
		30-Nov-10	NS		0.107		0.107		NS		NS		NS		0.109	U	NS				NS		
		26-Jan-11	0.568		0.502		0.531		0.604		0.504		0.584		0.429		0.550		0.484		0.467		0.767
		26-Jan-11**	NS		0.570		0.600		NS		NS		NS		0.600		NS				NS		
		27-Apr-11	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U	0.107	U			0.107	U	
		26-Jul-11	0.107		0.107		0.118		0.107		0.107		0.107		0.107		0.107				0.107		
		28-Oct-11	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U	0.081	U			0.054	U	
		23-Jan-12	0.190	U	0.190	U	0.190	U	0.290		0.190	U	0.190	U	0.190	U	0.190	U			0.190	U	
		13-Apr-12	0.081	U	0.081	U	0.081	U	0.081	U	0.090		0.081		0.081	U	0.081	U			0.110		
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS				0.081	U	
		20-Jun-12	0.110	U	0.110	U	0.110	U	0.110	U	0.120		0.110		0.110	U	0.110	U			0.110	U	
		1-Nov-12	0.054	U	0.054	U	0.067		0.054		0.054		0.054		0.054		0.054				0.054		
		1-Feb-13	0.054	U	0.054	U	0.054	U	0.054	U	0.054	U	0.054	U	0.054	U	0.054	U			0.054	U	
		29-Apr-13	0.120		0.110		0.110		0.110		0.130		0.120		0.110		0.110				0.054	U	
		9-Jul-13	0.160		0.140		0.140		0.150		0.120		0.400		0.280		0.310				0.080		
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.119		NS		NS		NS				0.088		
		18-Oct-13	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.390				0.110	U	
		9-Jan-14	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U	0.110	U			0.110	U	
		24-Apr-14	0.054	U	0.054	U																	

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)		
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual		
		8-Feb-08	1.140		1.020		1.110		1.010		0.990		1.050		1.040		1.020					1.080		
		27-Mar-08	1.740		1.520		1.540		1.250		2.320		2.120		2.140		1.210					1.380		
		25-Apr-08	1.740		1.660		1.240		1.640		1.480		1.520		1.660		1.500					1.030		
		29-May-08	1.020		0.930		0.870		1.060		0.930		0.930		0.990		0.910					0.880		
		27-Jun-08	1.240		1.220		1.290		1.300		1.160		1.150		1.170		1.160					1.180		
		31-Jul-08	1.080		1.100		1.010		1.010		1.010		1.010		1.000		0.973					0.926		
		28-Aug-08	2.740		3.360		3.470		3.260		3.660		3.420		3.380		3.860					2.310		
		30-Sep-08	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U			2.800	U		
		27-Oct-08	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U			2.800	U		
		25-Nov-08	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U			2.800	U		
		18-Dec-08	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U			2.800	U		
		21-Jan-09	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U	2.800	U			2.800	U		
		25-Feb-09	2.800	U	2.800	U	2.800	U	NS		2.800	U	2.800	U	2.800	U	2.800	U			2.800	U		
		26-Mar-09	1.220		1.160		1.180		1.140		1.230		1.190		1.120		1.130					1.160		
		29-Apr-09	1.490		1.170		0.051		U		1.270		1.180		1.190		1.270		1.290				1.190	
		22-Jul-09	1.950		1.920		1.62		1.900		1.630		2.050		1.540		1.900					2.120		
		9-Oct-09	1.520		1.830		1.510		0.019		1.620		1.310		1.410		1.430					1.180		
		15-Jan-10	11.900		1.260		1.210		1.290		1.210		1.290		1.220		1.270					1.240		
		21-Apr-10	4.170		3.780		2.540		3.200		3.500		3.400		2.500		3.190					1.260		
		16-Jul-10	1.470		1.470		1.480		1.470		2.160		1.470		1.470		1.470					1.560		
		15-Oct-10	1.410		1.360		1.380		1.350		1.360		1.300		1.320		1.340					1.490		
		30-Nov-10	NS		1.520		1.490		NS		NS		NS		1.340		NS					NS		
		26-Jan-11	1.780		1.960		1.720		1.740		1.620		1.960		1.630		1.950		1.490		1.930		1.780	
		26-Jan-11**	NS		2.300		2.100		NS		NS		NS		2.100		NS					NS		
		27-Apr-11	1.200		1.250		1.110		1.240		1.080		1.140		1.280		1.120					1.250		
		26-Jul-11	1.210		1.210		1.300		1.250		1.220		1.290		1.180		1.170					1.210		
		28-Oct-11	2.500		1.400		1.600		1.600		1.900		1.900		1.900		1.800					1.500		
		23-Jan-12	1.500		1.500		1.500		1.500		1.500		1.400		1.500		1.500					1.400		
		13-Apr-12	2.200		2.000		1.700		2.000		2.300		2.400		2.300		2.400					1.200		
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		NS					1.800		
		20-Jun-12	1.200		1.400		1.300		1.200		1.500		1.100		1.400		1.400					1.100		
		1-Nov-12	1.200		1.200		1.300		1.200		1.200		1.200		1.300		1.200					1.300		
		1-Feb-13	1.600		1.600		1.700		1.600		1.600		1.700		1.600		1.600					1.600		
		29-Apr-13	1.400		1.600		1.600		1.400		1.400		1.300		1.400		1.300					1.400		
		9-Jul-13	1.200		1.200		1.200		1.300		1.300		1.200		1.200		1.200					1.500		
		18-Oct-13	1.100		2.100		1.300		1.800		1.300		1.200		1.900		1.200					1.100		
		9-Jan-14	1.500		2.200		1.800		1.700		1.600		1.600		1.700		1.900					2.000		
		24-Apr-14	1.500		1.700		1.700		1.600		1.800		1.700		1.700		1.700					1.500		
		1-Aug-14	1.900		1.700		0.110		U		1.600		1.900		1.700		1.800					1.500		
		12-Sept-14 resample	NS		NS		NS		NS		NS		NS		1.300		NS					NS		
		22-Oct-14	1.500		1.300		1.500		1.500		1.500		1.500		1.500		1.500					1.300		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.900		0.970		2.520		1.890		0.210		0.210		0.210		0.310		0.210		0.210		
		27-Mar-08	1.330		1.590		3.390		3.240		0.920		1.390		0.828		0.989		0.098		0.098	U	
		25-Apr-08	0.998		1.760		11.700		1.640		0.909		0.839		0.911		0.750		0.098		0.098	U	
		29-May-08	0.300		0.470		8.320		6.680		0.270		0.960		0.690		0.110		0.100		0.175	U	
		27-Jun-08	1.560		0.443		2.120		3.040		0.634		0.246		0.722		0.206		0.142		0.157	U	
		31-Jul-08	1.650		1.360		1.380		2.080		0.959		1.940		0.207		0.142		0.157		0.354	U	
		28-Aug-08	0.438		1.430		3.690		5.340		0.642		0.461		0.455		0.464		0.16		0.250	U	
		30-Sep-08	2.500	U	2.500	U	2.500	U	2.000	U	6.800		2.500	U	2.500	U	9.300		2.500		2.500	U	
		27-Oct-08	2.500	U	2.500	U	2.500	U	3.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500		2.500	U	
		25-Nov-08	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500		2.500	U	
		18-Dec-08	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500		2.500	U	
		21-Jan-09	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500		2.500	U	
		25-Feb-09	2.500	U	2.500	U	3.900		NS		2.500	U	2.500	U	2.500	U	2.500	U	2.500		2.500	U	
		26-Mar-09	0.942		0.859		1.500		1.300		0.526		0.563		0.737		0.564		0.739		0.739	U	
		29-Apr-09	1.520		0.368		1.340		1.200		0.192		0.098	U	0.108		0.098		0.142		0.142	U	
		22-Jul-09	1.010		0.216		1.140		0.339		0.594		0.791		0.889		0.673		0.894		0.894	U	
		9-Oct-09	1.240		1.080		1.250		1.460		0.712		0.796		0.702		0.717		0.069		0.069	U	
		15-Jan-09	0.609		0.550		0.452		0.521		0.206		0.196		0.216		0.196		0.196		0.196	U	
		21-Apr-10	0.393		0.845		4.590		0.643		0.570		0.545		0.427	U	0.476		0.098		0.098	U	
		16-Jul-10	0.354		0.216		0.388		0.344		0.250		0.138		0.511		0.187		0.108		0.108	U	
		15-Oct-10	0.319		0.408		0.329		0.211		0.098	U	0.098	U	0.319		0.098		0.098		0.098	U	
		30-Nov-10	NS		0.334		0.560		NS		NS		0.098	U	0.098		NS		NS		NS	U	
		26-Jan-11	1.010		1.120		1.100		1.200		0.780		0.917		0.868		1.030		1.000		0.994	U	
		26-Jan-11**	NS		1.900		2.100		NS		NS		2.000		NS		NS		NS		NS	U	
		27-Apr-11	0.138		0.280		2.080		0.255		0.147		0.113		0.172		0.113		0.128		0.128	U	
		26-Jul-11	0.575		2.160		1.120		0.285		0.236		0.157		0.290		0.177		0.123		0.123	U	
		28-Oct-11	0.340		0.220		0.300		0.290		0.230		0.260		0.310		0.330		0.098		0.098	U	
		23-Jan-12	0.660		0.580		0.580		0.710		0.380		1.000		0.520		0.650		0.470		0.470	U	
		13-Apr-12	0.400		0.410		0.760		0.480		0.340		0.340		0.290		0.360		0.240		0.240	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.150	U	0.150		0.150	U	
		20-Jun-12	0.560		1.200		0.910		0.680		0.600		0.470		0.560		0.610		0.310		0.310	U	
		1-Nov-12	0.720		0.480		0.310		0.300		0.460		0.650		0.750		0.600		0.120		0.120	U	
		1-Feb-13	0.330		0.180		0.170		0.160		0.150		0.120		0.220		0.160		0.098		0.098	U	
		29-Apr-13	0.990		0.540		0.540		0.510		0.700		0.320		0.580		0.440		0.130		0.130	U	
		9-Jul-13	0.480		0.410		0.280		0.340		0.440		0.230		0.300		0.240		0.190		0.190	U	
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.470		NS		NS		NS		0.230		0.230	U	
		18-Oct-13	2.600		0.098	U	0.120		2.400		3.200		0.140		3.600		3.200		2.300		2.300	U	
		9-Jan-14	4.500		8.900		0.220		0.180		0.180		0.180		0.290		0.240		0.120		0.120	U	
		24-Apr-14	0.120		0.098	U	0.210		0.098	U	0.098	U	0.098	U	0.098	U	0.130		0.098		0.098	U	
		1-Aug-14	0.320		0.270		0.630		1.300		1.500		0.220		1.100		1.200		1.200		1.200	U	

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level			Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.460		0.450			1.300		0.980		0.100	U	0.100	U	0.100	U	0.100	U			0.100	U		
		27-Mar-08	0.535		0.652			1.620		1.530		0.292		0.438		0.256		0.334				0.098	U		
		25-Apr-08	0.367		0.816			7.170		0.802		0.342		0.293		0.375		0.280				0.098	U		
		29-May-08	0.170		0.220			4.710		4.050		0.140		0.640		0.470		0.100	U			0.100	U		
		27-Jun-08	0.942		0.232			1.100		1.580		0.385		0.102		0.387		0.100	U			0.098	U		
		31-Jul-08	1.040		0.782			0.671		1.360		0.570		1.190		0.098	U	0.098	U			0.098	U		
		28-Aug-08	0.170		0.732			1.950		2.990		0.270		0.181		0.181		0.155				0.100			
		30-Sep-08	2.500	U	2.500	U		2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U			2.500	U		
		27-Oct-08	2.500	U	2.500	U		2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U			2.500	U		
		25-Nov-08	2.500	U	2.500	U		2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U			2.500	U		
		18-Dec-08	2.500	U	2.500	U		2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U			2.500	U		
		21-Jan-09	2.500	U	2.500	U		2.500	U	2.500	U	2.500	U	2.500	U	2.500	U	2.500	U			2.500	U		
		25-Feb-09	2.500	U	2.500	U		2.500	U	NS		2.500	U	2.500	U	2.500	U	2.500	U			2.500	U		
		26-Mar-09	0.330		0.315			0.678		0.540		0.194		0.185		0.246		0.198				0.238			
		29-Apr-09	0.098	U	0.192			0.678		0.629		0.098		0.098	U	0.098	U	0.098	U			0.098	U		
		22-Jul-09	0.378		0.098	U		0.427		0.138		0.246		0.270		0.295		0.241				0.241			
		9-Oct-09	0.550		0.452			0.476		0.599		0.255		0.265		0.221		0.241				0.226			
		15-Jan-10	0.265		0.260			0.192		0.206		0.098	U	0.098	U	0.098	U	0.098	U			0.098	U		
		21-Apr-10	0.118		0.368			2.100		2.600		0.206		0.187		0.162		0.177				0.098	U		
		16-Jul-10	0.113		0.098	U		0.138		0.118		0.098	U	0.098	U	0.147		0.098	U			0.098	U		
		15-Oct-10	0.128		0.172			0.123		0.098	U	0.098	U	0.098	U	0.098	U	0.098	U			0.098	U		
		30-Nov-10	NS		0.133			0.177		NS		NS		NS		0.098	U	NS				NS			
		26-Jan-11	0.293		0.326			0.360		0.410		0.260		0.267		0.292		0.302		0.334		0.168	U	0.342	
		26-Jan-11**	NS		0.590			0.700		NS		NS		NS		0.630		NS				NS			
		27-Apr-11	0.098	U	0.128			0.820		0.113		0.098	U	0.098	U	0.098	U	0.098	U			0.098	U		
		26-Jul-11	0.206		0.737			0.393		0.108		0.098	U	0.098	U	0.098	U	0.098	U			0.098	U		
		28-Oct-11	0.150	U	0.150	U		0.150	U	0.150	U	0.150	U	0.150	U	0.150	U	0.150	U			0.098	U		
		23-Jan-12	0.220		0.170	U		0.200		0.230		0.170	U	0.220		0.180		0.180				0.170	U		
		13-Apr-12	0.150	U	0.150	U		0.270		0.170		0.150	U	0.150	U	0.150	U	0.150	U			0.270			
		2-Jul-12 resample	NS		NS			NS		NS		NS		NS		NS		NS				0.150	U		
		20-Jun-12	0.180		0.450			0.340		0.250		0.220		0.150		0.140		0.200				0.110			
		1-Nov-12	0.220		0.140			0.098	U	0.120		0.140		0.190		0.220		0.170				0.098	U		
		1-Feb-13	0.098	U	0.098	U		0.098	U	0.098	U	0.098	U	0.098	U	0.098	U	0.098	U			0.098	U		
		29-Apr-13	0.250		0.180			0.180		0.180		0.250		0.130		0.190		0.150				0.098	U		
		9-Jul-13	0.180		0.150			0.098	U	0.110		0.160		0.098	U	0.098	U	0.098	U			0.098	U		
		9-Jul-13 RIDEM	NS		NS			NS		NS		0.143		NS		NS		NS				0.037	J		
		18-Oct-13	0.170		0.098	U		0.098	U	0.180		0.290		0.098	U	0.420		0.280				0.180			
		9-Jan-14	1.100		2.100			0.098	U	0.098	U	0.098	U	0.098	U	0.098	U	0.098	U			0.098	U		
		24-Apr-14	0.098	U	0.098	U		0.098	U	0.098</															

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)		
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual		
p/m-Xylene	220.0	8-Feb-08	0.710		0.660		2.110		1.460		0.550		0.450		0.390		0.420					0.580		
		27-Mar-08	2.460		2.080		3.510		2.960		2.620		2.890		1.810		1.910					0.269		
		25-Apr-08	2.220		1.870		8.240		2.170		1.960		2.080		2.150		1.850					0.205		
		29-May-08	0.350		0.290		5.110		2.260		0.290		0.410		0.340		0.250					0.170	U	
		27-Jun-08	1.060		1.080		3.280		3.000		1.250		0.994		2.160		0.926					0.795		
		31-Jul-08	1.360		1.160		3.330		1.140		1.140		1.370		0.656		0.488					0.656		
		28-Aug-08	2.130		3.220		8.690		8.200		1.910		2.190		2.280		1.960					2.240		
		30-Sep-08	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	22.000					4.300	U	
		27-Oct-08	4.300	U	4.300	U	4.300	U	5.000		4.300	U	4.300	U	4.300	U	4.300	U				4.700		
		25-Nov-08	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U				4.300	U	
		18-Dec-08	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U				4.300	U	
		21-Jan-09	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U	4.300	U				4.300	U	
		25-Feb-09	4.300	U	4.300	U	15.000		NS		4.300	U	4.300	U	4.300	U	4.300	U				4.300	U	
		26-Mar-09	3.080		2.850		4.530		4.340		1.580		1.990		2.340		1.870					2.310		
		29-Apr-09	0.456		0.733		0.534		1.950		0.477		0.308		0.312		0.347					0.442		
		22-Jul-09	0.920		0.577		2.680		0.824		1.560		2.070		2.510		1.720					3.510		
		9-Oct-09	2.610		2.240		3.360		3.190		2.200		2.090		1.960		1.910					2.290		
		15-Jan-10	1.080		0.915		1.040		0.946		0.724		0.603		0.672		0.607					0.672		
		21-Apr-10	1.200		2.000		4.380		1.610		1.800		1.670		1.430		1.350					0.174	U	
		16-Jul-10	0.868		0.568		1.290		1.120		1.290		0.729		1.890		0.694					0.330		
		15-Oct-10	0.642		0.972		1.340		0.408		0.299		0.174		0.468		0.174					0.317		
		30-Nov-10	NS		0.620		1.000		NS		NS		NS		0.230		NS					NS		
		26-Jan-11	2.810		2.600		2.910		3.320		2.590		2.790		2.540		3.450		2.700		1.010		3.480	
		26-Jan-11**	NS		4.300		5.100		NS		NS		NS		4.900		NS					NS		
		27-Apr-11	0.295		0.412		2.030		0.642		3.020		0.260		0.412		0.191					0.256		
		26-Jul-11	1.240		3.650		2.630		3.670		0.799		0.816		0.864		0.486					0.404		
		28-Oct-11	2.400		1.100		1.400		0.750		1.300		1.700		1.900		1.500					0.480		
		23-Jan-12	1.600		1.300		1.300		1.500		1.300		1.400		1.400		1.500					1.500		
		13-Apr-12	0.810		0.690		0.810		0.660		0.670		0.740		0.640		0.520					0.350	U	
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.260		U			0.260	U	
		20-Jun-12	1.200		1.300		1.200		1.400		1.300		1.200		1.400		1.400					0.770		
		1-Nov-12	2.300		1.300		0.960		1.400		1.300		2.100		2.500		1.800					0.340		
		1-Feb-13	0.270		0.210		0.220		0.230		0.220		0.210		0.510		0.210					0.400		
		29-Apr-13	1.700		1.300		1.300		1.300		1.200		0.920		2.400		1.200					0.320		
		9-Jul-13	0.910		0.850		0.810		0.890		0.830		0.770		0.860		0.820					0.650		
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.929		NS		NS		NS					0.669		
		18-Oct-13	2.200		0.270		0.300		1.600		2.300		0.310		4.200		2.700					1.300		
		9-Jan-14	10.000		15.000		0.380		0.400		0.420		0.360		0.820		0.430					0.330		
		24-Apr-14	0.220		0.170		0.250		0.170		0.170		0.170		0.260									

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Kitchen Storage Room		Cafeteria		Gymnasium		Elevator Hallway		Room 118		Room 110		Media Center (Rm 145)		Room 152		Room 149		Room 234		Ambient Outdoor (AOA-1)	
		Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
		8-Feb-08	0.280		0.270		0.870		0.610		0.210		0.170		0.150		0.160		0.200		0.200		
		27-Mar-08	0.762		0.718		1.340		1.120		0.920		1.060		0.640		0.668		0.087		0.087	U	
		25-Apr-08	0.824		0.724		3.480		0.821		0.750		0.770		0.786		0.680		0.087		0.087	U	
		29-May-08	0.130		0.120		2.080		1.000		0.110		0.180		0.150		0.090		0.090		0.090	U	
		27-Jun-08	0.463		0.393		1.030		1.030		0.485		0.358		0.833		0.339		0.332		0.246		
		31-Jul-08	0.476		0.375		0.822		0.371		0.420		0.583		0.240		0.207		0.246		0.832		
		28-Aug-08	0.779		1.020		2.210		2.160		0.683		0.787		0.812		0.702		0.200		0.200		
		30-Sep-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		27-Oct-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		25-Nov-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		18-Dec-08	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		21-Jan-09	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		25-Feb-09	2.200	U	2.200	U	2.600		NS		2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	2.200	U	
		26-Mar-09	1.080		0.798		1.090		1.020		0.551		0.718		0.824		0.651		0.826				
		29-Apr-09	0.143		0.186		0.085	U	0.442		0.165		0.100		0.104		0.108		0.156				
		22-Jul-09	0.347		0.195		0.690		0.247		0.555		0.742		0.911		0.590		1.240				
		9-Oct-09	0.850		0.724		0.954		0.920		0.764		0.764		0.720		0.698		0.759				
		15-Jan-10	0.404		0.321		0.356		0.338		0.273		0.230		0.256		0.230		0.273				
		21-Apr-10	0.425		0.686		1.260		0.577		0.629		0.603		0.564		0.482		0.087		0.126	U	
		16-Jul-10	0.273		0.186		0.312		0.304		,503		0.200		0.703		0.230						
		15-Oct-10	0.186		0.265		0.347	U	0.130		0.139		0.087	U	2.000		0.087	U	0.104				
		30-Nov-10	NS		0.226		0.325		NS		NS		NS		0.091		NS		NS				
		26-Jan-11	1.000		0.981		1.020		1.150		0.948		1.030		0.922		1.270		1.000		0.392	1.280	
		26-Jan-11**	NS		1.600		1.900		NS		NS		NS		1.900		NS		NS				
		27-Apr-11	0.133		0.134		0.616		0.208		0.824		0.091		0.152		0.080	U	0.095				
		26-Jul-11	0.439		1.520		0.643		2.210		0.295		0.395		0.308		0.165		0.139				
		28-Oct-11	0.810		0.360		0.440		0.260		0.450		0.550		0.660		0.470		0.180				
		23-Jan-12	0.630		0.520		0.530		0.620		0.530		0.580		0.580		0.600		0.590				
		13-Apr-12	0.320		0.270		0.320		0.270		0.280		0.300		0.270		0.220		0.200				
		2-Jul-12 resample	NS		NS		NS		NS		NS		NS		NS		0.130	U	0.130		0.130	U	
		20-Jun-12	0.470		0.056		0.430		0.580		0.490		0.460		0.530		0.510		0.280				
		1-Nov-12	0.860		0.480		0.350		0.510		0.480		0.780		0.930		0.710		0.140				
		1-Feb-13	0.110		0.089		0.087	U	0.087		0.092		0.090		0.220		0.087	U	0.140				
		29-Apr-13	0.590		0.460		0.460		0.450		0.450		0.330		0.910		0.430		0.120				
		9-Jul-13	0.350		0.320		0.300		0.350		0.340		0.300		0.330		0.310		0.290				
		9-Jul-13 RIDEM	NS		NS		NS		NS		0.405		NS		NS		NS		0.330				
		18-Oct-13	0.660		0.100		0.100		0.500		0.770		0.110		1.300		0.850		0.460				
		9-Jan-14	4.000		6.100		0.160		0.160		0.160		0.160		0.330		0.190		0.140				
		24-Apr-14	0.087	U	0.087	U	0.094		0.087	U	0.087	U	0.087	U	0.099		0.120		0.087		0.087	U	
		1-Aug-14	0.200		0.160		0.310		0.700		0.690		0.230		0.940		0.770		0.560				
		12-Sep-14 resample	NS		NS		NS		NS		NS		NS		0.130		NS		NS				
		22-Oct-14	0.220		0.160																		

Summary of Indoor and Ambient Outdoor Air Sampling Data - Alvarez School - Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	CT Draft Proposed Indoor Residential Target Air Concentrations/Interim RIDEM-Approved Action Level	Sample Date	Kitchen Storage Room	Cafeteria	Gymnasium	Elevator Hallway	Room 118	Room 110	Media Center (Rm 145)	Room 152	Room 149	Room 234	Ambient Outdoor (AOA-1)			
			Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual			
^a = Site Specific Compound of Concern per ATSDR Health Consultation, December 4, 2006.																
^{**} - Analyzed by Con-Test Analytical Laboratory																
¹ Elevated Data is a result of inadvertent cross-contamination at the laboratory, and not resultant from soil vapor intrusion. Media Center/Room 145 was resampled on 28 January 2008 with Tetrachloroethylene concentration not detected by the laboratory (MDL = 0.14 ug/m ³).																
² : Elevated Tetrachloroethylene and Acetone data detected on 27 March 2008 was determined to be the result of cleaning products (e.g., graffiti remover, stainless steel polish, etc.) introduced to the school in February and March, and not the result of soil vapor intrusion.																
³ : All samples collected on 20 April 2016 except for the Kitchen Storage Room, which was collected on 25 April 2016 due to inaccessibility of the room during spring break.																
⁴ : All samples collected on 17 April 2017 except for the Kitchen Storage Room, which was collected on 25 April 2017 due to inaccessibility of the room during spring break.																
^a : Summa canister had low pressure upon beginning sample collection, possible interference. Re-sampling effort on 25 April 2008 indicates no exceedances of applicable Acetone and Tetrachloroethylene Action Levels.																
^b : Analyte found in associated blank as well as the sample but not expected to affect data due to sample concentration >10x concentration found in blank.																
^M : Laboratory fortified blank/laboratory control sample recovery is outside of control limits. Reported value for this compound is likely to be biased on the high side.																
^L : Laboratory fortified blank/laboratory control sample recovery is outside of control limits. Reported value for this compound is likely to be biased on the low side.																
^V : Continuing calibration did not meet method specifications and was biased on the low side for this compound. Increased uncertainty is associated with the reported value which is likely to be biased on the low side.																
^W : Continuing calibration did not meet method specifications and was biased on the high side for this compound. Increased uncertainty is associated with the reported value which is likely to be biased on the high side.																
^J : Estimated result as the result was between the MDL and the RDL.																
^I : Initial calibration verification did not meet standard. Reported value is likely to be biased on the high side.																
^K : Initial calibration did not meet standard and was biased on the low side. Reported result is estimated.																
^D : Elevated method detection limits due to failure of Con-test internal standards. Applies to Ambient Outdoor Air sample.																
NOTES:																
All data presented in micrograms per cubic meter (ug/m ³).																
Two values displayed with a slash indicates dilutions resulting in two different concentrations																
U = Designation indicates that the compound was not detected by the laboratory. Reporting limit shown in the data column.																
NS = Not sampled.																
None = No Draft Proposed CT Residential TAC for this compound.																
= exceedance of interim RIDEM-approved action level																

APPENDIX C

Sub-slab Vapor Analytical Summary

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	17.2	NS	NS	4.75	U	NS	NS	5.62	11.4	NS
	27-Mar-08	NS	28.7	NS	NS	NS	NS	NS	NS	217	12.4
	25-Apr-08	NS	NS	188	NS	NS	513	NS	34	NS	33.9
	29-May-08	NS	NS	NS	40.9	NS	NS	92	9.82	16.4	NS
	27-Jun-08	107	NS	NS	145	NS	NS	NS	NS	20.4	9.73
	31-Jul-08	NS	101	NS	NS	NS	NS	NS	14.4	NS	18.1
	28-Aug-08	NS	NS	1130	NS	NS	30.9	NS	46	47.8	NS
	30-Sep-08	NS	NS	NS	32.8	NS	NS	44.1	NS	9.4	12.8
	27-Oct-08	19.6	NS	NS	15	NS	NS	NS	17.9	NS	33.3
	25-Nov-08	NS	148	NS	NS	183	NS	NS	13	24.7	NS
	18-Dec-08	NS	NS	856	NS	NS	10.4	NS	NS	37.2	22
	21-Jan-09	NS	NS	NS	19.1	NS	NS	6.1	2.4	U	NS
	25-Feb-09	28.6	NS	NS	60.9	NS	NS	NS	9.5	8.3	NS
	26-Mar-09	NS	102	NS	NS	47.5	U	NS	NS	50.6	64.8
	29-Apr-09	NS	NS	1980	NS	NS	23.3	NS	5.15	NS	22.1
	22-Jul-09	58.5	NS	58.5	148	NS	87.8	NS	96	88.1	NS
	9-Oct-09	NS	25.7	NS	49.7	NS	9.2	11100	6.51	NS	16.8
	15-Jan-10	33.6	NS	90.9	22.8	NS	26.3	NS	12.5	11.2	NS
	21-Apr-10	NS	21.9	NS	206	NS	263	2870	72.8	NS	73.4
	16-Jul-10	654	NS	4800	202	NS	11400	NS	8.34	21.1	NS
	15-Oct-10	NS	11.3	NS	26	NS	10.2	18.3	7.03	NS	21.2
	26-Jan-11	114	26.8	NS	54.4	NS	34.4	NS	35.4	25.3	NS
	28-Feb-11	NS	NS	80.8	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	106	NS	255	NS	220	227	17.8	NS	58.2
	26-Jul-11	76.2	NS	120	154	NS	2730	NS	12.8	23.8	NS
	28-Oct-11	NS	48	U	NS	48	U	48	U	51	48
	23-Jan-12	37	NS	36	19	NS	28	NS	38	29	NS
	13-Apr-12	NS	32	NS	70	NS	32	83	54	NS	43
Acetone	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	48	U
	23-Jun-12	21	NS	30	370	NS	1600	NS	43	21	NS
	1-Nov-12	NS	41	NS	NS	52	NS	75	44	35	NS
	1-Feb-13	17	NS	12	25	NS	36	NS	16	12	NS
	29-Apr-13	NS	45	NS	100	NS	68	62	33	NS	43
	9-Jul-13	100	NS	170	130	NS	260	NS	80	15	NS
	18-Oct-13	NS	43	NS	61	NS	47	57	48	NS	42
	9-Jan-14	250	NS	16	25	NS	11	NS	24	33	NS
	24-Apr-14	NS	18	NS	13	NS	41	15	42	24	30
	1-Aug-14	31 ^M	NS	110/99 ^{ME}	110/100 ^{ME}	NS	NS	NS	31 ^M	57/50 ^{ME}	NS
	27-Aug-14	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	NS	15	NS	NS	NS
	22-Oct-14	NS	31	NS	14	5.3	17	3.8	40	19	NS
	20-Jan-15	14	NS	23	23	NS	16	NS	39	72	NS
30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	45	NS
	22-Apr-15	NS	87 ^V	NS	1.9 ^V	U	43	55 ^{L,V/68}	42	NS	49
	21-Jul-15	12	NS	22	20	NS	9.2	NS	42 ^O	11 ^O	NS
23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	5.0	NS	NS	NS
	29-Oct-15	NS	4.5	NS	20	NS	11	9.2	11	NS	22
4-Dec-15 resample	NS	1.9	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	8.4	NS	9.2	7.2	NS	8.6	NS	49	22	NS
	20-Apr-16	NS	7.3	NS	8.4	NS	11	11	35	NS	21
	20-Jul-16	37	NS	56	44	NS	35	NS	70	51	NS
	21-Oct-16	NS	17	NS	25	NS	22	12	29	NS	52
	31-Jan-17	7.4 ^V	NS ^{L,V}	8.9 ^{L,V}	5.9 ^{L,V}	NS	6.7 ^{L,V}	NS	21 ^{L,V}	20 ^{L,V}	NS
	17-Apr-17	NS	7	NS	17	NS	13	7.5	33	NS	49
	26-Jul-17	19	NS	15	17	NS	11	NS	18	16	NS
	12-Oct-17	NS	32	NS	20	NS	52	29	22	NS	33
	10-Jan-18	39	NS	17	8.1	NS	14	NS	26	NS	28
	11-Apr-18	NS	34	NS	26	NS	36	63	38	NS	40
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	19	NS
	27-Jul-18	73	NS	110	130	NS	77	NS	83	63	NS
	24-Oct-18	NS	13	NS	13	NS	16	21	30	NS	35
	16-Jan-19	33	NS	6.9	6.1	NS	6.8	NS	14	21	NS
	12-Apr-19	NS	8.8	NS	17	NS	9.2	7.7	25	NS	51
	29-Jul-19	130 ^E	NS	92 ^E	130 ^E	NS	110 ^E	NS	72 ^E	65 ^E	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	68	NS
	29-Oct-19	NS	9.8	NS	12	NS	6	12	35 ^D	24 ^D	29 ^D
	21-Jan-20	9.20	NS	5.10	8.40	NS	3.10	NS	9.50	11.00	NS
	22-Apr-20	NS	15	NS	25	NS	38	40	60 ^E	NS	40
	23-Jul-20	150 ^E	NS	260 ^E	130 ^E	NS	210 ^E	NS	120 ^E	92	NS
	29-Oct-20	NS	5.1	NS	11	NS	6.6	7.4	25	NS	25
	19-Jan-21	7.4	NS	8.6	5.7	NS	5.4	NS	26	10 ^E	NS
	15-Apr-21	NS	14	NS	11	NS	4.4	13	20	NS	15
	21-Jul-21	48	NS	50	61	NS	71	NS	66	25	NS
	20-Oct-21	NS	16	NS	36	NS	60 ^E	33	26	NS	29
	9-Feb-22	6.7	NS	6.2	45	NS	13	NS	16	24	NS
	7-Apr-22	NS	7.4	NS	4	NS	5	8.6	10	NS	19
	28-Jul-22	8.5	NS	19	23	NS	37	NS	37	17	NS
	18-Oct-22	NS	16	NS	15	NS</td					

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	1.08	U	NS	NS	NS	1.08	U	NS	NS	1.08	U
	27-Mar-08	NS		1.08	U	NS	NS	U	NS	NS	1.08	U
	25-Apr-08	NS		NS	U	1.08	U	NS	NS	1.08	U	1.08
	29-May-08	NS		NS	U	1.08	U	NS	NS	1.08	U	NS
	27-Jun-08	1.69	U	NS	NS	NS	1.08	U	NS	NS	1.08	U
	31-Jul-08	NS		1.08	U	NS	NS	U	NS	NS	1.08	U
	28-Aug-08	NS		NS	U	1.08	U	NS	NS	1.08	U	NS
	30-Sep-08	NS		NS	U	2.2	U	NS	NS	2.2	U	2.2
	27-Oct-08	2.2	U	NS	NS	NS	2.2	U	NS	2.2	U	2.2
	25-Nov-08	NS		2.2	U	NS	NS	U	NS	2.2	U	NS
	18-Dec-08	NS		NS	U	2.2	U	NS	NS	2.2	U	2.2
	21-Jan-09	NS		NS	U	2.2	U	NS	NS	2.2	U	2.2
	25-Feb-09	2.2	U	NS	NS	NS	2.2	U	NS	2.2	U	NS
	26-Mar-09	NS		5.42	U	NS	NS	U	10.8	NS	1.08	U
	29-Apr-09	NS		NS	U	1.08	U	NS	NS	1.08	U	1.08
	22-Jul-09	5.42	U	NS	U	10.8	U	NS	5.42	U	1.08	U
	9-Oct-09	NS		0.051	U	NS	1.08	U	NS	1.08	U	1.08
	15-Jan-10	1.08	U	NS	U	1.08	U	NS	1.08	U	1.08	U
	21-Apr-10	NS		1.08	U	NS	NS	U	5.42	U	1.08	U
	16-Jul-10	1.08	U	NS	U	1.08	U	NS	8.19	U	1.08	U
	15-Oct-10	NS		0.108	U	NS	NS	U	1.08	U	1.08	U
	26-Jan-11	10.8	U	1.08	U	NS	1.08	U	5.42	U	5.42	U
	28-Feb-11	NS		NS	U	10.8	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		1.08	U	NS	1.08	U	NS	1.08	U	1.08
	26-Jul-11	3.62	U	NS	U	3.62	U	1.08	U	5.42	U	5.42
	28-Oct-11	NS		6.2	U	NS	6.2	U	NS	6.2	U	6.2
	23-Jan-12	1.2	U	NS	U	1.2	U	NS	1.2	U	1.2	U
	13-Apr-12	NS		1.2	U	NS	1.2	U	NS	1.2	U	1.2
Acrylonitrile	2-Jul-12 (resample)	NS		NS	U	NS	NS	U	NS	NS	NS	NS
	23-Jun-12	1.2	U	NS	U	1.2	U	NS	1.2	U	1.2	U
	1-Nov-12	NS		0.25	U	NS	NS	U	0.25	U	0.25	U
	1-Feb-13	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	29-Apr-13	NS		0.62	U	NS	0.25	U	NS	0.25	U	0.25
	9-Jul-13	0.37	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	18-Oct-13	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	9-Jan-14	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	24-Apr-14	NS		0.25	U	NS	0.37	U	NS	0.25	U	0.37
	1-Aug-14	0.25	U	NS	U	0.37	U	NS	NS	0.25	U	NS
	27-Aug-14	NS		NS	U	NS	NS	U	0.25	U	NS	NS
	12-Sept-14 (resample)	NS		NS	U	NS	NS	U	0.37 ^L	U	NS	NS
	22-Oct-14	NS		0.37 ^L	U	NS	0.37 ^L	U	0.37 ^L	U	0.37 ^L	U
	20-Jan-15	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	30-Mar-15 (resample)	NS		NS	U	NS	NS	U	0.25 ^L	U	NS	NS
	22-Apr-15	NS		0.26 ^L	U	NS	NS	U	0.25 ^L	U	0.25 ^L	U
	21-Jul-15	0.1	U	NS	U	0.4	U	2	U	NS	0.1 ^v	U
23-Sept-15 resample	NS		NS	NS	U	NS	NS	U	NS	0.1 ^v	U	NS
	29-Oct-15	NS		0.1	U	NS	NS	U	0.2	U	0.1	U
	4-Dec-15 resample	NS		0.1	U	NS	NS	U	NS	NS	NS	NS
	27-Jan-16	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	20-Apr-16	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	20-Jul-16	1.3	U	NS	U	1.3 ^{MW}	U	1.3	U	NS	1.3	U
	21-Oct-16	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	31-Jan-17	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	17-Apr-17	NS		0.38	U	NS	NS	U	0.38	U	0.38	U
	26-Jul-17	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	12-Oct-17	NS		0.25	U	NS	0.25	U	0.76	U	0.71	U
	10-Jan-18	0.25	U	NS	U	0.25	U	NS	NS	0.25	U	0.25
	11-Apr-18	NS		0.25	U	NS	NS	U	2.5	U	2.5	U
	23-May-18	NS		NS	U	NS	NS	U	NS	NS	NS	NS
	27-Jul-18	1.3	U	NS	U	1.3	U	NS	1.3	U	1.3	U
	24-Oct-18	NS		1.2	U	NS	1.2	U	NS	1.2	U	1.2
	16-Jan-19	0.25	U	NS	U	0.25	U	NS	NS	0.25	U	NS
	12-Apr-19	NS		0.25	U	NS	0.25	U	0.31	U	0.38	U
	29-Jul-19	0.38	U	NS	U	0.38	U	NS	0.25	U	0.25	U
	26-Sep-19	NS		NS	U	NS	NS	U	NS	NS	NS	NS
	29-Oct-19	NS		0.25	U	NS	0.25	U	0.25	U	1.3 ^v	U
	21-Jan-20	0.25 ^w	U	NS	U	0.25 ^w	U	NS	0.25 ^w	U	0.25 ^w	U
	22-Apr-20	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	23-Jul-20	0.25	U	NS	U	0.25	U	NS	0.5	U	0.5	U
	29-Oct-20	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	19-Jan-21	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25 ^f	U
	15-Apr-21	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	21-Jul-21	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	20-Oct-21	NS		0.25								

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
Benzene	8-Feb-08	0.92	NS	NS	0.98	NS	NS	0.54	0.85	NS	0.635
	27-Mar-08	NS	0.54	NS	NS	0.462	NS	NS	0.788	NS	0.536
	25-Apr-08	NS	NS	0.584	NS	NS	0.745	NS	0.428	NS	0.399
	29-May-08	NS	NS	0.73	NS	NS	1.03	1.12	0.61	NS	0.265
	27-Jun-08	0.626	NS	NS	0.468	NS	NS	NS	0.499	NS	0.399
	31-Jul-08	NS	0.418	NS	NS	NS	NS	0.358	NS	NS	0.265
	28-Aug-08	NS	NS	1.02	NS	NS	0.537	NS	0.815	0.692	NS
	30-Sep-08	NS	U	NS	1.6	U	NS	1.6	U	1.6	U
	27-Oct-08	1.6	U	NS	1.6	U	NS	NS	1.6	1.6	U
	25-Nov-08	NS	1.6	U	NS	1.6	U	NS	1.6	1.6	U
	18-Dec-08	NS	NS	1.6	NS	NS	1.6	NS	1.6	1.6	U
	21-Jan-09	NS	NS	1.6	U	NS	1.6	U	1.6	1.6	U
	25-Feb-09	1.6	U	NS	NS	1.6	U	NS	1.6	1.6	U
	26-Mar-09	NS	2.1	NS	NS	2.23	U	NS	NS	0.945	1.48
	29-Apr-09	NS	NS	0.603	NS	NS	0.246	NS	0.223	NS	0.367
	22-Jul-09	1.12	U	NS	56	2.23	U	1.45	NS	4.27	0.629
	9-Oct-09	NS	1.15	NS	0.974	NS	0.431	46.6	0.619	NS	0.824
	15-Jan-10	0.763	NS	0.887	0.98	NS	1.26	NS	0.964	NS	NS
	21-Apr-10	NS	0.373	NS	0.16	U	NS	1.6	0.635	NS	1.26
	16-Jul-10	0.332	NS	1.53	0.689	NS	2.41	U	NS	0.319	U
	15-Oct-10	NS	0.319	U	NS	0.319	U	NS	0.319	NS	0.319
	26-Jan-11	3.19	U	2.49	NS	2.46	U	1.6	1.85	1.8	NS
	28-Feb-11	NS	NS	3.19	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.319	U	NS	0.319	U	NS	0.354	0.319	0.319
	26-Jul-11	1.06	U	NS	1.06	U	1.6	U	NS	0.319	U
	28-Oct-11	NS	1.6	U	NS	1.6	U	1.6	U	1.6	U
	23-Jan-12	0.84	NS	1.2	0.98	NS	0.81	NS	1.4	1.5	NS
	13-Apr-12	NS	0.32	U	NS	0.32	U	0.32	U	0.32	U
	2-Jul-12 (resample)	NS	NS	0.61	NS	NS	0.43	NS	NS	1.6	U
	23-Jun-12	0.45	NS	0.45	NS	0.43	NS	0.49	0.56	0.61	NS
	1-Nov-12	NS	0.45	NS	0.45	NS	0.35	NS	0.45	0.46	NS
	1-Feb-13	0.33	NS	0.45	0.47	NS	0.38	NS	0.47	0.63	0.67
	29-Apr-13	NS	0.41	NS	NS	0.38	NS	0.41	0.47	0.65	0.42
	9-Jul-13	0.64	NS	0.93	0.76	NS	0.70	NS	NS	0.65	NS
	18-Oct-13	NS	0.66	NS	NS	0.63	NS	0.86	1.0	0.28	0.92
	9-Jan-14	1.2	NS	1.1	0.97	NS	1.1	NS	1.5	1.5	NS
	24-Apr-14	NS	0.3	NS	0.22	NS	0.32	NS	0.39	0.34	0.35
	1-Aug-14	0.49	NS	0.790/0.76	0.68/0.69	NS	NS	NS	0.34	0.43	NS
	27-Aug-14	NS	NS	NS	NS	0.69	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	0.43	NS	NS	U
	22-Oct-14	NS	0.28	NS	0.21	0.19	0.34	0.14	0.36	0.32	NS
	20-Jan-15	0.42	NS	0.33	0.45	NS	0.31	NS	0.63	0.46	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	0.41	NS
	22-Apr-15	NS	0.48	NS	0.35	NS	0.46	0.57/0.60	0.84	NS	0.93
	21-Jul-15	0.35	NS	0.520'	3	U	NS	0.29	NS	0.29'	0.41'
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	0.28	NS	NS	NS
	29-Oct-15	NS	0.15'	NS	0.19	NS	0.26'	0.27	0.24	NS	0.23
	4-Dec-15 resample	NS	0.11'	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.32	NS	0.5	0.53	NS	0.43	NS	0.72	0.69	NS
	20-Apr-16	NS	0.21	NS	0.27	NS	0.27	0.32	0.73	NS	0.47
	20-Jul-16	0.32	U	NS	0.7	0.41	NS	0.68	NS	0.43	0.85
	21-Oct-16	NS	0.35	NS	0.84	NS	0.58	1.3	0.39	NS	0.064
	31-Jan-17	0.24	NS	0.43	0.37	NS	0.37	NS	0.66	0.49	NS
	17-Apr-17	NS	0.25	NS	0.26	NS	0.24	0.33	0.29	NS	0.39
	26-Jul-17	0.2	NS	0.41	0.36	NS	0.37	NS	0.4	0.5	NS
	12-Oct-17	NS	0.18	NS	0.17	NS	0.23	0.4	0.37	NS	0.32
	10-Jan-18	0.26	NS	0.46	0.46	NS	0.44	NS	0.73	NS	0.35
	11-Apr-18	NS	0.36	NS	0.64	U	0.64	0.64	0.99	NS	0.81
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	0.3	NS
	27-Jul-18	0.32	U	NS	0.6	0.39	NS	0.43	NS	0.37	0.38
	24-Oct-18	NS	0.32	U	NS	0.32	U	0.32	0.32	U	0.47
	16-Jan-19	0.55	NS	0.5	0.64	NS	0.48	NS	1	0.75	NS
	12-Apr-19	NS	0.44	NS	0.37	NS	0.18	0.71	0.67	NS	0.54
	29-Jul-19	0.6	NS	0.73	0.88	NS	1.3	NS	0.34	1.1	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	0.58	NS
	29-Oct-19	NS	0.29	NS	NS	0.28	NS	0.25	0.37	0.42"	0.54"
	21-Jan-20	0.20	NS	0.34	0.38	NS	0.35	NS	0.69	0.61	NS
	22-Apr-20	NS	0.12	NS	0.18	NS	0.064	U	0.14	0.21	0.21
	23-Jul-20	0.66	NS	0.66	0.49	NS	0.91	NS	0.43	0.13	U
	29-Oct-20	NS	0.48	NS	0.6	NS	0.35	0.77	0.73	NS	0.064
	19-Jan-21	0.31	NS	0.38	0.37	NS	0.36	NS	0.49	0.45'	NS
	15-Apr-21	NS	0.23	NS	0.29	NS	0.2	0.25	0.28	NS	0.064
	21-Jul-21	1	NS	1.6	0.73	NS	1.1	NS	1.1	2	NS
	20-Oct-21	NS	0.34	NS	0.47	NS	0.34	0.41	0.46	NS	0.46
	9-Feb-22	0.22	NS	0.32	0.4	NS	0.23	NS	0.94	1.2	NS
	7-Apr-22	NS	0.29								

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
Bromodichloromethane	8-Feb-08	0.13	U	NS	NS	0.13	U	NS	0.13	U	0.13	U
	27-Mar-08	NS		0.134	U	NS	0.134	U	NS	0.134	U	0.134
	25-Apr-08	NS		NS	U	NS	NS	U	NS	U	NS	U
	29-May-08	NS		NS	U	0.13	U	NS	0.13	U	0.13	U
	27-Jun-08	0.209	U	NS	NS	0.134	U	NS	NS	NS	0.134	U
	31-Jul-08	NS		0.134	U	NS	NS	U	NS	U	NS	U
	28-Aug-08	NS		NS	U	0.134	U	NS	0.134	U	0.134	U
	30-Sep-08	NS		NS	U	0.52	U	NS	0.13	U	0.23	U
	27-Oct-08	0.13	U	NS	NS	1.07	U	NS	0.13	U	0.13	U
	25-Nov-08	NS		0.13	U	NS	NS	U	NS	NS	3	NS
	18-Dec-08	NS		NS	U	0.13	U	NS	0.13	U	0.13	U
	21-Jan-09	NS		NS	U	0.13	U	NS	0.13	U	0.13	U
	25-Feb-09	0.13	U	NS	NS	0.13	U	NS	0.13	U	0.13	U
	26-Mar-09	NS		0.67	U	NS	NS	U	NS	NS	0.134	U
	29-Apr-09	NS		NS	U	0.134	U	NS	0.134	U	0.134	U
	22-Jul-09	0.67	U	NS	27.3	U	1.34	U	NS	0.134	U	0.134
	9-Oct-09	NS		0.134	U	NS	0.134	U	NS	28	U	0.134
	15-Jan-10	0.134	U	NS	0.134	U	0.134	U	NS	0.134	U	0.134
	21-Apr-10	NS		0.134	U	NS	0.67	U	NS	0.67	U	0.134
	16-Jul-10	0.134	U	NS	0.134	U	0.134	U	NS	0.134	U	0.134
	15-Oct-10	NS		0.134	U	NS	0.134	U	NS	0.134	U	0.134
	26-Jan-11	1.34	U	0.134	U	NS	0.134	U	NS	0.67	U	NS
	28-Feb-11	NS		NS	U	1.34	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.134	U	NS	0.134	U	NS	0.134	U	0.134
	26-Jul-11	0.447	U	NS	0.447	U	0.134	U	NS	0.67	U	0.67
	28-Oct-11	NS		3.4	U	NS	NS	U	3.4	U	3.4	U
	23-Jan-12	0.67	U	NS	0.67	U	0.67	U	NS	0.67	U	0.67
	13-Apr-12	NS		0.34	U	NS	0.34	U	NS	0.34	U	0.34
	2-Jul-12 (resample)	NS		NS	U	NS	NS	U	NS	NS	1.7	U
	23-Jun-12	0.67	U	NS	0.67	U	0.67	U	NS	0.67	U	0.67
	1-Nov-12	NS		0.067	U	NS	NS	U	0.067	U	0.067	U
	1-Feb-13	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.067
	29-Apr-13	NS		0.16	U	NS	0.067	U	NS	0.067	U	0.067
	9-Jul-13	0.1	U	NS	0.067	U	0.067	U	NS	0.067	U	0.23
	18-Oct-13	NS		0.13	U	NS	0.13	U	NS	0.13	U	0.13
	9-Jan-14	0.13	U	NS	0.13	U	0.13	U	NS	0.13	U	0.13
	24-Apr-14	NS		0.13	U	NS	0.20	U	NS	0.13	U	0.20
	1-Aug-14	0.13	U	NS	0.20	U	0.20	U	NS	0.13	U	NS
	27-Aug-14	NS		NS	U	NS	0.067	U	NS	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	U	NS	NS	U	NS	0.1	U	NS
	22-Oct-14	NS		0.10	U	NS	0.10	U	0.10	U	0.10	U
	20-Jan-15	0.067	U	NS	0.067	U	0.067	U	NS	0.1	U	0.067
	30-Mar-15 (resample)	NS		NS	U	NS	NS	U	NS	NS	NS	NS
	22-Apr-15	NS		0.069	U	NS	0.067	U	NS	0.067	U	0.077
	21-Jul-15	0.3	U	NS	7	U	0.4	U	NS	0.30 ^v	U	0.40 ^v
	23-Sept-15 resample	NS		NS	U	NS	NS	U	NS	0.3	U	NS
	29-Oct-15	NS		0.4	U	NS	0.4	U	0.6	U	0.3	U
	4-Dec-15 resample	NS		0.3	U	NS	NS	U	NS	NS	NS	NS
	27-Jan-16	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.42
	20-Apr-16	NS		0.067	U	NS	0.83	U	0.067	U	0.067	U
	20-Jul-16	0.34	U	NS	0.34	U	0.34	U	NS	0.43	U	0.34
	21-Oct-16	NS		0.067	U	NS	0.067	U	0.067	U	0.067	U
	31-Jan-17	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.067
	17-Apr-17	NS		0.10	U	NS	0.10	U	0.10	U	0.10	U
	26-Jul-17	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.067
	12-Oct-17	NS		0.067	U	NS	0.067	U	0.2	U	0.19	U
	10-Jan-18	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.067
	11-Apr-18	NS		0.13	U	NS	1.3	U	1.3	U	0.13	U
	23-May-18	NS		NS	U	NS	NS	U	NS	NS	0.1	U
	27-Jul-18	0.34	U	NS	0.34	U	0.34	U	NS	0.34	U	NS
	24-Oct-18	NS		0.34	U	NS	0.34	U	0.34	U	0.34	U
	16-Jan-19	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.067
	12-Apr-19	NS		0.067	U	NS	0.067	U	0.1	U	NS	0.1
	29-Jul-19	0.1	U	NS	0.1	U	0.067	U	NS	0.067	U	1.6
	26-Sep-19	NS		NS	U	NS	NS	U	NS	NS	0.1	U
	29-Oct-19	NS		0.067	U	NS	0.067	U	0.067	U	0.34 ^d	U
	21-Jan-20	0.07	U	NS	0.07	U	0.07	U	NS	0.07	U	0.07
	22-Apr-20	NS		0.067	U	NS	0.067	U	0.067	U	NS	0.067
	23-Jul-20	0.067	U	NS	0.067	U	0.067	U	0.13	U	0.13	U
	29-Oct-20	NS		0.067	U	NS	0.067	U	0.067	U	0.067	U
	19-Jan-21	0.067	U	NS	0.067	U	0.067	U	NS	0.067	U	0.067
	15-Apr-21	NS		0.067	U	NS	0.067	U	0.067	U	0.067	

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
Bromoform	8-Feb-08	0.21	U	NS	NS	NS	NS	NS	0.21	U	0.21	U
	27-Mar-08	NS		0.206	U	NS	NS	NS	0.206	U	0.206	U
	25-Apr-08	NS		NS	U	NS	NS	NS	0.206	U	0.206	U
	29-May-08	NS		NS	U	NS	NS	NS	0.21	U	0.21	U
	27-Jun-08	0.322	U	NS	NS	NS	NS	NS	0.206	U	0.206	U
	31-Jul-08	NS		0.206	U	NS	NS	NS	0.206	U	0.206	U
	28-Aug-08	NS		NS	U	NS	NS	NS	0.206	U	0.206	U
	30-Sep-08	NS		NS	U	0.41	U	NS	0.41	U	0.41	U
	27-Oct-08	0.41	U	NS	NS	NS	0.41	U	NS	0.41	U	0.41
	25-Nov-08	NS		0.14	U	NS	NS	0.41	U	NS	0.41	U
	18-Dec-08	NS		NS	U	0.41	U	NS	0.41	U	0.41	U
	21-Jan-09	NS		NS	NS	0.41	U	NS	0.41	U	0.41	U
	25-Feb-09	0.41	U	NS	NS	0.14	U	NS	NS	0.41	U	NS
	26-Mar-09	NS		1.03	U	NS	NS	2.06	U	NS	0.206	U
	29-Apr-09	NS		NS	U	0.206	U	NS	0.206	U	NS	0.206
	22-Jul-09	1.03	U	NS	42	U	2.06	U	NS	1.03	U	0.206
	9-Oct-09	NS		0.206	U	NS	0.206	U	NS	0.206	U	0.206
	15-Jan-10	0.206	U	NS	0.206	U	0.206	U	NS	0.206	U	NS
	21-Apr-10	NS		0.206	U	NS	NS	1.03	U	1.03	U	0.206
	16-Jul-10	0.206	U	NS	0.206	U	0.206	U	NS	0.206	U	NS
	15-Oct-10	NS		0.206	U	NS	NS	0.206	U	0.206	U	0.206
	26-Jan-11	2.06	U	0.206	U	NS	0.206	U	1.03	U	1.03	U
	28-Feb-11	NS		NS	2.06	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.206	U	NS	NS	0.206	U	0.206	U	0.206
	26-Jul-11	0.69	U	NS	0.69	U	0.207	U	1.03	U	0.207	U
	28-Oct-11	NS		5.2	U	NS	NS	5.2	U	5.2	U	5.2
	23-Jan-12	1	U	NS	1	U	1	U	NS	1	U	1
	13-Apr-12	NS		1	U	NS	NS	1	U	1	U	NS
	2-Jul-12 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
	23-Jun-12	1	U	NS	1	U	1	U	NS	1	U	1
	1-Nov-12	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	1-Feb-13	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	NS
	29-Apr-13	NS		0.52	U	NS	NS	0.21	U	0.21	U	0.21
	9-Jul-13	0.31	U	NS	0.21	U	0.21	U	NS	0.21	U	NS
	18-Oct-13	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	9-Jan-14	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	NS
	24-Apr-14	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.31
	1-Aug-14	0.21	U	NS	0.31	U	NS	NS	NS	0.21	U	NS
	27-Aug-14	NS		NS	NS	NS	NS	0.21	U	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	0.13	U	NS	NS
	22-Oct-14	NS		0.31	U	NS	NS	0.31	U	0.31	U	0.41
	20-Jan-15	0.21	U	NS	0.21	U	0.21	U	NS	0.31	U	0.21
	30-Mar-15 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
	22-Apr-15	NS		0.21	U	NS	NS	0.21	U	0.03	U	0.24
	21-Jul-15	0.5	U	NS	2	U	10	U	0.6	U	0.50 ^v	U
	23-Sept-15 resample	NS		NS	NS	NS	NS	NS	0.5	U	NS	NS
	29-Oct-15	NS		0.6	U	NS	NS	0.6	U	0.5	U	0.5
	4-Dec-15 resample	NS		0.5	U	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	0.21
	20-Apr-16	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	20-Jul-16	1.0	U	NS	1.0	U	1.0	U	NS	1.0	U	NS
	21-Oct-16	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	31-Jan-17	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	NS
	17-Apr-17	NS		0.310	U	NS	NS	0.310	U	0.310	U	0.310
	26-Jul-17	0.21	U	NS	0.21	U	0.21	U	NS	0.210	U	NS
	12-Oct-17	NS		0.21	U	NS	NS	0.21	U	0.590	U	0.52
	10-Jan-18	0.21	U	NS	0.21	U	0.21	U	NS	0.210	U	0.21
	11-Apr-18	NS		0.21	U	NS	NS	2.1 ^v	U	2.1 ^v	U	2.1 ^v
	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jul-18	1.0	U	NS	1.0	U	1.0	U	NS	1.0	U	1.0
	24-Oct-18	NS		1	U	NS	NS	1	U	1	U	1
	16-Jan-19	0.2	U	NS	0.2	U	0.2	U	NS	0.2	U	NS
	12-Apr-19	NS		0.1	U	NS	NS	0.1	U	0.16	U	0.16
	29-Jul-19	0.31	U	NS	0.31	U	0.21	U	NS	0.21	U	3.1
	26-Sep-19	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-19	NS		0.21	U	NS	NS	0.21	U	1 ^v	U	1 ^v
	21-Jan-20	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	NS
	22-Apr-20	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	23-Jul-20	0.21	U	NS	0.21	U	0.21	U	NS	0.41	U	NS
	29-Oct-20	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	19-Jan-21	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	0.31 ^f
	15-Apr-21	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	21-Jul-21	0.21	U	NS	0.21	U	0.21	U	NS	0.21	U	NS
	20-Oct-21	NS		0.21	U	NS	NS	0.21	U	0.21	U	0.21
	9-Feb-22	0.21	U	NS	0.21	U</td						

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
2-Butanone	8-Feb-08	126	NS	NS	NS	1.47	U	NS	NS	3.08	10.6	NS
	27-Mar-08	NS	226	NS	NS	NS	NS	NS	NS	11.9	3.9	
	25-Apr-08	NS	NS	477	NS	NS	NS	1680	NS	2.24	NS	1.47
	29-May-08	NS	NS	NS	527	NS	NS	NS	591	2.27	3.04	NS
	27-Jun-08	1080	NS	NS	NS	596	NS	NS	NS	6.92	3.64	
	31-Jul-08	NS	1350	NS	NS	NS	NS	NS	NS	12	NS	2.56
	28-Aug-08	NS	NS	8380	NS	NS	NS	102	NS	5.29	9.18	NS
	30-Sep-08	NS	NS	NS	101	NS	NS	NS	194	NS	2	1.5
	27-Oct-08	53.5	NS	NS	NS	30.5	NS	NS	NS	2.4	NS	5.7
	25-Nov-08	NS	802	NS	NS	NS	259	NS	NS	1.8	2.4	NS
	18-Dec-08	NS	NS	5630	NS	NS	NS	8.3	NS	NS	2.6	3.3
	21-Jan-09	NS	NS	NS	209	NS	NS	NS	24	1.5	NS	1.5
	25-Feb-09	30	NS	NS	NS	198	NS	NS	NS	1.5	U	NS
	26-Mar-09	NS	926	NS	NS	29.1	NS	NS	NS	2.66	3.02	
	29-Apr-09	NS	NS	12400	NS	NS	NS	38.1	NS	1.47	U	NS
	22-Jul-09	433	NS	433	410	NS	151	NS	NS	21.6	2.8	NS
	9-Oct-09	NS	289	NS	1.47	U	NS	19.1	22700	2.75	NS	12.6
	15-Jan-10	29.8	NS	826	64.1	NS	38.4	NS	NS	2.64	1.6	NS
	21-Apr-10	NS	6.44	NS	NS	7.37	U	NS	34.6	1840	16.8	NS
	16-Jul-10	5320	NS	21000	441	NS	10400	NS	NS	1.54	2.8	NS
	15-Oct-10	NS	117	NS	NS	44.9	NS	2.85	18.2	1.47	U	NS
	26-Jan-11	940	22.3	NS	16.5	NS	7.37	U	NS	50.4	7.37	U
	28-Feb-11	NS	NS	625	NS	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	6.87	NS	NS	171	NS	11.3	15.3	5.38	NS	10.4
	26-Jul-11	690	E	NS	82.9	93.2	NS	11000	NS	NS	2.07	7.37
	28-Oct-11	NS	59	U	NS	59	U	NS	59	U	NS	59
	23-Jan-12	110	NS	70	12	U	NS	20	NS	NS	12	U
	13-Apr-12	NS	16	NS	74	NS	12	U	12	U	12	U
	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	59	U
	23-Jun-12	75	NS	92	3700	NS	1900	NS	NS	12	U	12
	1-Nov-12	NS	24	NS	44	NS	3.6	12	3.7	NS	4.2	
	1-Feb-13	36	NS	4.9	16	NS	20	NS	NS	2.4	2.4	NS
	29-Apr-13	NS	170	NS	110	NS	6.1	7	7.2	NS	4.5	
	9-Jul-13	98	NS	130	79	NS	370	NS	NS	6.8	2.4	U
	18-Oct-13	NS	91	NS	28	NS	4	52	8.2	NS	6.4	
	9-Jan-14	1900	NS	11	26	NS	11	NS	NS	4.2	2.6	NS
	24-Apr-14	NS	32	NS	11	NS	3.2	19	8.1	2.5	3.5	U
	1-Aug-14	38	NS	110/81	110/93	NS	NS	NS	NS	5.8	4.3	NS
	27-Aug-14	NS	NS	NS	NS	12	NS	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	7.0	NS	NS	NS	NS	NS
	22-Oct-14	NS	5.8	NS	16	3.5	U	3.9	3.5	U	4.7	U
	20-Jan-15	5.1	NS	3.9	4.3	NS	2.4	NS	NS	7.5	6.2	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	5.5	NS
	22-Apr-15	NS	17 ^v	NS	23 ^v	NS	11	11	19	NS	10	
	21-Jul-15	17	NS	55	170	NS	21	NS	NS	20 ^v	2.2 ^v	NS
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	7.9	NS	NS	NS	NS
	29-Oct-15	NS	10	NS	13	NS	11	5.7	2.1	NS	3.1	
	4-Dec-15 resample	NS	3.3	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	2.4	U	NS	2.4	U	NS	2.4	U	NS	12	4.4
	20-Apr-16	NS	21	NS	29	NS	34	21	12	NS	4.1	
	20-Jul-16	36	NS	37	12	U	NS	46	NS	32	12	U
	21-Oct-16	NS	21	NS	12	NS	3.3	3.3	5.1	NS	8.3	
	31-Jan-17	2.4	U	NS	2.8	U	NS	2.4	NS	5	5.6	NS
	17-Apr-17	NS	13	NS	NS	21	NS	4.2	16	8	NS	7
	26-Jul-17	29	NS	16	6.1	NS	7.3	NS	NS	6.8	3.5	NS
	12-Oct-17	NS	8.3	NS	8.3	NS	7.1	U	5.9	U	6.7	U
	10-Jan-18	96 ^e	NS	18	2.4	U	8.1	NS	NS	4.7	NS	3.5
	11-Apr-18	NS	6	NS	24	U	NS	24	U	5.1	NS	24
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	3.5	U
	27-Jul-18	22	NS	24	12	U	NS	12	U	20	12	U
	24-Oct-18	NS	12	U	NS	12	U	NS	12	U	12	U
	16-Jan-19	41	NS	3	2.4	U	NS	2.4	NS	3.6	3.9	NS
	12-Apr-19	NS	7.3	NS	6.4	NS	3	U	3.5	U	4.4	
	29-Jul-19	6.4	NS	25	12	NS	11	NS	NS	9.7	3.2	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	210	NS
	29-Oct-19	NS	9	NS	4.2	NS	2.4	U	2.4	U	12 ^v	U
	21-Jan-20	9.00	NS	2.40	U	NS	2.40	U	NS	2.40	U	2.40
	22-Apr-20	NS	2.4	U	NS	2.4	U	2.4	U	7.3	NS	2.6
	23-Jul-20	94 ^e	NS	7.1	7	NS	4.7	U	NS	33	11	NS
	29-Oct-20	NS	5.4	NS	3.3	NS	2.4	U	2.4	U	7.3	NS
	19-Jan-21	2.6	NS	2.4	U	NS	2.4	U	NS	6.5	3.5 ^t	U
	15-Apr-21	NS	11	NS	NS	2.4	U	2.4	U	4	NS	2.4
	21-Jul-21	4.8	NS	2.4	U	6.8	NS	9.5	NS	18	3.8	NS
	20-Oct-21	NS	2.6	NS	2.8	NS	2.4	U	2.4	U	5.2	U
	9-Feb-22	2.6	NS	2.4	U	NS	2.4					

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
n-Butylbenzene	8-Feb-08	2.74	U	NS	NS	NS	2.74	U	NS	NS	2.74	U
	27-Mar-08	NS		2.74	U	NS	NS	U	NS	NS	2.74	U
	25-Apr-08	NS		NS	2.74	U	NS	U	NS	2.74	U	NS
	29-May-08	NS		NS	2.74	U	NS	U	NS	2.74	U	NS
	27-Jun-08	4.27	U	NS	NS	NS	2.74	U	NS	NS	2.74	U
	31-Jul-08	NS		2.74	U	NS	NS	U	NS	NS	2.74	U
	28-Aug-08	NS		NS	2.74	U	NS	U	NS	2.74	U	NS
	30-Sep-08	NS		NS	5.5	U	NS	U	NS	5.5	U	5.5
	27-Oct-08	22.1		NS	NS	5.5	U	NS	NS	12.8		5.5
	25-Nov-08	NS		5.5	U	NS	NS	U	NS	5.5	U	NS
	18-Dec-08	NS		NS	5.5	U	NS	U	NS	5.5	U	5.5
	21-Jan-09	NS		NS	5.5	U	NS	U	NS	5.5	U	5.5
	25-Feb-09	5.5	U	NS	NS	5.5	U	NS	NS	5.5	U	NS
	26-Mar-09	NS		13.7	U	NS	NS	U	NS	NS	2.74	U
	29-Apr-09	NS		NS	2.74	U	NS	U	NS	2.74	U	2.74
	22-Jul-09	13.7	U	NS	13.7	U	27.4	U	NS	2.74	U	NS
	9-Oct-09	NS		1.08	U	NS	2.74	U	NS	2.74	U	2.74
	15-Jan-10	2.74	U	NS	2.74	U	NS	U	NS	2.74	U	NS
	21-Apr-10	NS		2.74	U	NS	NS	U	13.7	U	2.74	U
	16-Jul-10	2.74	U	NS	2.74	U	NS	U	NS	2.74	U	2.74
	15-Oct-10	NS		2.74	U	NS	NS	U	2.74	U	2.74	U
	26-Jan-11	27.4	U	2.74	U	NS	2.74	U	NS	13.7	U	NS
	28-Feb-11	NS		NS	NS	NS	NS	U	NS	NS	NS	NS
	27-Apr-11	NS		2.745	U	NS	NS	U	NS	2.74	U	2.74
	26-Jul-11	9.17	U	NS	9.17	U	2.74	U	NS	13.7	U	13.7
	28-Oct-11	NS		7.9	U	NS	7.9	U	7.9	U	7.9	U
	23-Jan-12	1.6	U	NS	1.6	U	1.6	U	NS	1.6	U	1.6
	13-Apr-12	NS		1.6	U	NS	NS	U	1.6	U	1.6	U
	2-Jul-12 (resample)	NS		NS	NS	NS	NS	U	NS	NS	7.9	U
	23-Jun-12	1.6	U	NS	1.6	U	1.6	U	NS	1.6	U	NS
	1-Nov-12	NS		0.32	U	NS	0.32	U	0.44	U	0.35	U
	1-Feb-13	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	29-Apr-13	NS		0.79	U	NS	0.32	U	0.32	U	0.32	U
	9-Jul-13	0.47	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	18-Oct-13	NS		0.54	NS	NS	0.52	NS	0.74	U	0.65	U
	9-Jan-14	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	24-Apr-14	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	1-Aug-14	0.32	U	NS	0.63	0.47 ^L	U	NS	0.32	U	0.32	U
	27-Aug-14	NS		NS	NS	NS	NS	U	NS	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	U	NS	0.47	U	NS
	22-Oct-14	NS		0.47	U	NS	0.47	U	0.47	U	0.47	U
	20-Jan-15	0.32	U	NS	0.32	U	0.32	U	NS	0.47	U	0.032
	30-Mar-15 (resample)	NS		NS	NS	NS	NS	U	NS	NS	0.36	U
	22-Apr-15	NS		0.32	U	NS	0.32	U	0.46	U	0.32	U
	27-Jan-16	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	20-Apr-16	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	20-Jul-16	1.6	U	NS	1.6 ^{MV}	U	1.6	U	NS	1.6	U	1.6
	21-Oct-16	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	31-Jan-17	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	17-Apr-17	NS		0.47	U	NS	0.47	U	0.47	U	0.47	U
	26-Jul-17	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	12-Oct-17	NS		0.32	U	NS	0.32	U	0.96	U	0.79	U
	10-Jan-18	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	11-Apr-18	NS		0.32	U	NS	3.2	U	3.2	U	3.2	U
	23-May-18	NS		NS	NS	NS	NS	U	NS	NS	0.47	U
	27-Jul-18	1.6	U	NS	1.6	U	1.6	U	NS	1.6	U	1.6
	24-Oct-18	NS		1.6	U	NS	1.6	U	1.6	U	1.6	U
	16-Jan-19	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	12-Apr-19	NS		0.32	U	NS	0.32	U	0.4	U	0.47	U
	29-Jul-19	0.47	U	NS	0.47	U	0.32	U	NS	0.32	U	0.32
	26-Sep-19	NS		NS	NS	NS	NS	U	NS	0.47	U	NS
	29-Oct-19	NS		0.32	U	NS	0.32	U	0.32	U	1.6 ^D	U
	21-Jan-20	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	22-Apr-20	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	23-Jul-20	0.32	U	NS	0.32	U	0.63	U	NS	0.63	U	0.63
	29-Oct-20	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	19-Jan-21	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.47 ^F
	15-Apr-21	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	21-Jul-21	0.63	U	NS	0.63	U	0.63	U	NS	0.63	U	0.63
	20-Oct-21	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	9-Feb-22	0.32	U	NS	0.32	U	0.32	U	NS	0.32	U	0.32
	7-Apr-22	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U
	28-Jul-22	0.32	U	NS	0.63	U	0.63	U	NS	0.95	U	0.63
	18-Oct-22	NS		0.32	U	NS	0.32	U	0.32	U	0.32	U</td

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	2.74	U	NS	NS	NS	NS	NS	2.74	U	2.74	U
	27-Mar-08	NS		2.74	U	NS	NS	NS	NS	NS	2.74	U
	25-Apr-08	NS		NS	2.74	U	NS	NS	2.74	U	2.74	U
	29-May-08	NS		NS	NS	2.74	U	NS	NS	2.74	U	NS
	27-Jun-08	4.27	U	NS	NS	NS	NS	NS	2.74	U	2.74	U
	31-Jul-08	NS		2.74	U	NS	NS	NS	NS	2.74	U	2.74
	28-Aug-08	NS		NS	2.74	U	NS	NS	2.74	U	2.74	U
	27-Oct-08	NS		NS	5.5	U	NS	NS	5.5	U	5.5	U
	27-Oct-08	5.5	U	NS	NS	5.5	U	NS	NS	5.5	U	5.5
	25-Nov-08	NS		5.5	U	NS	NS	NS	5.5	U	5.5	U
	18-Dec-08	NS		NS	5.5	U	NS	NS	5.5	U	5.5	U
	21-Jan-09	NS		NS	NS	5.5	U	NS	NS	5.5	U	5.5
	25-Feb-09	5.5	U	NS	NS	NS	U	NS	NS	5.5	U	NS
	26-Mar-09	NS		13.7	U	NS	NS	NS	27.4	U	NS	2.74
	29-Apr-09	NS		NS	2.74	U	NS	NS	2.74	U	NS	2.74
	22-Jul-09	13.7	U	NS	13.7	U	27.4	U	NS	13.7	U	2.74
	9-Oct-09	NS		2.74	U	NS	2.74	U	NS	2.74	U	2.74
	15-Jan-10	2.74	U	NS	2.74	U	NS	2.74	U	NS	2.74	U
	21-Apr-10	NS		2.74	U	NS	NS	13.7	U	13.7	U	2.74
	16-Jul-10	2.74	U	NS	2.74	U	NS	20.7	U	2.74	U	2.74
	15-Oct-10	NS		2.74	U	NS	2.74	U	NS	2.74	U	NS
	26-Jan-11	27.4	U	2.74	U	NS	2.74	U	13.7	U	13.7	U
	28-Feb-11	NS		NS	27.4	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS		2.74	U	NS	NS	2.74	U	2.74	U	2.47
	26-Jul-11	9.17	U	NS	9.17	U	2.74	U	NS	13.7	U	NS
	28-Oct-11	NS		6.3	U	NS	6.3	U	6.3	U	6.3	U
	23-Jan-12	1.3	U	NS	1.3	U	1.3	U	NS	1.3	U	1.3
	13-Apr-12	NS		1.3	U	NS	NS	1.3	U	1.3	U	1.3
sec-Butylbenzene	2-Jul-12 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	6.3	U
	23-Jun-12	1.3	U	NS	1.3	U	1.3	U	NS	1.3	U	NS
	1-Nov-12	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	1-Feb-13	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	29-Apr-13	NS		0.63	U	NS	0.25	U	NS	0.25	U	0.25
	9-Jul-13	0.38	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	18-Oct-13	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	9-Jan-14	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	24-Apr-14	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.38
	1-Aug-14	0.25	U	NS	0.38	U	0.38	U	NS	0.25	U	NS
	27-Aug-14	NS		NS	NS	NS	NS	0.25	U	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	NS	0.38	U	NS
	22-Oct-14	NS		0.38	U	NS	0.38	U	0.38	U	0.38	U
	20-Jan-15	0.25	U	NS	0.25	U	0.25	U	NS	0.38	U	0.25
	30-Mar-15 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	0.28	U
	22-Apr-15	NS		0.26	U	NS	0.25	U	NS	0.36	U	0.29
	27-Jan-16	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	20-Apr-16	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	20-Jul-16	1.3	U	NS	1.3 ^{MW}	U	1.3	U	NS	1.3	U	1.3
	21-Oct-16	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	31-Jan-17	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	0.25
	17-Apr-17	NS		0.38	U	NS	0.38	U	0.38	U	0.38	U
	26-Jul-17	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	0.25
	12-Oct-17	NS		0.25	U	NS	0.25	U	0.76	U	0.71	U
	10-Jan-18	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	0.25
	11-Apr-18	NS		0.25	U	NS	2.5	U	2.5	U	2.5	U
	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	0.38	U
	27-Jul-18	1.3	U	NS	1.3	U	1.3	U	NS	1.3	U	NS
	24-Oct-18	NS		1.3	U	NS	1.3	U	1.3	U	1.3	U
	16-Jan-19	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	12-Apr-19	NS		0.25	U	NS	0.25	U	0.31	U	0.38	U
	29-Jul-19	0.38	U	NS	0.38	U	0.25	U	NS	0.25	U	0.25
	26-Sep-19	NS		NS	NS	NS	NS	NS	NS	NS	0.38	U
	29-Oct-19	NS		0.25	U	NS	0.25	U	0.25	U	1.3 ^D	U
	21-Jan-20	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	22-Apr-20	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	23-Jul-20	0.25	U	NS	0.25	U	0.25	U	0.5	U	0.5	U
	29-Oct-20	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	19-Jan-21	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	0.38 ^F
	15-Apr-21	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	21-Jul-21	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	20-Oct-21	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	9-Feb-22	0.25	U	NS	0.25	U	0.25	U	NS	0.25	U	NS
	7-Apr-22	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	28-Jul-22	0.25	U	NS	0.5	U						

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.44	NS	NS	NS	0.46	NS	NS	0.53	0.45	NS	
	27-Mar-08	NS	0.539	NS	NS	0.477	NS	NS	NS	0.576	0.574	
	25-Apr-08	NS	NS	0.417	NS	NS	0.448	NS	0.459	NS	0.448	
	29-May-08	NS	NS	NS	0.46	NS	NS	0.46	0.47	0.46	NS	
	27-Jun-08	0.478	NS	NS	0.506	NS	NS	NS	NS	0.533	0.553	
	31-Jul-08	NS	0.576	NS	NS	NS	NS	NS	0.548	NS	0.495	
	28-Aug-08	NS	NS	0.515	NS	NS	0.549	NS	0.567	0.563	NS	
	30-Sep-08	NS	NS	0.511	NS	NS	NS	0.577	NS	0.451	0.469	
	27-Oct-08	0.48	NS	NS	0.36	NS	NS	NS	0.41	NS	0.56	
	25-Nov-08	NS	0.5	NS	NS	0.42	NS	NS	0.3	0.44	NS	
	18-Dec-08	NS	NS	0.23	NS	NS	0.28	NS	NS	0.48	0.46	
	21-Jan-09	NS	NS	0.36	NS	NS	NS	0.47	0.27	NS	0.67	
	25-Feb-09	0.39	NS	NS	0.36	NS	NS	NS	0.37	0.36	NS	
	26-Mar-09	NS	0.629	U	NS	1.26	U	NS	NS	0.601	0.565	
	29-Apr-09	NS	NS	0.484	NS	NS	0.528	NS	0.522	NS	0.654	
	22-Jul-09	0.629	U	NS	25.6	1.26	U	NS	0.515	0.503	NS	
	9-Oct-09	NS	0.691	NS	0.666	NS	0.465	26.2	U	0.71	0.691	
	15-Jan-10	0.427	NS	0.647	0.509	NS	0.541	NS	0.541	0.528	NS	
	21-Apr-10	NS	0.126	NS	NS	0.629	U	0.629	U	0.61	0.503	
	16-Jul-10	0.459	NS	0.478	0.515	NS	0.95	U	NS	0.559	0.509	
	15-Oct-10	NS	0.509	NS	NS	0.434	NS	0.383	0.402	0.421	NS	
	26-Jan-11	1.26	U	0.415	NS	0.415	NS	0.629	U	0.629	0.629	U
	28-Feb-11	NS	NS	1.26	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.339	NS	NS	0.339	NS	0.33	0.364	0.339	NS	0.327
	26-Jul-11	0.44	NS	0.42	U	0.409	NS	0.629	U	0.402	0.629	U
	28-Oct-11	NS	3.1	U	NS	3.1	U	3.1	U	3.1	U	3.1
	23-Jan-12	0.63	U	NS	0.63	U	0.63	U	NS	0.63	U	NS
	13-Apr-12	NS	0.31	U	NS	0.31	U	0.31	U	0.31	U	0.31
Carbon tetrachloride	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	1.6	U	NS
	23-Jun-12	0.63	U	NS	0.63	U	0.63	U	NS	0.63	U	NS
	1-Nov-12	NS	0.48	NS	NS	0.46	NS	0.46	0.45	0.47	NS	0.43
	1-Feb-13	0.44	NS	0.43	0.39	NS	0.42	NS	NS	0.49	0.5	NS
	29-Apr-13	NS	0.42	NS	NS	0.44	NS	0.42	0.48	0.48	NS	0.46
	9-Jul-13	0.52	NS	0.52	0.46	NS	0.48	NS	NS	0.45	0.47	NS
	18-Oct-13	NS	0.45	NS	NS	0.41	NS	0.4	0.45	0.44	NS	0.47
	9-Jan-14	0.40	NS	0.45	0.40	NS	0.43	NS	NS	0.43	0.43	NS
	24-Apr-14	NS	0.48	NS	NS	0.45	NS	0.42	0.47	0.47	0.48	NS
	1-Aug-14	0.30	NS	0.44	0.43	NS	NS	NS	NS	0.56	0.43	NS
	27-Aug-14	NS	NS	NS	NS	NS	0.45	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	NS	0.43	NS	NS	U
	22-Oct-14	NS	0.45	NS	NS	0.42	0.43	0.42	0.45	0.43	0.44	NS
	20-Jan-15	0.45	NS	0.49	0.42	NS	0.44	NS	NS	0.48	0.48	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.43	NS
	22-Apr-15	NS	0.28	NS	NS	0.29	NS	0.34	0.34/0.36	0.33	NS	0.33
	21-Jul-15	0.270 ⁺	NS	1	U	6	U	NS	0.28 ⁺	NS	0.25 ⁺ ^U	0.24 ⁺ ^U
	23-Sept-15 resample	NS	NS	NS	NS	0.29 ⁺	NS	0.27 ⁺	0.28 ⁺	0.27 ⁺	NS	0.27 ⁺
	29-Oct-15	NS	0.35	NS	NS	NS	NS	NS	NS	NS	NS	NS
	4-Dec-15 resample	NS	0.30 ⁺	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.57	NS	0.59	0.53	NS	0.56	NS	0.57	0.59	NS	NS
	20-Apr-16	NS	0.65	NS	NS	0.61	NS	0.62	0.65	0.64	NS	0.67
	20-Jul-16	0.42	NS	0.58	0.59	NS	0.64	NS	NS	0.63	0.55	NS
	21-Oct-16	NS	0.49	NS	NS	0.45	NS	0.44	0.46	0.48	NS	0.47
	31-Jan-17	0.41	NS	0.38	0.39	NS	0.4	NS	NS	0.45	0.48	NS
	17-Apr-17	NS	0.49	NS	NS	0.44	NS	0.43	0.49	0.44	NS	0.48
	26-Jul-17	0.4	NS	0.44	0.41	NS	0.4	NS	NS	0.39	0.39	NS
	12-Oct-17	NS	0.38	NS	NS	0.37	NS	0.43	0.62	0.47	NS	0.41
	10-Jan-18	0.34	NS	0.35	0.36	NS	0.35	NS	NS	0.37	NS	0.37
	11-Apr-18	NS	0.49	NS	NS	1.3 ^v	U	1.3 ^v	U	0.55	NS	1.3 ^v
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	0.45	NS	NS
	27-Jul-18	0.31	U	NS	0.31	U	0.31	U	NS	0.31	U	NS
	24-Oct-18	NS	0.31	U	NS	0.31	U	0.31	U	0.31	U	0.31
	16-Jan-19	0.4	NS	0.39	0.39	NS	0.4	NS	NS	0.44	0.44	NS
	12-Apr-19	NS	0.47	NS	NS	0.44	NS	0.39	0.42	0.45	NS	0.43
	29-Jul-19	0.37	NS	0.44	0.47	NS	0.49	NS	NS	0.46	1.8	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.094	NS
	29-Oct-19	NS	0.063	U	NS	0.49	NS	0.46	0.45	0.43 ^v	0.5 ^v	0.44 ^d
	21-Jan-20	0.42	NS	0.40	0.41	NS	0.40	NS	NS	0.43	0.44	NS
	22-Apr-20	NS	0.37	NS	NS	0.4	NS	0.38	0.38	0.39	NS	0.39
	23-Jul-20	0.39	NS	0.43	0.44	NS	0.62	NS	NS	0.5	0.53	NS
	29-Oct-20	NS	0.44	NS	NS	0.46	NS</					

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.09	U	NS	NS	NS	NS	NS	0.09	U	0.09	U
	27-Mar-08	NS		0.052	U	NS	NS	NS	0.092	U	NS	0.092
	25-Apr-08	NS		NS	U	0.092	U	NS	NS	U	NS	0.092
	29-May-08	NS		NS	U	0.09	U	NS	NS	U	0.09	U
	27-Jun-08	0.207		NS	U	NS	U	NS	0.092	U	NS	0.092
	31-Jul-08	NS		0.092	U	NS	U	NS	NS	U	NS	0.092
	28-Aug-08	NS		NS	U	0.092	U	NS	NS	U	0.092	U
	30-Sep-08	NS		NS	U	2.3	U	NS	NS	U	2.3	U
	27-Oct-08	2.3	U	NS	U	NS	U	NS	2.3	U	NS	2.3
	25-Nov-08	NS		2.3	U	NS	U	NS	NS	U	2.3	U
	18-Dec-08	NS		NS	U	2.3	U	NS	NS	U	2.3	U
	21-Jan-09	NS		NS	U	2.3	U	NS	NS	U	2.3	U
	25-Feb-09	2.3	U	NS	U	NS	U	NS	NS	U	2.3	U
	26-Mar-09	NS		0.46	U	NS	U	NS	0.92	U	NS	0.092
	29-Apr-09	NS		NS	U	0.092	U	NS	NS	U	0.092	U
	22-Jul-09	0.46	U	NS	U	18.8	U	0.92	U	NS	0.092	U
	9-Oct-09	NS		0.092	U	NS	U	0.092	U	NS	0.092	U
	15-Jan-10	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	21-Apr-10	NS		0.092	U	NS	U	0.46	U	0.46	U	0.092
	16-Jul-10	0.092	U	NS	U	0.092	U	0.212	U	NS	0.092	U
	15-Oct-10	NS		0.092	U	NS	U	0.129	U	0.106	U	0.101
	26-Jan-11	0.92	U	0.092	U	NS	U	0.092	U	0.46	U	0.46
	28-Feb-11	NS		NS	U	0.92	U	NS	NS	U	NS	NS
	27-Apr-11	NS		0.092	U	NS	U	0.092	U	0.092	U	0.092
	26-Jul-11	0.307	U	NS	U	0.307	U	0.092	U	0.46	U	0.46
	28-Oct-11	NS		2.3	U	NS	U	2.3	U	2.3	U	2.3
	23-Jan-12	0.46	U	NS	U	0.46	U	NS	0.46	U	0.46	U
	13-Apr-12	NS		0.46	U	NS	U	0.46	U	0.46	U	0.46
Chlorobenzene	2-Jul-12 (resample)	NS		NS	U	NS	U	NS	NS	U	NS	NS
	23-Jun-12	0.46	U	NS	U	0.46	U	0.46	U	NS	0.46	U
	1-Nov-12	NS		0.092	U	NS	U	0.092	U	0.16	U	0.092
	1-Feb-13	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	29-Apr-13	NS		0.12	U	NS	U	0.046	U	0.046	U	0.046
	9-Jul-13	0.18		NS	U	0.14	U	0.15	U	NS	0.092	U
	18-Oct-13	NS		0.092	U	NS	U	0.092	U	0.092	U	0.092
	9-Jan-14	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	24-Apr-14	NS		0.046	U	NS	U	0.046	U	0.046	U	0.14
	1-Aug-14	0.092	U	NS	U	0.14	U	0.25	U	NS	0.092	U
	27-Aug-14	NS		NS	U	NS	U	0.092	U	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	U	NS	U	0.14	U	0.14	U	NS
	22-Oct-14	NS		0.14	U	NS	U	0.14	U	0.14	U	0.18
	20-Jan-15	0.092	U	NS	U	0.092	U	0.092	U	NS	0.14	U
	30-Mar-15 (resample)	NS		NS	U	NS	U	NS	U	NS	0.10	U
	22-Apr-15	NS		0.094	U	NS	U	0.092	U	0.13	U	0.11
	21-Jul-15	0.2	U	NS	U	0.9	U	5	U	NS	0.2	U
	23-Sept-15 resample	NS		NS	U	NS	U	NS	U	0.2	U	NS
	29-Oct-15	NS		0.3	U	NS	U	0.3	U	0.4	U	0.2
	4-Dec-15 resample	NS		0.2	U	NS	U	NS	U	NS	NS	NS
	27-Jan-16	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	20-Apr-16	NS		0.092	U	NS	U	0.092	U	0.092	U	0.092
	20-Jul-16	0.46	U	NS	U	0.46	U	0.46	U	NS	0.46	U
	21-Oct-16	NS		0.092	U	NS	U	0.092	U	0.092	U	0.092
	31-Jan-17	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	17-Apr-17	NS		0.14	U	NS	U	0.14	U	0.14	U	0.14
	26-Jul-17	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	12-Oct-17	NS		0.092	U	NS	U	0.092	U	0.28	U	0.23
	10-Jan-18	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	11-Apr-18	NS		0.092	U	NS	U	0.92	U	0.92	U	0.92
	23-May-18	NS		NS	U	NS	U	NS	U	NS	0.14	U
	27-Jul-18	0.46	U	NS	U	0.46	U	0.46	U	NS	0.46	U
	24-Oct-18	NS		0.46	U	NS	U	0.46	U	0.46	U	0.46
	16-Jan-19	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	12-Apr-19	NS		0.092	U	NS	U	0.092	U	0.12	U	0.14
	29-Jul-19	0.14	U	NS	U	0.14	U	0.092	U	NS	0.092	U
	26-Sep-19	NS		NS	U	NS	U	NS	U	NS	0.14	U
	29-Oct-19	NS		0.092	U	NS	U	0.092	U	0.092	U	0.46 ^b
	21-Jan-20	0.09	U	NS	U	0.09	U	0.09	U	NS	0.09	U
	22-Apr-20	NS		0.092	U	NS	U	0.092	U	0.092	U	0.092
	23-Jul-20	0.092	U	NS	U	0.092	U	0.18	U	NS	0.18	U
	29-Oct-20	NS		0.092	U	NS	U	0.092	U	0.092	U	0.092
	19-Jan-21	0.092	U	NS	U	0.092	U	0.092	U	NS	0.092	U
	15-Apr-21	NS		0.092	U	NS	U	0.092	U			

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.05	U	NS	NS	NS	NS	NS	0.05	U	0.05	U
	27-Mar-08	NS	0.053	U	NS	NS	NS	NS	0.053	U	0.053	U
	25-Apr-08	NS	NS	0.053	U	NS	NS	NS	0.139	NS	NS	U
	29-May-08	NS	NS	NS	U	0.11	NS	NS	NS	0.1	0.07	NS
	27-Jun-08	0.082	U	NS	NS	NS	0.132	NS	NS	NS	0.053	U
	31-Jul-08	NS	0.053	U	NS	NS	NS	NS	NS	NS	0.053	U
	28-Aug-08	NS	NS	0.053	U	NS	NS	NS	0.153	NS	0.053	U
	30-Sep-08	NS	NS	NS	U	1.3	NS	NS	NS	1.3	NS	U
	27-Oct-08	1.3	U	NS	NS	NS	1.3	U	NS	1.3	U	1.3
	25-Nov-08	NS	1.3	U	NS	NS	1.3	U	NS	1.3	U	NS
	18-Dec-08	NS	NS	1.3	U	NS	NS	NS	1.3	NS	1.3	U
	21-Jan-09	NS	NS	NS	U	1.3	NS	NS	NS	1.3	U	1.3
	25-Feb-09	1.3	U	NS	NS	NS	1.3	U	NS	1.3	U	NS
	26-Mar-09	NS	0.264	U	NS	NS	0.527	U	NS	NS	0.1212	U
	29-Apr-09	NS	NS	0.137	U	NS	NS	U	0.063	NS	0.053	U
	22-Jul-09	0.264	U	NS	10.8	0.527	U	NS	0.277	NS	0.053	U
	9-Oct-09	NS	0.053	U	NS	0.058	U	NS	0.406	11	U	0.053
	15-Jan-10	0.053	U	NS	0.074	0.066	NS	0.053	NS	NS	0.053	NS
	21-Apr-10	NS	0.074	NS	NS	0.264	NS	0.303	0.303	0.053	U	0.116
	16-Jul-10	0.1	NS	2.55	NS	0.166	NS	0.398	U	NS	0.053	NS
	15-Oct-10	NS	0.053	U	NS	0.082	NS	0.071	0.053	U	0.053	U
	26-Jan-11	0.527	U	0.053	U	NS	0.077	NS	0.264	U	0.264	U
	28-Feb-11	NS	NS	,527	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.053	U	NS	0.079	NS	0.082	0.053	U	0.053	NS
	26-Jul-11	0.176	U	NS	0.176	0.116	NS	0.264	U	NS	0.264	NS
	28-Oct-11	NS	1.3	U	NS	NS	1.3	U	NS	1.3	U	1.3
	23-Jan-12	0.26	U	NS	0.26	U	0.26	U	NS	0.26	U	0.26
	13-Apr-12	NS	0.26	U	NS	0.26	U	NS	0.26	U	0.26	U
Chloroethane	2-Jul-12 (resample)	NS	NS	NS	U	0.26	U	0.26	U	NS	NS	NS
	23-Jun-12	0.26	U	NS	0.26	U	0.26	U	NS	0.26	U	0.26
	1-Nov-12	NS	0.053	U	NS	NS	0.085	NS	0.08	0.053	U	0.053
	1-Feb-13	0.082	NS	0.053	U	0.11	NS	0.053	U	NS	0.053	U
	29-Apr-13	NS	0.4	NS	NS	0.11	U	NS	0.11	U	0.11	U
	9-Jul-13	0.11	NS	0.12	0.31	NS	0.091	NS	NS	0.11	0.053	U
	18-Oct-13	NS	0.053	U	NS	0.11	NS	0.091	0.053	U	0.053	U
	9-Jan-14	0.084	NS	0.053	U	0.11	NS	0.053	U	NS	0.053	U
	24-Apr-14	NS	0.026	U	NS	0.026	U	NS	0.13	0.026	U	0.026
	1-Aug-14	0.23	NS	0.43	0.53	NS	NS	NS	NS	0.059	0.053	U
	27-Aug-14	NS	NS	NS	NS	NS	0.072	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	0.079	U	0.35	0.079	U	NS
	22-Oct-14	NS	0.079	U	NS	NS	0.079	U	0.35	0.079	U	0.11
	20-Jan-15	0.069 ^v	NS	0.094	0.062	NS	0.24 ^v	NS	NS	0.079 ^v	U	0.053 ^v
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	22-Apr-15	NS	0.20 ^v	NS	NS	0.19 ^v	NS	NS	0.16	0.077	U	0.059
	21-Jul-15	0.1	U	NS	0.5	3	U	NS	0.21	NS	0.1	U
	23-Sept-15 resample	NS	NS	NS	NS	NS	0.1	U	NS	0.1	U	NS
	29-Oct-15	NS	0.1	U	NS	NS	0.2	U	NS	0.1	U	0.1
	4-Dec-15 resample	NS	0.1	NS	0.11	0.12	NS	0.11	NS	NS	NS	NS
	27-Jan-16	0.1	NS	0.14	NS	0.053	U	NS	0.073	0.053	U	0.053
	20-Apr-16	NS	0.26 ^{Lv}	U	NS	0.26 ^{Lv}	U	0.77 ^{Lv}	NS	NS	0.26 ^{Lv}	U
	20-Jul-16	0.26 ^{Lv}	U	NS	0.16	NS	0.069	NS	0.088	0.053	U	0.053
	21-Oct-16	NS	0.16	NS	0.14	0.053	U	NS	0.053	NS	NS	U
	31-Jan-17	0.053	U	NS	0.16	NS	0.079	U	NS	0.079	U	0.079
	17-Apr-17	NS	0.16	NS	0.18	0.12	NS	0.053	U	NS	0.053 ^L	U
	26-Jul-17	0.053	U	NS	0.15	NS	0.066	NS	0.16	U	0.15	U
	12-Oct-17	NS	0.17	NS	0.07	NS	0.36	NS	0.13	U	NS	0.13
	10-Jan-18	0.13	NS	0.53	NS	0.53	U	NS	0.53	U	0.053	NS
	11-Apr-18	NS	0.053	U	NS	NS	0.53	U	NS	0.53	U	0.53
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.079	U
	27-Jul-18	0.26	U	NS	0.26	U	0.26	U	NS	0.26	U	0.26
	24-Oct-18	NS	0.26	U	NS	0.26	U	NS	0.26	U	0.26	U
	16-Jan-19	0.053	U	NS	0.053	U	0.29	NS	NS	0.053	U	0.053
	12-Apr-19	NS	0.053	U	NS	0.053	U	NS	0.066	U	0.079	U
	29-Jul-19	0.079	U	NS	0.079	U	0.053	U	NS	NS	0.053	U
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.079	U
	29-Oct-19	NS	0.053 ^L	U	NS	0.053 ^L	U	NS	0.053 ^L	U	0.26 ^L	U
	21-Jan-20	0.05	U	NS	0.05	U	0.05	U	NS	0.05	U	0.05
	22-Apr-20	NS	0.053	U	NS	0.053	U	NS	0.053	U	0.053	U
	23-Jul-20	0.053	U	NS	0.053	U	0.11	U	NS	0.11	U	NS
	29-Oct-20	NS	0.053	U	NS	0.053	U	NS	0.053	U	0.053	U
	19-Jan-21	0.05										

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.1	U	NS	NS	NS	NS	NS	0.12	0.12	NS	
	27-Mar-08	NS		0.098	U	NS	NS	0.125	NS	0.453	0.847	
	25-Apr-08	NS		NS	0.231	NS	NS	0.203	0.134	NS	0.265	
	29-May-08	NS		NS	NS	0.14	NS	NS	0.1	0.11	NS	
	27-Jun-08	0.263		NS	NS	0.623	NS	NS	NS	NS	0.305	0.395
	31-Jul-08	NS		0.145	NS	NS	NS	NS	0.13	NS	0.124	
	28-Aug-08	NS		NS	0.098	U	NS	NS	0.331	0.386	NS	
	30-Sep-08	NS		NS	NS	0.49	U	NS	NS	0.49	0.49	U
	27-Oct-08	0.49	U	NS	NS	0.49	U	NS	0.49	U	0.49	U
	25-Nov-08	NS		0.24	U	NS	NS	0.24	NS	0.24	U	NS
	18-Dec-08	NS		NS	0.24	U	NS	NS	0.24	U	0.24	U
	21-Jan-09	NS		NS	0.24	U	NS	NS	0.24	U	0.24	U
	25-Feb-09	0.24	U	NS	NS	0.24	U	NS	NS	0.24	U	NS
	26-Mar-09	NS		0.488	U	NS	NS	1.29	NS	NS	0.265	0.2
	29-Apr-09	NS		NS	0.098	U	NS	NS	0.136	NS	0.098	U
	22-Jul-09	0.488	U	NS	19.9	U	NS	0.488	NS	0.429	0.22	NS
	9-Oct-09	NS		0.205	NS	0.263	NS	0.268	20.4	NS	0.312	
	15-Jan-10	0.176		NS	7.22	0.146	NS	0.19	NS	0.098	0.185	NS
	21-Apr-10	NS		0.098	U	NS	0.488	U	0.488	U	0.22	NS
	16-Jul-10	0.361		NS	0.098	U	0.215	NS	0.737	U	0.205	NS
	15-Oct-10	NS		0.171	NS	NS	0.366	NS	0.654	0.117	0.102	NS
	26-Jan-11	2.78		0.122	NS	0.161	NS	0.488	U	0.488	0.488	U
	28-Feb-11	NS		NS	0.976	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.136	NS	NS	0.185	NS	0.117	0.273	0.098	U
	26-Jul-11	0.326	U	NS	0.326	U	0.239	NS	1.37	NS	0.244	0.488
	28-Oct-11	NS		2.4	U	NS	2.4	U	2.4	U	2.4	U
	23-Jan-12	0.49	U	NS	0.84	0.49	U	NS	0.49	U	0.49	0.84
	13-Apr-12	NS		0.24	U	NS	0.24	U	NS	0.24	U	0.24
Chloroform	2-Jul-12 (resample)	NS		NS	NS	0.49	U	NS	NS	NS	1.2	U
	23-Jun-12	0.49	U	NS	0.49	U	0.49	U	NS	0.49	U	0.58
	1-Nov-12	NS		0.088	NS	NS	0.28	NS	0.12	0.076	0.092	NS
	1-Feb-13	0.14		NS	0.46	0.15	NS	0.19	NS	0.11	0.18	NS
	29-Apr-13	NS		0.15	NS	NS	0.19	NS	0.13	0.13	0.16	NS
	9-Jul-13	0.34		NS	0.63	0.33	NS	0.27	NS	NS	0.24	0.27
	18-Oct-13	NS		0.098	U	NS	0.29	NS	0.12	0.11	NS	0.31
	9-Jan-14	0.12		NS	0.94	0.18	NS	0.27	NS	NS	0.16	NS
	24-Apr-14	NS		0.049	U	NS	0.21	NS	0.11	0.049	0.16	0.32
	1-Aug-14	1.0		NS	2.73.6	0.32	NS	NS	NS	NS	2.1	NS
	27-Aug-14	NS		NS	NS	NS	0.19	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	0.12	NS	NS	U
	22-Oct-14	NS		0.073	U	NS	0.24	0.15	0.16	0.073	0.073	U
	20-Jan-15	0.049	U	NS	1.4	0.14	NS	0.29	NS	NS	0.073	U
30-Mar-15 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	0.15	NS
	22-Apr-15	NS		0.17 ^v	NS	NS	0.21 ^v	NS	0.13	0.071	0.17	0.17
	21-Jul-15	0.130 ^j		NS	1	5	U	NS	0.21 ^j	NS	0.14 ^{j,u}	0.17 ^{j,u}
23-Sept-15 resample	NS		NS	NS	NS	NS	NS	NS	NS	0.2	NS	NS
	29-Oct-15	NS		0.16 ^j	NS	NS	0.16 ^j	NS	0.4	U	0.2	U
4-Dec-15 resample	NS		0.2	U	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.086		NS	1	0.13	NS	0.11	NS	NS	0.094	0.16
	20-Apr-16	NS		0.08	NS	NS	0.18	NS	0.1	0.096	0.1	0.13
	20-Jul-16	0.24	U	NS	0.69	0.38	NS	0.47	NS	NS	0.44	NS
	21-Oct-16	NS		0.13	NS	NS	0.27	NS	0.12	0.23	0.1	0.2
	31-Jan-17	0.078		NS	0.56	0.2	NS	0.13	NS	NS	0.094	0.41
	17-Apr-17	NS		0.11	NS	NS	0.20	NS	0.073	U	0.073	U
	26-Jul-17	0.13		NS	0.62	0.24	NS	0.13	NS	NS	0.14	0.33
	12-Oct-17	NS		0.18	NS	NS	0.28	NS	0.15	U	0.14	U
	10-Jan-18	0.1		NS	0.68	0.14	NS	0.18	NS	NS	0.12	NS
	11-Apr-18	NS		0.14	NS	NS	0.98	U	0.98	U	0.13	NS
	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	0.073	U
	27-Jul-18	0.24	U	NS	0.24	U	0.24	U	NS	NS	3.2	NS
	24-Oct-18	NS		0.24	U	NS	0.24	U	0.24	U	0.24	U
	16-Jan-19	0.1		NS	0.14	0.26	NS	0.12	NS	NS	0.049	NS
	12-Apr-19	NS		0.12	NS	NS	0.15	NS	0.061	U	0.073	U
	29-Jul-19	0.073	U	NS	0.69	0.31	NS	0.3	NS	NS	0.2	NS
	26-Sep-19	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-19	NS		0.049	U	NS	0.33	NS	0.14	0.13	0.24 ^d	0.24 ^d
	21-Jan-20	0.05	U	NS	0.13	0.05	U	0.18	NS	NS	0.10	0.05
	22-Apr-20	NS		0.12	NS	NS	0.16	NS	0.049	U	0.049	NS
	23-Jul-20	0.049	U	NS	0.14	0.19	NS	15	NS	NS	0.098	U
	29-Oct-20	NS		0.26	NS	NS	0.35	NS	0.17	0.28	0.3	NS
	19-Jan-21	0.049	U	NS	0.049	U	0.11	NS	0.049	U	0.049	0.2 ^b
	15-Apr-21	NS										

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	2.44	U	NS	NS	NS	NS	NS	2.44	U	2.44	U
	27-Mar-08	NS	U	2.67	NS	NS	NS	NS	3.24	U	2.44	U
	25-Apr-08	NS	U	NS	2.44	U	NS	NS	2.44	U	2.44	U
	29-May-08	NS	U	NS	NS	U	NS	NS	2.44	U	2.44	U
	27-Jun-08	3.8	U	NS	NS	U	NS	NS	2.44	U	2.44	U
	31-Jul-08	NS	U	4.64	NS	NS	NS	NS	2.44	U	2.44	U
	28-Aug-08	NS	U	NS	2.44	U	NS	NS	2.44	U	2.44	U
	30-Sep-08	NS	U	NS	1	U	NS	NS	1	U	1	U
	27-Oct-08	1	U	NS	NS	U	NS	NS	NS	1.1	NS	3.5
	25-Nov-08	NS	U	1	U	NS	NS	1	U	1	U	NS
	18-Dec-08	NS	U	NS	1	U	NS	NS	NS	1.4	1	U
	21-Jan-09	NS	U	NS	1	U	NS	NS	3.1	1	NS	1
	25-Feb-09	1	U	NS	NS	U	NS	NS	NS	1	U	NS
	26-Mar-09	NS	U	12.2	U	NS	NS	24.4	U	NS	4.58	U
	29-Apr-09	NS	U	NS	22.4	U	NS	NS	19.4	U	2.44	U
	22-Jul-09	18.5	U	NS	497	U	32	NS	41.9	NS	2.44	U
	9-Oct-09	NS	U	2.44	U	NS	2.44	U	NS	509	U	2.44
	15-Jan-10	2.44	U	NS	2.78	U	NS	2.44	NS	2.44	U	2.44
	21-Apr-10	NS	U	3.25	NS	U	12.2	U	NS	12.2	U	2.44
	16-Jul-10	1.32	U	NS	62.8	U	1.48	NS	7.79	U	NS	1.03
	15-Oct-10	NS	U	1.03	NS	U	1.03	NS	1.03	U	1.03	U
	26-Jan-11	10.3	U	1.03	U	NS	1.03	U	5.16	U	5.16	U
	28-Feb-11	NS	U	NS	10.3	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	U	1.23	NS	U	1.03	U	NS	1.03	U	1.18
	26-Jul-11	3.45	U	NS	3.45	U	1.03	U	5.16	U	NS	1.03
	28-Oct-11	NS	U	1	U	NS	1	U	NS	1	U	1
	23-Jan-12	0.21	U	NS	0.21	U	0.21	U	0.21	U	1.2	U
	13-Apr-12	NS	U	0.21	NS	U	NS	NS	NS	NS	NS	0.97
	2-Jul-12 (resample)	NS	U	NS	NS	U	NS	NS	NS	NS	NS	NS
	23-Jun-12	0.21	U	NS	0.21	U	0.21	U	2.1	NS	0.21	U
	1-Nov-12	NS	U	0.041	U	NS	0.041	U	NS	0.041	U	0.37
	1-Feb-13	0.5	NS	NS	1.8	NS	2.1	NS	0.19	NS	0.71	NS
	29-Apr-13	NS	U	0.21	U	NS	0.083	U	NS	0.083	U	0.73
	9-Jul-13	0.12	U	NS	0.083	U	0.083	U	0.083	U	1.0	U
	18-Oct-13	NS	U	0.083	NS	NS	0.083	U	NS	0.083	U	0.40
	9-Jan-14	3.2	NS	NS	1.5	NS	0.083	U	0.053	U	0.64	NS
	24-Apr-14	NS	U	4.6	NS	U	4.5	NS	NS	3.5	1.2	0.083
	1-Aug-14	0.083	U	NS	0.12	U	0.12	U	NS	NS	0.083	U
	27-Aug-14	NS	U	NS	NS	U	1.7	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	U	NS	NS	U	NS	NS	NS	0.12	U	NS
	22-Oct-14	NS	U	1.3	NS	U	0.12	U	0.74	U	1.30	0.74
	20-Jan-15	0.083	U	NS	3	U	0.083	U	0.083	U	0.69	U
	30-Mar-15 (resample)	NS	U	NS	NS	U	NS	NS	NS	NS	0.093	NS
	22-Apr-15	NS	U	0.083	U	NS	0.083	U	NS	1.7/1.6	0.72	0.1~
	21-Jul-15	0.69	NS	NS	6.9	2	U	NS	2.6	NS	0.11~	U
	23-Sept-15 resample	NS	U	NS	NS	U	NS	NS	NS	0.09	NS	NS
	29-Oct-15	NS	U	11	NS	U	6.5	NS	3.6	1.5	0.73	NS
	4-Dec-15 resample	NS	U	0.1	NS	U	NS	NS	NS	NS	NS	0.84
	27-Jan-16	0.083	U	NS	3.9	U	0.083	U	2.1	NS	1.4	NS
	20-Apr-16	NS	U	7.7	NS	U	0.083	NS	2.4	1.4	1.1	I
	20-Jul-16	0.41	U	NS	4.3	U	0.41	U	5	NS	1.1	NS
	21-Oct-16	NS	U	0.083	U	NS	0.083	U	NS	1.4	0.9	0.82
	31-Jan-17	0.083	U	NS	3.8	U	0.96	NS	1.4	NS	1.1	0.99
	17-Apr-17	NS	U	0.12	U	NS	0.12	U	NS	1.7	1.2	1.1
	26-Jul-17	0.083	U	NS	0.083	U	0.083	U	0.083	U	0.71	0.56
	12-Oct-17	NS	U	0.083	U	NS	0.083	U	0.25	U	1.5	1.2
	10-Jan-18	5.3	NS	NS	3.8	1.4	NS	2.8	NS	0.99	NS	1.1
	11-Apr-18	NS	U	0.083	U	NS	0.83	U	3.4	1.8	1.4	0.83
	23-May-18	NS	U	NS	NS	U	NS	NS	NS	NS	0.99	NS
	27-Jul-18	4.5	NS	NS	3.4	5.5	NS	2.6	NS	NS	0.41	2.8
	24-Oct-18	NS	U	0.41	U	NS	0.41	U	0.41	U	1	1.2
	16-Jan-19	0.083	U	NS	2	U	0.083	U	0.083	U	1	0.083
	12-Apr-19	NS	U	0.083	U	NS	0.083	U	0.1~	U	1.1~	U
	29-Jul-19	0.12	U	NS	0.12	U	0.083	U	0.083	U	0.083	U
	26-Sep-19	NS	U	NS	NS	U	NS	NS	NS	NS	0.12	U
	29-Oct-19	NS	U	0.083	U	NS	0.083	U	0.083	U	1.1~	0.41~
	21-Jan-20	0.08	U	NS	0.08	U	0.08	U	0.08	U	0.08	U
	22-Apr-20	NS	U	0.083	U	NS	0.083	U	0.083	U	0.92	NS
	23-Jul-20	0.083	U	NS	0.083	U	0.083	U	0.17	U	0.17	U
	29-Oct-20	NS	U	0.083	U	NS	0.083	U	0.083	U	0.083	U
	19-Jan-21	0.083	U	NS	1	U	0.083	U	0.083	U	0.083	U
	15-Apr-21	NS	U	0.083	U	NS	0.083	U	NS	0.083	U	0.083
	21-Jul-21	1.7										

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
Dibromochloromethane	8-Feb-08	0.1	U	NS	NS	NS	0.1	U	NS	NS	0.1	U
	27-Mar-08	NS	0.096	U	NS	NS	0.096	U	NS	NS	0.096	U
	25-Apr-08	NS	NS	U	NS	0.1	U	NS	0.096	U	NS	U
	29-May-08	NS	NS	U	NS	0.096	U	NS	0.1	U	0.1	U
	27-Jun-08	0.15	U	NS	NS	0.096	U	NS	NS	NS	0.096	U
	31-Jul-08	NS	0.096	U	NS	NS	U	NS	NS	NS	0.096	U
	28-Aug-08	NS	NS	U	0.096	U	NS	NS	0.096	U	0.096	U
	30-Sep-08	NS	NS	U	NS	4.2	U	NS	4.2	U	4.2	U
	27-Oct-08	4.2	U	NS	NS	NS	U	NS	NS	4.2	U	4.2
	25-Nov-08	NS	4.2	U	NS	NS	U	NS	NS	4.2	U	NS
	18-Dec-08	NS	NS	U	4.2	U	NS	NS	4.2	U	4.2	U
	21-Jan-09	NS	NS	U	NS	4.2	U	NS	NS	4.2	U	4.2
	25-Feb-09	4.2	U	NS	NS	NS	U	NS	NS	4.2	U	NS
	26-Mar-09	NS	0.48	U	NS	NS	U	0.96	NS	NS	0.096	U
	29-Apr-09	NS	NS	U	0.096	U	NS	NS	0.096	U	NS	0.096
	22-Jul-09	0.48	U	NS	19.6	U	0.96	U	NS	0.096	U	NS
	9-Oct-09	NS	0.096	U	NS	NS	U	NS	0.096	U	0.096	U
	15-Jan-10	0.096	U	NS	0.096	U	0.096	U	NS	0.096	U	NS
	21-Apr-10	NS	0.096	U	NS	NS	U	0.48	U	0.48	U	0.096
	16-Jul-10	0.17	U	NS	0.17	U	0.17	U	NS	0.17	U	0.17
	15-Oct-10	NS	0.17	U	NS	NS	U	0.17	U	0.17	U	0.17
	26-Jan-11	1.7	U	0.17	U	NS	0.17	U	0.851	U	0.851	U
	28-Feb-11	NS	NS	U	1.7	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.17	U	NS	NS	U	0.17	U	0.17	U	0.17
	26-Jul-11	0.568	U	NS	0.568	U	0.17	U	0.852	U	0.852	U
	28-Oct-11	NS	4.3	U	NS	NS	U	4.3	U	4.3	U	4.3
	23-Jan-12	0.85	U	NS	0.85	U	0.85	U	NS	0.85	U	0.85
	13-Apr-12	NS	0.85	U	NS	NS	U	0.85	U	0.85	U	0.85
	2-Jul-12 (resample)	NS	NS	U	NS	NS	U	0.85	U	NS	2.1	U
	23-Jun-12	0.85	U	NS	0.85	U	NS	0.85	U	0.85	U	NS
	1-Nov-12	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.085
	1-Feb-13	0.17	U	NS	0.17	U	0.17	U	NS	0.17	U	NS
	29-Apr-13	NS	0.21	U	NS	NS	U	0.085	U	0.085	U	0.085
	9-Jul-13	0.26	U	NS	0.17	U	0.17	U	NS	0.17	U	NS
	18-Oct-13	NS	0.17	U	NS	NS	U	0.17	U	0.17	U	0.17
	9-Jan-14	0.17	U	NS	0.17	U	0.17	U	NS	0.17	U	NS
	24-Apr-14	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.085
	1-Aug-14	0.17	U	NS	0.26	U	0.26	U	NS	0.17	U	NS
	27-Aug-14	NS	NS	U	NS	NS	U	0.085	U	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	U	NS	NS	U	0.085	U	0.13	U	NS
	22-Oct-14	NS	0.13	U	NS	NS	U	0.13	U	0.13	U	NS
	20-Jan-15	0.085	U	NS	0.085	U	0.085	U	NS	0.13	U	0.085
	30-Mar-15 (resample)	NS	NS	U	NS	NS	U	0.085	U	NS	0.096	U
	22-Apr-15	NS	0.087	U	NS	NS	U	0.085	U	0.083	U	0.098
	21-Jul-15	0.4	U	NS	2	U	8	U	0.5	U	0.4	U
	23-Sept-15 resample	NS	NS	U	NS	NS	U	0.5	U	0.4	U	NS
	29-Oct-15	NS	0.5	U	NS	NS	U	0.5	U	0.4	U	0.4
	4-Dec-15 resample	NS	0.4	U	NS	NS	U	NS	NS	NS	NS	NS
	27-Jan-16	0.085	U	NS	0.085	U	0.085	U	NS	0.085	U	0.085
	20-Apr-16	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.085
	20-Jul-16	0.43	U	NS	0.43	U	0.43	U	NS	0.43	U	NS
	21-Oct-16	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.085
	31-Jan-17	0.085	U	NS	0.085	U	0.085	U	NS	0.085	U	0.085
	17-Apr-17	NS	0.13 ^v	U	NS	NS	U	0.13 ^v	U	0.13 ^v	U	0.13 ^y
	26-Jul-17	0.085	U	NS	0.085	U	0.085	U	NS	0.085	U	NS
	12-Oct-17	NS	0.085	U	NS	NS	U	0.085	U	0.26	U	0.21
	10-Jan-18	0.085	U	NS	0.085	U	0.085	U	NS	0.085	U	0.085
	11-Apr-18	NS	0.17	U	NS	NS	U	1.7	U	1.7	U	1.7
	23-May-18	NS	NS	U	NS	NS	U	NS	NS	NS	U	NS
	27-Jul-18	0.43	U	NS	0.43	U	0.43	U	NS	0.43	U	NS
	24-Oct-18	NS	0.43	U	NS	NS	U	0.43	U	0.43	U	0.43
	16-Jan-19	0.085	U	NS	0.085	U	0.085	U	NS	0.085	U	NS
	12-Apr-19	NS	0.085	U	NS	NS	U	0.085	U	0.11	U	0.13
	29-Jul-19	0.13	U	NS	0.13	U	0.085	U	0.12	NS	0.11	U
	26-Sep-19	NS	NS	U	NS	NS	U	NS	NS	NS	NS	NS
	29-Oct-19	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.43 ^v
	21-Jan-20	0.09	U	NS	0.09	U	0.09	U	NS	0.09	U	0.09
	22-Apr-20	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.085
	23-Jul-20	0.085	U	NS	0.085	U	0.085	U	0.17	U	0.17	U
	29-Oct-20	NS	0.085	U	NS	NS	U	0.085	U	0.085	U	0.085
	19-Jan-21	0.085	U	NS	0.085	U	0.085	U	NS	0.085	U	0.13 ^f
	15-Apr-21	NS	0.085	U								

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.15	U	NS	NS	NS	NS	NS	0.15	U	0.15	U
	27-Mar-08	NS		0.154	U	NS	NS	NS	0.154	U	NS	0.154
	25-Apr-08	NS		NS	U	0.154	U	NS	NS	U	NS	0.154
	29-May-08	NS		NS	U	0.15	U	NS	NS	U	0.15	U
	27-Jun-08	0.239	U	NS	NS	NS	U	NS	0.154	U	NS	0.154
	31-Jul-08	NS		0.154	U	NS	NS	NS	NS	U	NS	0.154
	28-Aug-08	NS		NS	U	0.154	U	NS	NS	U	0.154	U
	30-Sep-08	NS		NS	U	0.15	U	NS	NS	U	0.15	U
	27-Oct-08	0.15	U	NS	NS	NS	U	NS	0.15	U	NS	0.15
	25-Nov-08	NS		0.15	U	NS	NS	NS	0.15	U	NS	0.15
	18-Dec-08	NS		NS	U	0.15	U	NS	NS	U	0.15	U
	21-Jan-09	NS		NS	U	0.15	U	NS	NS	U	0.15	U
	25-Feb-09	0.15	U	NS	NS	NS	U	NS	0.15	U	0.15	U
	26-Mar-09	NS		0.768	U	NS	NS	NS	1.54	U	NS	0.154
	29-Apr-09	NS		NS	U	0.154	U	NS	NS	U	0.154	U
	22-Jul-09	0.768	U	NS	31.3	U	1.54	U	NS	0.768	U	0.154
	9-Oct-09	NS		0.154	U	NS	0.154	U	NS	0.154	U	32
	15-Jan-10	0.154	U	NS	0.154	U	0.154	U	0.154	U	0.154	U
	21-Apr-10	NS		0.154	U	NS	NS	0.768	U	0.768	U	0.154
	16-Jul-10	0.154	U	NS	0.154	U	0.154	U	1.16	U	NS	0.154
	15-Oct-10	NS		0.154	U	NS	0.154	U	NS	0.154	U	0.154
	26-Jan-11	1.54	U	0.154	U	NS	0.154	U	0.768	U	0.768	U
	28-Feb-11	NS		NS	U	1.54	U	NS	NS	U	NS	NS
	27-Apr-11	NS		0.154	U	NS	0.154	U	NS	0.154	U	0.154
	26-Jul-11	0.512	U	NS	0.512	U	0.154	U	0.768	U	0.768	U
	28-Oct-11	NS		3.8	U	NS	NS	3.8	U	3.8	U	3.8
	23-Jan-12	0.77	U	NS	0.77	U	0.77	U	NS	0.77	U	0.77
	13-Apr-12	NS		0.38	U	NS	0.38	U	NS	0.38	U	0.38
1,2-Dibromoethane	2-Jul-12 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	1.9
	23-Jun-12	0.77	U	NS	0.77	U	0.77	U	NS	0.77	U	0.77
	1-Nov-12	NS		0.077	U	NS	NS	0.077	U	0.077	U	0.077
	1-Feb-13	0.077	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
	29-Apr-13	NS		0.19	U	NS	0.077	U	NS	0.077	U	0.077
	9-Jul-13	0.12	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
	18-Oct-13	NS		0.15	U	NS	0.15	U	NS	0.15	U	0.15
	9-Jan-14	0.15	U	NS	0.15	U	0.15	U	NS	0.15	U	0.15
	24-Apr-14	NS		0.077	U	NS	0.077	U	NS	0.077	U	0.077
	1-Aug-14	0.15	U	NS	0.23	U	0.23	U	NS	0.15	U	0.15
	27-Aug-14	NS		NS	NS	NS	NS	0.077	U	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	NS	0.12	U	NS
	22-Oct-14	NS		0.12	U	NS	0.12	U	0.12	U	0.12	U
	20-Jan-15	0.077	U	NS	0.077	U	0.077	U	NS	0.12	U	0.077
	30-Mar-15 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	0.086
	22-Apr-15	NS		0.079	U	NS	0.077	U	NS	0.11	U	0.088
	21-Jul-15	0.4	U	NS	2	U	8	U	NS	0.4	U	0.4
23-Sept-15 resample	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-15	NS		0.4	U	NS	NS	0.4	U	0.4	U	0.4
4-Dec-15 resample	NS		0.4	U	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.077	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
24-Oct-16 resample	20-Apr-16	NS		0.077	U	NS	0.077	U	0.077	U	0.077	U
	20-Jul-16	0.38	U	NS	0.38	U	0.38	U	0.38	U	0.38	U
	21-Oct-16	NS		0.077	U	NS	0.077	U	0.077	U	0.077	U
	31-Jan-17	0.077	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
	17-Apr-17	NS		0.12	U	NS	NS	0.12	U	0.12	U	0.12
	26-Jul-17	0.077	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
	12-Oct-17	NS		0.077	U	NS	0.077	U	0.23	U	0.22	U
	10-Jan-18	0.077	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
	11-Apr-18	NS		0.15	U	NS	1.5	U	1.5	U	1.5	U
	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	NS	0.12
	27-Jul-18	0.38	U	NS	0.38	U	0.38	U	0.38	U	0.38	U
	24-Oct-18	NS		0.38	U	NS	0.38	U	0.38	U	0.38	U
	16-Jan-19	0.077	U	NS	0.077	U	0.077	U	NS	0.077	U	0.077
	12-Apr-19	NS		0.077	U	NS	0.077	U	0.096	U	0.12	U
	29-Jul-19	0.12	U	NS	0.12	U	0.077	U	NS	0.077	U	2.1
	26-Sep-19	NS		NS	NS	NS	NS	NS	NS	NS	NS	0.12
	29-Oct-19	NS		0.077	U	NS	0.077	U	0.077	U	0.38 ^b	U
	21-Jan-20	0.08	U	NS	0.08	U	0.08	U	0.08	U	0.08	U
22-Apr-20 resample	22-Apr-20	NS		0.077	U	NS	0.077	U	0.077	U	0.077	U
	23-Jul-20	0.077	U	NS	0.077	U	0.077	U	0.15	U	0.15	U
	29-Oct-20	NS		0.077	U	NS	0.077	U	0.077	U	0.077	U
	19-Jan-21	0.077	U	NS	0.077</td							

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	IMP-4
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
8-Feb-08	0.12	U	NS	NS	NS	0.12	U	NS	0.12	U	0.55	NS
27-Mar-08	NS		0.12	U	NS	NS	0.12	U	NS	0.12	U	0.12
25-Apr-08	NS		NS	U	0.12	U	NS	NS	0.12	U	NS	U
29-May-08	NS		NS	U	NS	0.12	U	NS	0.12	U	0.12	U
27-Jun-08	0.187	U	NS	NS	NS	0.12	U	NS	NS	0.12	U	0.12
31-Jul-08	NS		0.12	U	NS	NS	U	NS	NS	0.12	U	0.12
28-Aug-08	NS		NS	U	0.12	U	NS	NS	0.12	U	0.12	U
30-Sep-08	NS		NS	U	3	U	NS	NS	3	U	3	U
25-Nov-08	NS		3	U	NS	NS	U	NS	3	U	3	U
18-Dec-08	NS		NS	U	NS	NS	U	NS	NS	3	U	3
21-Jan-09	NS		NS	U	3	U	NS	NS	3	U	NS	3
25-Feb-09	3	U	NS	NS	NS	3	U	NS	NS	3	U	NS
26-Mar-09	NS		0.601	U	NS	NS	U	1.2	U	NS	0.12	U
29-Apr-09	NS		NS	U	0.12	U	NS	NS	0.12	U	NS	0.12
22-Jul-09	0.601	U	NS	NS	24	U	1.2	U	0.601	U	0.12	U
9-Oct-09	NS		0.12	U	NS	0.12	U	NS	0.12	U	25.1	U
15-Jan-10	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
21-Apr-10	NS		0.12	U	NS	NS	U	0.601	U	0.601	U	0.12
16-Jul-10	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
15-Oct-10	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12	U
26-Jan-11	1.2	U	0.12	U	NS	0.12	U	0.601	U	0.601	U	0.601
28-Feb-11	NS		NS	U	1.2	U	NS	NS	NS	NS	NS	NS
27-Apr-11	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12	U
26-Jul-11	0.401	U	NS	0.401	U	0.12	U	NS	0.601	U	0.601	U
28-Oct-11	NS		3	U	NS	NS	U	3	U	3	U	3
23-Jan-12	0.6	U	NS	0.6	U	0.1	U	NS	0.6	U	0.6	U
13-Apr-12	NS		0.6	U	NS	0.6	U	NS	0.6	U	0.6	U
2-Jul-12 (resample)	NS		NS	U	NS	NS	U	NS	NS	NS	3	U
23-Jun-12	0.6	U	NS	0.6	U	0.6	U	NS	0.6	U	0.6	U
1-Nov-12	NS		0.12	U	NS	NS	U	0.12	U	0.12	U	0.12
1-Feb-13	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
29-Apr-13	NS		0.3	U	NS	NS	U	0.12	U	0.12	U	0.12
9-Jul-13	0.18	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
18-Oct-13	NS		0.12	U	NS	NS	U	0.12	U	0.12	U	0.12
9-Jan-14	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
24-Apr-14	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12	U
1-Aug-14	0.12	U	NS	0.18	U	0.69	U	NS	NS	0.12	U	NS
27-Aug-14	NS		NS	U	NS	NS	U	0.12	U	NS	NS	NS
12-Sept-14 (resample)	NS		NS	U	NS	NS	U	NS	0.18	U	NS	NS
22-Oct-14	NS		0.18	U	NS	NS	U	0.18	U	0.18	U	0.24
20-Jan-15	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
30-Mar-15 (resample)	NS		NS	U	NS	NS	U	NS	NS	NS	0.14	U
22-Apr-15	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12	U
21-Jul-15	0.3	U	NS	0.900 ^j	6	U	NS	0.3	U	NS	0.3 ^v	U
23-Sept-15 resample	NS		NS	U	NS	NS	U	NS	0.3	U	NS	NS
29-Oct-15	NS		0.3	U	NS	NS	U	4	NS	0.3	U	0.3
4-Dec-15 resample	NS		0.3	U	NS	NS	U	NS	0.5	U	0.12	U
27-Jan-16	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
20-Apr-16	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12	U
20-Jul-16	0.60	U	NS	0.60	U	0.60	U	NS	0.60	U	0.60	U
21-Oct-16	NS		0.12	U	NS	NS	U	0.12	U	0.12	U	0.12
31-Jan-17	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
17-Apr-17	NS		0.18	U	NS	NS	U	0.18	U	0.18	U	0.18
26-Jul-17	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
12-Oct-17	NS		0.12	U	NS	NS	U	0.12	U	0.36	U	0.32
10-Jan-18	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
11-Apr-18	NS		0.12	U	NS	NS	U	1.2	U	1.2	U	1.2
23-May-18	NS		NS	U	NS	NS	U	NS	NS	NS	0.18	U
27-Jul-18	0.60	U	NS	0.60	U	0.60	U	NS	0.60	U	0.60	U
24-Oct-18	NS		0.6	U	NS	NS	U	0.6	U	0.6	U	0.6
16-Jan-19	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
12-Apr-19	NS		0.12	U	NS	NS	U	0.12	U	0.15	U	0.18
29-Jul-19	0.18	U	NS	0.18	U	0.12	U	NS	0.12	U	0.12	U
26-Sep-19	NS		NS	U	NS	NS	U	NS	NS	NS	0.18	U
29-Oct-19	NS		0.12	U	NS	NS	U	0.23	NS	0.12	U	0.6 ^v
21-Jan-20	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
22-Apr-20	NS		0.12	U	NS	NS	U	0.12	U	0.12	U	0.12
23-Jul-20	0.12	U	NS	0.12	U	0.12	U	NS	0.24	U	0.24	U
29-Oct-20	NS		0.12	U	NS	NS	U	0.12	U	0.12	U	0.12
19-Jan-21	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.12	U
15-Apr-21	NS		0.12	U	NS	NS	U	0.12	U	0.12	U	0.12
21-Jul-21	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	0.	

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
8-Feb-08	0.12	U	NS	NS	0.12	U	NS	NS	0.12	U	0.12
27-Mar-08	NS		0.12	U	NS	0.6	NS	0.12	U	0.12	U
25-Apr-08	NS		NS	U	0.12	U	NS	0.12	U	NS	U
29-May-08	NS		NS	U	NS	1.18	NS	NS	3.47	0.62	NS
27-Jun-08	0.187	U	NS	NS	NS	0.257	NS	NS	NS	0.22	U
31-Jul-08	NS		0.822	U	NS	NS	NS	NS	0.136	U	0.12
28-Aug-08	NS		NS	U	0.12	U	NS	NS	0.12	U	NS
30-Sep-08	NS		NS	U	3	U	NS	NS	3	U	3
27-Oct-08	3	U	NS	NS	NS	3	U	NS	3	U	3
25-Nov-08	NS		3	U	NS	NS	3	U	NS	3	U
18-Dec-08	NS		NS	U	3	U	NS	NS	3	U	3
21-Jan-09	NS		NS	U	3	U	NS	NS	3	U	3
25-Feb-09	3	U	NS	NS	NS	3	U	NS	3	U	NS
26-Mar-09	NS		0.601	U	NS	NS	1.2	U	NS	0.12	U
29-Apr-09	NS		NS	U	0.12	U	NS	NS	0.12	U	0.12
22-Jul-09	0.601	U	NS	NS	24.5	U	1.2	U	NS	0.12	U
9-Oct-09	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12
15-Jan-10	0.12		NS	U	0.12	U	NS	0.12	U	0.12	U
21-Apr-10	NS		0.12	U	NS	NS	0.601	U	0.601	U	0.12
16-Jul-10	0.595		NS	U	0.685	U	1.99	U	NS	0.132	U
15-Oct-10	NS		0.12	U	NS	0.12	U	NS	0.12	U	0.12
26-Jan-11	1.2	U	0.12	U	NS	0.12	U	NS	0.601	U	NS
28-Feb-11	NS		NS	U	1.2	U	NS	NS	NS	NS	NS
27-Apr-11	NS		0.12	U	NS	NS	0.42	U	0.156	U	0.12
26-Jul-11	0.401	U	NS	U	0.401	U	0.12	U	NS	0.12	U
28-Oct-11	NS		3	U	NS	NS	3	U	3	U	3
23-Jan-12	1.6		NS	U	1.8	U	2.3	NS	1.6	NS	2.7
13-Apr-12	NS		0.6	U	NS	NS	0.6	U	0.6	U	0.6
2-Jul-12 (resample)	NS		NS	U	NS	NS	NS	U	NS	NS	NS
23-Jun-12	0.6	U	NS	U	0.6	U	0.6	U	NS	0.6	U
1-Nov-12	NS		1.2		NS	NS	2.6		6	2.2	NS
1-Feb-13	0.18		NS	U	0.34	U	0.56	NS	0.44	NS	0.12
29-Apr-13	NS		1.3		NS	NS	4.5	NS	6.5	NS	0.14
9-Jul-13	1.3		NS	U	2.0	U	3.9	NS	3.8	NS	NS
18-Oct-13	NS		0.52		NS	NS	1.4	NS	2.6	2.2	0.22
9-Jan-14	0.58		NS	U	0.9	U	1.1	NS	0.84	NS	4.1
24-Apr-14	NS		0.12	U	NS	NS	0.14	NS	0.12	U	0.18
1-Aug-14	4.2		NS	U	4.8/6.7	U	4.9/7.6	NS	NS	3.6	NS
27-Aug-14	NS		NS	U	NS	NS	0.80	NS	NS	NS	NS
12-Sept-14 (resample)	NS		NS	U	NS	NS	NS	U	0.82	NS	NS
22-Oct-14	NS		0.18	U	NS	NS	0.18	U	0.18	U	0.24
20-Jan-15	0.12	U	NS	U	0.120	U	0.12	U	NS	0.2	U
30-Mar-15 (resample)	NS		NS	U	NS	NS	NS	NS	NS	0.14	U
22-Apr-15	NS		0.13		NS	NS	0.36	NS	1.5	0.78/0.87	0.17
21-Jul-15	0.3	U	NS	U	1	U	6	U	0.30 ^j	NS	NS
23-Sept-15 resample	NS		NS	U	NS	NS	NS	U	NS	0.3	NS
29-Oct-15	NS		0.3	U	NS	NS	0.3	U	0.5	U	0.3
4-Dec-15 resample	NS		0.3	U	NS	NS	NS	U	NS	NS	U
27-Jan-16	0.12	U	NS	U	0.12	U	0.22 ^m	NS	0.12	U	NS
20-Apr-16	NS		0.31		NS	NS	0.51	NS	0.9	0.24	0.21
20-Jul-16	0.60	U	NS	U	1.3	U	0.60	U	NS	0.60	NS
21-Oct-16	NS		0.12	U	NS	NS	0.12	U	0.12	U	0.12
31-Jan-17	0.12	U	NS	U	0.13	U	0.13	U	0.12	U	0.5
17-Apr-17	NS		0.92		NS	NS	0.79	NS	1.3	1.8	0.18
26-Jul-17	0.2		NS	U	0.12	U	2.3	NS	3.5	NS	0.12
12-Oct-17	NS		2.2		NS	NS	0.73	NS	4.2	4.5	1
10-Jan-18	0.12	U	NS	U	0.19	U	0.28	NS	0.12	NS	0.69
11-Apr-18	NS		0.12	U	NS	NS	1.2	U	1.2	0.58	1.2
23-May-18	NS		NS	U	NS	NS	NS	NS	NS	3.2	NS
27-Jul-18	3.4		NS	U	6.4	U	4.4	NS	4.1	NS	NS
24-Oct-18	NS		0.6	U	NS	NS	0.6	U	0.6	U	0.6
16-Jan-19	0.12	U	NS	U	0.12	U	0.12	U	NS	0.19	0.24
12-Apr-19	NS		0.2		NS	NS	0.13	U	0.15	U	0.18
29-Jul-19	3.3		NS	U	3	U	6.4	NS	6.7	NS	3.6
26-Sep-19	NS		NS	U	NS	NS	NS	NS	NS	NS	NS
29-Oct-19	NS		1		NS	NS	1.4	NS	0.22	1.1	1
21-Jan-20	0.57		NS	U	0.68	U	0.67	NS	0.25	NS	0.93
22-Apr-20	NS		0.3		NS	NS	0.13	NS	0.63	0.84	0.12
23-Jul-20	0.12	U	NS	U	6.3	U	0.12	U	NS	0.24	U
29-Oct-20	NS		0.12	U	NS	NS	0.12	U	0.12	U	0.12
19-Jan-21	0.12	U	NS	U	0.12	U	0.12	U	NS	0.12	U
15-Apr-21	NS		0.12		NS	NS	0.12	U	0.12	U	0.12
21-Jul-21	2.2		NS	U	1.6	U	1.8	NS	3.5	NS	0.26
20-Oct-21	NS		0.12	U	NS	NS	0.12	U	0.12	U	0.12
9-Feb-22	0.23		NS	U	0.39	U	1.6	NS	0.27	NS	0.68
7-Apr-22	NS		0.12	U	NS	NS	0.12	U	0.12	U	NS
28-Jul-22	2.2		NS	U	6.6	U	2.9	NS	3.1	NS	0.12
18-Oct-22	NS		0.12	U	NS	NS	0.12	U	0.12	U	0.12
24-Jan-23	0.12	U	NS	U	0.12						

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual						
	8-Feb-08	1.56	NS	NS	0.26	NS	NS	NS	9.5	7.91	NS	
	27-Mar-08	NS	4.33	NS	8.48	NS	NS	NS	6.28	15.1		
	25-Apr-08	NS	NS	0.347	NS	NS	32.3	17.9	NS	16.3		
	29-May-08	NS	NS	5.5	NS	NS	10	9.41	4.18	NS		
	27-Jun-08	47.3	NS	NS	38.1	NS	NS	NS	40.8	57.9		
	31-Jul-08	NS	2.46	NS	NS	NS	NS	1.84	NS	2.04		
	28-Aug-08	NS	NS	234	NS	NS	214	229	208	NS		
	30-Sep-08	NS	NS	7.2	NS	NS	3	U	NS	6.8	5.6	
	27-Oct-08	3	U	NS	NS	NS	NS	NS	NS	3	3	U
	25-Nov-08	NS	3	U	NS	NS	3	U	NS	3	3	U
	18-Dec-08	NS	NS	3	U	NS	4.7	NS	NS	10.3	17.1	
	21-Jan-09	NS	NS	NS	U	NS	NS	NS	13.9	NS	27.2	
	25-Feb-09	3	U	NS	NS	NS	NS	NS	3	U	NS	
	26-Mar-09	NS	5.43	*	NS	4.87	NS	NS	20.6	33		
	29-Apr-09	NS	NS	1.2	NS	NS	1.91	NS	4.12	NS	4.25	
	22-Jul-09	0.601	U	NS	24.5	U	0.601	U	NS	0.348	0.613	
	9-Oct-09	NS	3.31	NS	3.44	NS	2.79	25.1	6.95	NS	3.82	
	15-Jan-10	0.12	NS	1.06	0.715	NS	0.823	NS	2	1.98	NS	
	21-Apr-10	NS	0.12	U	NS	0.601	U	0.601	U	3.27	NS	2.84
	16-Jul-10	1.78	NS	2.3	2.86	NS	1.36	NS	1.63	5.05	NS	
	15-Oct-10	NS	0.685	NS	1.75	NS	1.37	1.48	1.8	NS	2.47	
	26-Jan-11	1.2	U	0.12	U	NS	0.601	U	0.601	U	0.601	U
	28-Feb-11	NS	NS	1.2	U	NS	NS	NS	NS	NS	NS	
	27-Apr-11	NS	0.985	NS	1.08	NS	0.967	1.14	1.07	NS	1.24	
	26-Jul-11	5.45	NS	5.21	0.715	NS	5.26	NS	5.54	4.69	NS	
	28-Oct-11	NS	3	U	NS	3	U	3	U	3	3	U
	23-Jan-12	0.6	U	NS	0.6	U	0.6	U	NS	0.6	0.66	NS
	13-Apr-12	NS	0.6	U	NS	0.6	U	0.6	U	0.6	0.6	U
2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	3	U	NS
	23-Jun-12	0.6	U	NS	0.6	U	0.6	U	NS	0.6	0.6	U
	1-Nov-12	NS	0.12	U	NS	0.12	U	0.12	U	0.12	U	0.12
	1-Feb-13	0.12	U	NS	0.12	U	0.12	U	NS	0.12	U	NS
	29-Apr-13	NS	0.3	U	NS	0.12	U	0.12	U	0.12	U	0.12
	9-Jul-13	0.18	U	NS	0.14	0.16	NS	0.18	NS	0.18	0.22	NS
	18-Oct-13	NS	0.12	U	NS	0.12	U	0.12	U	0.12	NS	0.12
	9-Jan-14	0.12	U	NS	0.12	U	0.12	U	NS	0.14	0.12	U
	24-Apr-14	NS	0.12	U	NS	0.18	U	NS	0.12	U	0.12	U
	1-Aug-14	0.12	U	NS	0.18	U	NS	NS	NS	0.12	U	NS
	27-Aug-14	NS	NS	NS	NS	NS	0.12	U	NS	NS	NS	
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	0.18	U	NS	NS	U
	22-Oct-14	NS	0.18	U	NS	0.18	U	0.18	U	0.18	U	0.24
	20-Jan-15	0.12	U	NS	0.120	U	0.12	U	NS	0.18	0.13	NS
30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.14	U	NS
	22-Apr-15	NS	0.12	U	NS	0.12	U	0.12	U	0.17	U	0.14
	21-Jul-15	0.3	U	NS	1	U	6	U	NS	0.3	0.3	U
23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-15	NS	0.3	U	NS	0.3	U	0.5	U	0.3	U	0.3
4-Dec-15 resample	NS	0.3	U	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.12	U	NS	0.12	U	0.12	U	NS	0.12	0.13	NS
	20-Apr-16	NS	0.12	U	NS	0.52	NS	0.12	U	0.12	0.12	U
	20-Jul-16	0.60	U	NS	0.60	U	0.60	U	NS	0.60	0.60	U
	21-Oct-16	NS	0.12	U	NS	0.12	U	0.12	U	0.12	0.12	U
	31-Jan-17	0.12	U	NS	0.12	U	0.12	U	NS	0.12	0.12	U
	17-Apr-17	NS	0.18	U	NS	0.18	U	0.18	U	0.18	0.18	U
	26-Jul-17	0.12	U	NS	1.8	0.12	U	0.12	U	0.12	0.12	U
	12-Oct-17	NS	0.12	U	NS	0.12	U	0.36	U	0.37	0.34	U
	10-Jan-18	0.12	U	NS	0.12	U	0.12	U	NS	0.12	0.12	U
	11-Apr-18	NS	0.12	U	NS	1.2	U	1.2	U	0.12	0.12	U
	23-May-18	NS	NS	0.18	0.18	NS						
	27-Jul-18	0.60	U	NS	0.60	U	0.60	U	NS	0.60	0.60	U
	24-Oct-18	NS	0.6	U	NS	0.6	U	0.6	U	0.60	0.6	U
	16-Jan-19	0.12	U	NS	0.12	U	0.12	U	NS	0.12	0.12	U
	12-Apr-19	NS	0.12	U	NS	0.12	U	0.15	U	0.18	0.18	U
	29-Jul-19	0.18	U	NS	0.18	U	0.12	U	NS	0.12	2.2	NS
	26-Sep-19	NS	NS	NS	0.18	NS						
	29-Oct-19	NS	0.12	U	NS	0.29	NS	0.12	U	0.12	0.6 ^v	U
	21-Jan-20	0.12	U	NS	0.12	U	0.12	U	NS	0.12	0.12	U
	22-Apr-20	NS	0.12	U	NS	0.12	U	0.12	U	0.12	0.12	NS
	23-Jul-20	0.12	U	NS	0.12	U	0.24	U	NS	0.24	0.24	U
	29-Oct-20	NS	0.12	U	NS	0.12	U	0.12	U	0.12	0.12	NS
	19-Jan-21	0.12	U	NS	0.12	U	0.12	U	NS	0.12	0.18 ^f	U
	15-Apr-21	NS	0.12	U	NS	0.12	U	0.12</				

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
Dichlorodifluoromethane	8-Feb-08	2	NS	NS	NS	2.03	NS	NS	1.92	2	NS	
	27-Mar-08	NS	2.29	NS	NS	2.15	NS	NS	2.72	4.14		
	25-Apr-08	NS	NS	2.01	NS	NS	2.11	NS	2.04	2.16		
	29-May-08	NS	NS	NS	1.63	NS	NS	1.62	1.66	NS		
	27-Jun-08	2.03	NS	NS	NS	2.52	NS	NS	NS	2.27	2.48	
	31-Jul-08	NS	1.9	NS	NS	NS	NS	NS	1.81	NS	1.87	
	28-Aug-08	NS	NS	3.13	NS	NS	2.8	NS	2.75	2.88	NS	
	30-Sep-08	NS	NS	NS	2.5	U	NS	NS	2.5	2.5	U	2.7
	27-Oct-08	2.5	U	NS	NS	2.5	U	NS	2.5	NS	2.5	U
	25-Nov-08	NS	215	NS	NS	11.7	NS	NS	2.5	U	5.1	NS
	18-Dec-08	NS	NS	25	NS	NS	2.5	U	NS	2.5	U	2.5
	21-Jan-09	NS	NS	NS	2.5	U	NS	NS	5.8	2.5	U	2.5
	25-Feb-09	2.5	U	NS	NS	19.4	NS	NS	2.5	U	3.4	NS
	26-Mar-09	NS	2.55	NS	NS	2.48	NS	NS	NS	2.46	2.41	
	29-Apr-09	NS	NS	2.41	NS	NS	3.78	NS	2.26	NS	2.4	
	22-Jul-09	2.42	NS	NS	2.42	2.72	NS	NS	NS	2.37	2.48	NS
	9-Oct-09	NS	2.73	NS	NS	2.77	NS	3.67	51.6	U	2.64	2.79
	15-Jan-10	2.5	NS	3.57	2.52	NS	2.61	NS	2.29	2.25	NS	
	21-Apr-10	NS	0.568	NS	NS	2.2	NS	2.59	2.2	2.64	NS	2.43
	16-Jul-10	3.36	NS	2.61	2.55	NS	2.98	NS	NS	3.15	3.29	NS
	15-Oct-10	NS	3.13	NS	NS	2.67	NS	2.43	2.41	2.46	NS	2.43
	26-Jan-11	2.47	U	2.2	NS	2.64	NS	1.98	NS	2.57	3.31	NS
	28-Feb-11	NS	NS	2.47	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	2.18	NS	NS	2.27	NS	2.26	2.5	2.32	NS	2.31
	26-Jul-11	2.41	NS	2.29	2.28	NS	2.08	NS	NS	2.44	2.3	NS
	28-Oct-11	NS	2.7	NS	NS	2.7	NS	2.7	2.7	2.9	NS	3.1
	23-Jan-12	2.5	NS	2.6	2.6	NS	2.7	NS	NS	2.6	2.6	NS
	13-Apr-12	NS	2.5	NS	NS	2.9	NS	2.4	3.2	2.5	NS	2.8
	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	2.8	NS
	23-Jun-12	2.6	NS	2.3	2.5	NS	2.3	NS	NS	2.3	2.3	NS
	1-Nov-12	NS	1.8	NS	NS	1.8	NS	2	1.9	2	NS	1.9
	1-Feb-13	1.4	NS	1.4	1.5	NS	1.6	NS	NS	1.6	1.6	NS
	29-Apr-13	NS	2.6	NS	NS	2.3	NS	2.2	2.2	2.3	NS	2.3
	9-Jul-13	1	NS	1.1	0.99	NS	1.1	NS	NS	1.0	1.1	NS
	18-Oct-13	NS	2.0	NS	NS	1.9	NS	1.9	2.2	2.0	NS	2.1
	9-Jan-14	1.5	NS	1.2	1.3	NS	1.4	NS	NS	1.5	1.5	NS
	24-Apr-14	NS	2.7	NS	NS	2.6	NS	2.3	2.6	2.7	2.6	3.1
	1-Aug-14	1.1	NS	2.2/1.5	2.3/1.6	NS	NS	NS	NS	1.6	2.2/1.6	NS
	27-Aug-14	NS	NS	NS	NS	NS	2.9/3.3	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	NS	2.3	NS	NS	U
	22-Oct-14	NS	1.3	NS	NS	1.4	1.4	1.4	1.6	1.4	1.4	NS
	20-Jan-15	0.099	U	NS	1.5	1.4	NS	1.4	NS	1.4	1.5	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	1.4	NS
	22-Apr-15	NS	4.0 ^v	NS	NS	4.1 ^v	NS	1.8	1.7/2.0	1.8	NS	2.0
	21-Jul-15	0.88	NS	1.6	5	U	NS	0.91	NS	0.74 ^v	0.72 ^v	NS
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	0.93	NS	NS	NS
	29-Oct-15	NS	1	NS	NS	0.89	NS	0.88	0.89	0.83	NS	0.84
	4-Dec-15 resample	NS	0.91	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	2 ^m	NS	2 ^m	2.1 ^m	NS	2.1 ^m	NS	NS	2.2 ^m	2.1 ^m	NS
	20-Apr-16	NS	1.5	NS	NS	1.6	NS	1.5	1.7	1.6	NS	1.7
	20-Jul-16	1.4	NS	1.6	1.6	NS	1.6	NS	NS	1.5	1.5	NS
	21-Oct-16	NS	0.55	NS	NS	0.55	NS	0.58	0.56	0.51	NS	0.51
	31-Jan-17	0.75	NS	0.79	0.8	NS	0.75	NS	NS	0.78	0.86	NS
	17-Apr-17	NS	0.84	NS	NS	0.89	NS	0.91	0.96	0.86	NS	0.93
	26-Jul-17	1.8	NS	1.8	1.8	NS	1.7	NS	NS	1.8	1.8	NS
	12-Oct-17	NS	0.82	NS	NS	0.73	NS	1.3	1.2	1.4	NS	1.2
	10-Jan-18	0.66	NS	0.67	0.65	NS	0.63	NS	NS	0.63	NS	0.63
	11-Apr-18	NS	1.2	NS	NS	2.8	NS	2.7	2.7	1.1	NS	2.7
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	1.6	NS	NS
	27-Jul-18	1.6	NS	1.7	1.6	NS	1.5	NS	NS	1.4	1.6	NS
	24-Oct-18	NS	1.7	NS	NS	1.2	NS	1.1	1.1	1.3	NS	1.2
	16-Jan-19	0.75	NS	0.78	0.75	NS	0.8	NS	NS	0.79	0.99	NS
	12-Apr-19	NS	0.84 ^v	NS	NS	0.83 ^{L,v}	NS	0.86 ^{L,v}	0.79	0.8	NS	1.1
	29-Jul-19	0.15	U	0.15	0.099	U	0.099	U	NS	0.099	U	0.099
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	1.5	NS
	29-Oct-19	NS	1.5	NS	NS	1.8	NS	1.6	1.5	2.6 ^v	3.4 ^v	2.8 ^v
	21-Jan-20	2.40	NS	2.40	0.10	U	NS	2.60	NS	0.73	U	2.50
	22-Apr-20	NS	1.2	NS	NS	1.1	NS	1.1	1.1	1.1	NS	1.3
	23-Jul-20	0.099	U	NS	1.1	0.099	U	0.2	U	NS	2.6	0.2
	29-Oct-20	NS	0.099	U	NS	0.099	U	NS	0.099	U	0.099	0.099
	19-Jan-21	0.91	NS	0.99	0.099	U	0.96	NS	NS	0.099	U	1.1 ^t
	15-Apr-21	NS	0.099	U	NS	0.						

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.08	U	NS	NS	NS	NS	NS	0.08	U	0.08	U
	27-Mar-08	NS		0.081	U	NS	NS	NS	0.081	U	0.081	U
	25-Apr-08	NS		NS	U	0.081	U	NS	0.081	U	0.081	U
	29-May-08	NS		NS	U	0.08	U	NS	NS	U	0.08	U
	27-Jun-08	0.126	U	NS	NS	NS	U	NS	0.081	U	0.081	U
	31-Jul-08	NS		0.081	U	NS	NS	NS	NS	U	NS	U
	28-Aug-08	NS		NS	U	0.081	U	NS	NS	U	0.081	U
	27-Oct-08	NS		NS	U	2	U	NS	NS	U	2	U
	27-Oct-08	2	U	NS	U	NS	U	NS	2	U	NS	2
	25-Nov-08	NS		2	U	NS	U	NS	2	U	2	U
	18-Dec-08	NS		NS	U	2	U	NS	NS	U	2	U
	21-Jan-09	NS		NS	U	2	U	NS	NS	U	2	U
	25-Feb-09	2	U	NS	U	NS	U	NS	NS	U	2	U
	26-Mar-09	NS		0.404	U	NS	U	NS	0.809	U	NS	0.081
	29-Apr-09	NS		NS	U	0.19	U	NS	0.081	U	0.121	U
	22-Jul-09	0.404	U	NS	U	16.5	U	NS	0.404	U	0.081	U
	9-Oct-09	NS		0.081	U	NS	U	NS	0.081	U	16.9	U
	15-Jan-10	0.137	U	NS	U	0.081	U	NS	0.081	U	0.081	U
	21-Apr-10	NS		0.081	U	NS	U	NS	0.404	U	0.081	U
	16-Jul-10	0.081	U	NS	U	2.48	U	NS	0.611	U	0.081	U
	15-Oct-10	NS		0.081	U	NS	U	NS	0.081	U	,081	U
	26-Jan-11	0.809	U	0.081	U	NS	U	NS	7.37	U	0.404	U
	28-Feb-11	NS		NS	U	0.809	U	NS	NS	U	0.404	U
	27-Apr-11	NS		0.081	U	NS	U	NS	0.081	U	0.081	U
	26-Jul-11	0.27	U	NS	U	0.27	U	NS	0.405	U	NS	0.405
	28-Oct-11	NS		2	U	NS	U	NS	2	U	2	U
	23-Jan-12	0.4	U	NS	U	0.4	U	NS	0.4	U	0.4	U
	13-Apr-12	NS		0.2	U	NS	U	NS	0.2	U	0.2	U
2-Jul-12 (resample)	NS		NS	U	NS	NS	U	NS	NS	U	1	U
	23-Jun-12	0.4	U	NS	U	0.4	U	NS	0.4	U	0.4	U
	1-Nov-12	NS		0.04	U	NS	U	NS	0.04	U	0.040	U
	1-Feb-13	0.04	U	NS	U	0.04	U	NS	0.04	U	0.040	U
	29-Apr-13	NS		0.2	U	NS	U	NS	0.081	U	0.081	U
	9-Jul-13	0.061	U	NS	U	0.040	U	NS	0.040	U	0.040	U
	18-Oct-13	NS		0.081	U	NS	U	NS	0.081	U	0.081	U
	9-Jan-14	0.081	U	NS	U	0.081	U	NS	0.081	U	0.081	U
	24-Apr-14	NS		0.04	U	NS	U	NS	0.04	U	0.040	U
	1-Aug-14	0.081	U	NS	U	0.280	U	NS	0.120	U	0.081	U
	27-Aug-14	NS		NS	U	NS	U	NS	0.040	U	NS	NS
	12-Sept-14 (resample)	NS		NS	U	NS	U	NS	0.061	U	0.061	U
	22-Oct-14	NS		0.061	U	NS	U	NS	0.061	U	0.061	U
	20-Jan-15	0.04	U	NS	U	0.040	U	NS	0.040	U	0.061	U
	30-Mar-15 (resample)	NS		NS	U	NS	U	NS	0.041 ^v	U	NS	0.046
	22-Apr-15	NS		0.041 ^v	U	NS	U	NS	0.04 ^v	U	0.040	U
	21-Jul-15	0.2	U	NS	U	0.8	U	NS	4	U	0.200 ^v	U
1,1-Dichloroethane	23-Sep-15 resample	NS		NS	U	NS	U	NS	0.2	U	NS	NS
	29-Oct-15	NS		0.2	U	NS	U	NS	0.2	U	0.2	U
	4-Dec-15 resample	NS		0.2	U	NS	U	NS	0.2	U	NS	NS
	27-Jan-16	0.04	U	NS	U	0.044	U	NS	0.04	U	0.04	U
	20-Apr-16	NS		0.040	U	NS	U	NS	0.040	U	0.040	U
	20-Jul-16	0.20	U	NS	U	0.37	U	NS	0.20	U	0.20	U
	21-Oct-16	NS		0.04	U	NS	U	NS	0.04	U	0.04	U
	31-Jan-17	0.04	U	NS	U	0.04	U	NS	0.04	U	0.04	U
	17-Apr-17	NS		0.061	U	NS	U	NS	0.061	U	0.061	U
	26-Jul-17	0.04	U	NS	U	0.2	U	NS	0.04	U	0.04	U
1,1-Dichloroethane	12-Oct-17	NS		0.04	U	NS	U	NS	0.04	U	0.1	U
	10-Jan-18	0.04	U	NS	U	0.04	U	NS	0.04	U	0.04	U
	11-Apr-18	NS		0.081	U	NS	U	NS	0.81	U	0.81	U
	23-May-18	NS		NS	U	NS	U	NS	NS	U	0.061	U
	27-Jul-18	0.20	U	NS	U	0.20	U	NS	0.20	U	0.20	U
	24-Oct-18	NS		0.2	U	NS	U	NS	0.2	U	0.20	U
	16-Jan-19	0.04	U	NS	U	0.04	U	NS	0.04	U	0.04	U
	12-Apr-19	NS		0.04	U	NS	U	NS	0.04	U	0.061	U
	29-Jul-19	0.061	U	NS	U	0.24	U	NS	0.04	U	0.04	U
	26-Sep-19	NS		NS	U	NS	U	NS	0.13	U	1.1	U
	29-Oct-19	NS		0.04	U	NS	U	NS	0.04	U	0.061	U
	21-Jan-20	0.04	U	NS	U	0.04	U	NS	0.04	U	0.2 ^v	U
	22-Apr-20	NS		0.04	U	NS	U	NS	0.04	U	0.04	U
	23-Jul-20	0.04	U	NS	U	0.04	U	NS	0.081	U	0.081	U
	29-Oct-20	NS		0.04	U	NS	U	NS	0.04	U	0.04	U
	19-Jan-21	0.04	U	NS	U	0.04	U	NS	0.04	U	0.04	U
	15-Apr-21	NS		0.04	U	NS	U	NS	0.04	U	0.04	U
	21-Jul-21	0.04	U	NS	U	0.11	U	NS	0.04			

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.08	U	NS	NS	NS	NS	NS	0.09	0.08	U	NS
	27-Mar-08	NS		0.081	U	NS	NS	0.143	NS	0.081	U	0.1
	25-Apr-08	NS		NS	U	NS	NS	0.081	NS	NS	U	0.089
	29-May-08	NS		NS		0.09	NS	NS	0.11	0.08	U	NS
	27-Jun-08	0.126	U	NS	NS	NS	0.153	NS	NS	NS	U	0.081
	31-Jul-08	NS		0.081	U	NS	NS	NS	NS	0.081	U	0.081
	28-Aug-08	NS		NS	U	0.171	NS	NS	NS	0.081	U	NS
	27-Oct-08	NS		NS		0.08	U	NS	NS	0.08	U	0.08
	27-Oct-08	0.08	U	NS	NS	NS	0.08	U	NS	0.08	U	0.095
	25-Nov-08	NS		0.08	U	NS	NS	0.08	NS	0.08	U	NS
	18-Dec-08	NS		NS	U	0.08	NS	NS	0.08	NS	U	0.08
	21-Jan-09	NS		NS		0.08	U	NS	NS	0.08	U	0.08
	25-Feb-09	0.08	U	NS		NS	0.08	U	NS	0.08	U	NS
	26-Mar-09	NS		0.404	U	NS	NS	0.809	U	NS	U	0.133
	29-Apr-09	NS		NS	U	0.319	NS	NS	0.081	U	NS	0.089
	22-Jul-09	0.404	U	NS	U	16.5	U	0.404	U	NS	U	NS
	9-Oct-09	NS		0.081	U	NS	0.081	U	NS	0.081	U	0.081
	15-Jan-10	0.081	U	NS	U	0.081	U	0.081	U	NS	U	NS
	21-Apr-10	NS		0.081	U	NS	0.404	U	NS	0.404	U	0.081
	16-Jul-10	0.101		NS		1.44	U	0.611	U	NS	U	NS
	15-Oct-10	NS		0.081	U	NS	0.081	U	NS	0.081	U	0.081
	26-Jan-11	0.809	U	0.081	U	NS	0.081	U	0.404	U	0.404	U
	28-Feb-11	NS		NS	U	0.809	U	NS	NS	NS	U	NS
	27-Apr-11	NS		0.081	U	NS	0.081	U	NS	0.081	U	0.081
	26-Jul-11	0.27	U	NS	U	0.27	U	0.405	U	NS	U	0.405
	28-Oct-11	NS		2	U	NS	2	U	2	U	2	U
	23-Jan-12	0.2	U	NS	U	0.2	U	NS	0.2	U	0.2	U
	13-Apr-12	NS		0.2	U	NS	0.2	U	NS	0.2	U	0.2
2-Jul-12 (resample)	NS		NS		NS	NS	NS	NS	NS	NS	U	NS
	23-Jun-12	0.4	U	NS	U	0.4	U	0.4	U	NS	U	0.4
	1-Nov-12	NS		0.04	U	NS	0.04	U	0.04	U	0.04	U
	1-Feb-13	0.053		NS		0.062		NS	0.05	NS	U	0.049
	29-Apr-13	NS		0.19		NS	0.06	NS	0.04	U	0.079	U
	9-Jul-13	0.12	U	NS	U	0.081	U	0.081	U	NS	U	0.081
	18-Oct-13	NS		0.081	U	NS	0.081	U	0.081	U	NS	U
	9-Jan-14	0.081	U	NS	U	0.040	U	0.040	U	NS	U	0.040
	24-Apr-14	NS		0.04	U	NS	0.170	U	NS	0.04	U	0.073
	1-Aug-14	0.040	U	NS		0.061	U	NS	NS	0.04	U	NS
	27-Aug-14	NS		NS		NS	0.040	U	NS	NS	U	NS
	12-Sept-14 (resample)	NS		NS	U	0.061	U	0.061	U	0.061	U	0.061
	22-Oct-14			NS	U	0.040	U	0.040	U	0.061	U	0.081
	20-Jan-15	0.040	U	NS	U	0.040	U	0.040	U	NS	U	0.100
	30-Mar-15 (resample)	NS		NS		NS	NS	NS	NS	NS	U	0.046
	22-Apr-15	NS		0.17 ^v		NS	0.087 ^v	NS	0.04	U	0.040	U
	21-Jul-15	0.140 ^v		NS	U	0.8	4	U	NS	0.2	U	0.200 ^v
1,2-Dichloroethane	23-Sep-15 resample	NS		NS		NS	NS	NS	NS	NS	U	0.86 ^v
	29-Oct-15	NS		0.2	U	NS	0.2	U	0.3	U	0.2	U
	4-Dec-15 resample	NS		0.2	U	NS	NS	NS	NS	NS	U	NS
	27-Jan-16	0.04	U	NS		0.057	0.042	NS	0.049	NS	0.065	0.05
	20-Apr-16	NS		0.053		NS	0.040	U	0.040	U	0.058	0.060
	20-Jul-16	0.20	U	NS		0.20	U	0.28	NS	0.21	U	0.20
	21-Oct-16	NS		0.086		NS	0.04	U	0.04	U	0.04	U
	31-Jan-17	0.04	U	NS		0.078	0.04	U	0.04	U	0.04	U
	17-Apr-17	NS		0.061	U	NS	0.061	U	0.061	U	0.061	U
	26-Jul-17	0.04	U	NS	U	0.04	U	0.04	U	NS	U	0.061
1,1,1-Trichloroethane	12-Oct-17	NS		0.04	U	NS	0.04	U	0.12	U	0.23	U
	10-Jan-18	0.04	U	NS	U	0.04	U	0.04	U	0.11	U	0.1
	11-Apr-18	NS		0.081	U	NS	0.81 ^v	U	NS	0.04	U	0.04
	23-May-18	NS		NS		NS	NS	NS	NS	NS	U	0.81 ^v
	27-Jul-18	0.20	U	NS		0.20	U	0.20	U	0.20	U	NS
	24-Oct-18	NS		0.2	U	NS	0.2	U	0.2	U	0.20	U
	16-Jan-19	0.04	U	NS	U	0.04	U	0.04	U	NS	U	0.04
	12-Apr-19	NS		0.04	U	NS	0.04	U	0.051	U	0.061	U
	29-Jul-19	0.061	U	NS	U	0.061	U	0.04	U	0.061	U	0.061
	26-Sep-19	NS		NS		NS	NS	NS	NS	NS	U	NS
	29-Oct-19	NS		0.04	U	NS	0.04	U	0.04	U	0.04	U
	21-Jan-20	0.04	U	NS	U	0.04	U	0.05	NS	0.04	U	0.04
	22-Apr-20	NS		0.04	U	NS	0.04	U	0.04	U	0.04	U
	23-Jul-20	0.04	U	NS	U	0.04	U	0.081	U	NS	U	0.081
	29-Oct-20	NS		0.04	U	NS	0.04	U	0.04	U	0.04	U
1,1,2,2-Tetrachloroethane	19-Jan-21	0.04	U	NS</								

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.08	U	NS	NS	NS	NS	NS	0.08	U	0.08	U
	27-Mar-08	NS	0.079	U	NS	NS	NS	NS	0.079	U	0.079	U
	25-Apr-08	NS	NS	0.079	U	NS	NS	NS	0.079	U	0.079	U
	29-May-08	NS	NS	NS	U	0.08	U	NS	NS	0.08	U	NS
	27-Jun-08	0.123	U	NS	NS	NS	0.079	U	NS	NS	0.079	U
	31-Jul-08	NS	0.079	U	NS	NS	NS	NS	NS	0.079	U	0.079
	28-Aug-08	NS	NS	0.079	U	NS	NS	NS	0.079	U	0.079	NS
	30-Sep-08	NS	NS	NS	U	2	U	NS	NS	2	U	2
	27-Oct-08	2	U	NS	NS	NS	2	U	NS	2	U	2
	25-Nov-08	NS	2	U	NS	NS	2	U	NS	2	U	NS
	18-Dec-08	NS	NS	2	U	NS	NS	NS	2	U	2	U
	21-Jan-09	NS	NS	NS	U	2	U	NS	NS	2	U	2
	25-Feb-09	2	U	NS	NS	NS	2	U	NS	2	U	NS
	26-Mar-09	NS	0.396	U	NS	NS	0.792	U	NS	NS	0.079	U
	29-Apr-09	NS	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U
	22-Jul-09	0.396	U	NS	16.2	U	0.792	U	NS	0.079	U	0.079
	9-Oct-09	NS	0.079	U	NS	0.079	U	NS	0.079	U	16.5	U
	15-Jan-10	0.137	U	NS	0.079	U	0.079	U	NS	0.079	U	0.079
	21-Apr-10	NS	0.079	U	NS	NS	0.396	U	NS	0.396	U	0.079
	16-Jul-10	0.079	U	NS	0.206	U	0.079	U	NS	0.598	U	0.079
	15-Oct-10	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	26-Jan-11	0.792	U	0.079	U	NS	0.079	U	0.396	U	3.96	U
	28-Feb-11	NS	NS	0.792	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	26-Jul-11	0.264	U	NS	0.264	U	0.079	U	0.396	U	0.396	U
	28-Oct-11	NS	2	U	NS	NS	2	U	NS	2	U	2
	23-Jan-12	0.4	U	NS	0.4	U	0.4	U	NS	0.4	U	0.4
	13-Apr-12	NS	0.2	U	NS	0.2	U	NS	0.2	U	0.2	U
2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.99	U
	23-Jun-12	0.4	U	NS	0.4	U	0.4	U	NS	0.4	U	0.4
	1-Nov-12	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	1-Feb-13	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	29-Apr-13	NS	0.099	U	NS	NS	0.04	U	NS	0.04	U	0.04
	9-Jul-13	0.059	U	NS	0.040	U	0.040	U	NS	0.040	U	0.040
	18-Oct-13	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	9-Jan-14	0.079	U	NS	0.081	U	0.079	U	0.079	U	0.079	U
	24-Apr-14	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.040
	1-Aug-14	0.079	U	NS	0.120	U	0.420	U	NS	0.079	U	0.079
	27-Aug-14	NS	NS	NS	NS	NS	0.040	U	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	0.059	U	0.059	U	0.059	U
	22-Oct-14	NS	0.059	U	NS	NS	0.059	U	0.059	U	0.059	U
	20-Jan-15	0.04	U	NS	0.040	U	0.040	U	NS	0.059	U	0.040
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	0.040	U	NS	NS	NS	NS
	22-Apr-15	NS	0.041 ^v	U	NS	NS	0.040 ^v	U	NS	0.040	U	0.046
	21-Jul-15	0.2	U	NS	0.8	U	4	U	NS	0.2	U	0.200 ^v
1,1-Dichloroethene	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-15	NS	0.2	U	NS	NS	0.2	U	NS	0.2	U	0.46
	4-Dec-15 resample	NS	0.2	U	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.040
	20-Apr-16	NS	0.040	U	NS	NS	0.040	U	NS	0.040	U	0.040
	20-Jul-16	0.20	U	NS	0.21	U	0.20	U	0.24	NS	0.21	NS
	21-Oct-16	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.63
	31-Jan-17	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	17-Apr-17	NS	0.059	U	NS	NS	0.059	U	NS	0.059	U	0.059
	26-Jul-17	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
1,1-Dichloroethene	12-Oct-17	NS	0.04	U	NS	NS	0.04	U	NS	0.099	U	0.099
	10-Jan-18	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	11-Apr-18	NS	0.079	U	NS	NS	0.79	U	NS	0.79	U	0.79
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	U	NS
	27-Jul-18	0.20	U	NS	0.20	U	0.20	U	NS	0.20	U	NS
	24-Oct-18	NS	0.2	U	NS	NS	0.2	U	NS	0.2	U	0.2
	16-Jan-19	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
	12-Apr-19	NS	0.04	U	NS	NS	0.04	U	NS	0.059	U	0.059
	29-Jul-19	0.059	U	NS	0.059	U	0.04	U	NS	0.04	U	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	U	NS
	29-Oct-19	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.2 ^v
	21-Jan-20	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.2 ^v
	22-Apr-20	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	23-Jul-20	0.04	U	NS	0.04	U	0.04	U	NS	0.079	U	NS
	29-Oct-20	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	19-Jan-21	0.04	U	NS	0.04							

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
cis-1,2-Dichloroethene*	8-Feb-08	0.08	U	NS	NS	NS	NS	NS	0.08	U	0.08	U
	27-Mar-08	NS	0.079	U	NS	NS	NS	NS	0.079	U	0.079	U
	25-Apr-08	NS	NS	0.079	U	NS	NS	NS	0.079	U	0.079	U
	29-May-08	NS	NS	NS	U	0.08	NS	NS	NS	U	0.08	U
	27-Jun-08	0.123	U	NS	NS	NS	0.079	U	NS	NS	0.079	U
	31-Jul-08	NS	0.079	U	NS	NS	NS	NS	NS	U	0.079	U
	28-Aug-08	NS	NS	0.079	U	NS	NS	NS	0.079	U	0.079	U
	30-Sep-08	NS	NS	NS	U	5.9	NS	NS	NS	U	5.9	U
	27-Oct-08	2	U	NS	NS	NS	2	U	NS	2	NS	2
	25-Nov-08	NS	2	U	NS	NS	NS	U	2	U	2	U
	18-Dec-08	NS	NS	2	U	NS	NS	U	2	U	2	U
	21-Jan-09	NS	NS	NS	U	2	NS	NS	NS	U	2	U
	25-Feb-09	2	U	NS	NS	NS	2	U	NS	2	U	NS
	26-Mar-09	NS	0.396	U	NS	NS	NS	U	0.792	U	NS	0.079
	29-Apr-09	NS	NS	0.079	U	NS	NS	U	0.079	U	NS	0.079
	22-Jul-09	0.396	U	NS	595	0.792	U	NS	0.396	U	NS	0.079
	9-Oct-09	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	15-Jan-10	0.079	U	NS	0.079	U	0.079	U	NS	0.079	U	NS
	21-Apr-10	NS	0.079	U	NS	NS	0.396	U	NS	0.396	U	0.079
	16-Jul-10	0.079	U	NS	0.079	U	0.079	U	0.598	U	NS	0.079
	15-Oct-10	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	26-Jan-11	0.792	U	0.079	U	NS	0.079	U	0.396	U	0.396	U
	28-Feb-11	NS	NS	0.792	U	NS	NS	U	NS	NS	NS	NS
	27-Apr-11	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	26-Jul-11	0.264	U	NS	0.264	U	0.079	U	0.396	U	0.396	U
	28-Oct-11	NS	2	U	NS	NS	2	U	NS	2	U	2
	23-Jan-12	0.4	U	NS	0.4	U	0.4	U	0.4	U	NS	0.53
	13-Apr-12	NS	0.2	U	NS	NS	0.2	U	NS	0.2	U	0.2
	2-Jul-12 (resample)	NS	NS	NS	U	NS	NS	U	NS	NS	NS	NS
	23-Jun-12	0.4	U	NS	0.4	U	0.4	U	NS	0.4	U	0.4
	1-Nov-12	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	1-Feb-13	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
	29-Apr-13	NS	0.2	U	NS	NS	0.079	U	NS	0.079	U	0.079
	9-Jul-13	0.059	U	NS	0.040	U	0.040	U	0.054	U	NS	0.040
	18-Oct-13	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	9-Jan-14	0.079	U	NS	0.079	U	0.079	U	0.079	U	0.079	U
	24-Apr-14	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.12
	1-Aug-14	0.079	U	NS	0.120	U	0.120	U	NS	NS	U	NS
	27-Aug-14	NS	NS	NS	U	NS	NS	U	0.040	U	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	U	NS	NS	U	NS	0.059	U	NS
	22-Oct-14	NS	0.059	U	NS	NS	0.059	U	0.059	U	0.059	U
	20-Jan-15	0.04	U	NS	0.040	U	0.040	U	0.040	U	0.059	U
	30-Mar-15 (resample)	NS	NS	NS	U	NS	NS	U	NS	NS	NS	NS
	22-Apr-15	NS	0.041 v	U	NS	NS	0.040 v	U	NS	0.04	U	0.046
	21-Jul-15	0.2	U	NS	0.8	U	4	U	NS	0.2	U	1.700 v
	23-Sept-15 resample	NS	NS	NS	U	NS	NS	U	NS	0.2	U	NS
	29-Oct-15	NS	0.2	U	NS	NS	0.27	U	NS	0.31	U	2.7
	4-Dec-15 resample	NS	0.2	U	NS	NS	NS	U	NS	NS	U	NS
	27-Jan-16	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	20-Apr-16	NS	0.040	U	NS	NS	0.040	U	NS	0.040	U	0.040
	20-Jul-16	0.20	U	NS	0.20	U	0.20	U	NS	0.21	U	0.20
	21-Oct-16	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	31-Jan-17	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.07
	17-Apr-17	NS	0.059	U	NS	NS	0.059	U	NS	0.059	U	0.059
	26-Jul-17	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
	12-Oct-17	NS	0.04	U	NS	NS	0.04	U	0.12	U	0.099	U
	10-Jan-18	0.04	U	NS	0.04	U	0.04	U	NS	0.11	U	0.099
	11-Apr-18	NS	0.079	U	NS	NS	0.79	U	NS	0.04	U	0.04
	23-May-18	NS	NS	NS	U	NS	NS	U	NS	NS	U	0.79
	27-Jul-18	0.20	U	NS	0.20	U	0.20	U	NS	0.20	U	NS
	24-Oct-18	NS	0.2	U	NS	NS	0.2	U	NS	0.20	U	0.2
	16-Jan-19	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
	12-Apr-19	NS	0.04	U	NS	NS	0.04	U	NS	0.059	U	0.059
	29-Jul-19	0.059	U	NS	0.059	U	0.071	U	NS	0.062	U	1.1
	26-Sep-19	NS	NS	NS	U	NS	NS	U	NS	0.059	U	NS
	29-Oct-19	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.2 ^v
	21-Jan-20	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.2 ^v
	22-Apr-20	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	23-Jul-20	0.04	U	NS	0.04	U	0.04	U	0.079	U	0.079	U
	29-Oct-20	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	19-Jan-21	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	15-Apr-21	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	21-Jul-21	0.04	U	NS	0.04	U	0.04	U	NS			

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.08	U	NS	NS	NS	NS	NS	0.08	U	0.08	U
	27-Mar-08	NS	0.079	U	NS	NS	NS	NS	0.079	U	0.079	U
	25-Apr-08	NS	NS	0.079	U	NS	NS	NS	0.079	U	0.079	U
	29-May-08	NS	NS	NS	U	0.08	U	NS	NS	0.08	U	NS
	27-Jun-08	0.123	U	NS	NS	NS	0.079	U	NS	NS	0.079	U
	31-Jul-08	NS	0.079	U	NS	NS	NS	NS	NS	0.079	U	0.079
	28-Aug-08	NS	NS	0.079	U	NS	NS	NS	0.079	U	0.079	U
	30-Sep-08	NS	NS	NS	U	2	U	NS	NS	2	U	2
	27-Oct-08	2	U	NS	NS	NS	2	U	NS	2	U	2
	25-Nov-08	NS	2	U	NS	NS	2	U	NS	2	U	NS
	18-Dec-08	NS	NS	2	U	NS	NS	NS	2	U	2	U
	21-Jan-09	NS	NS	NS	U	2	U	NS	NS	2	U	2
	25-Feb-09	2	U	NS	NS	NS	2	U	NS	2	U	NS
	26-Mar-09	NS	0.396	U	NS	NS	0.792	U	NS	NS	0.079	U
	29-Apr-09	NS	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U
	22-Jul-09	0.396	U	NS	0.396	U	0.792	U	NS	0.079	U	NS
	9-Oct-09	NS	0.079	U	NS	0.079	U	NS	0.079	U	16.5	U
	15-Jan-10	0.079	NS	0.079	U	0.079	U	NS	0.079	U	0.079	U
	21-Apr-10	NS	0.079	U	NS	NS	0.396	U	NS	0.396	U	0.079
	16-Jul-10	0.079	U	NS	0.079	U	0.079	U	NS	0.079	U	NS
	15-Oct-10	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	26-Jan-11	0.792	U	0.079	U	NS	0.36	U	NS	0.396	U	NS
	28-Feb-11	NS	NS	0.792	U	NS	NS	U	NS	NS	NS	NS
	27-Apr-11	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	26-Jul-11	0.264	U	NS	0.264	U	0.079	U	NS	0.396	U	NS
	28-Oct-11	NS	2	U	NS	NS	2	U	NS	2	U	2
	23-Jan-12	0.4	U	NS	0.4	U	0.4	U	NS	0.4	U	0.4
	13-Apr-12	NS	0.2	U	NS	0.2	U	NS	0.2	U	0.2	U
2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.99	U
	23-Jun-12	0.4	U	NS	0.4	U	0.4	U	NS	0.4	U	0.4
	1-Nov-12	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	1-Feb-13	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	29-Apr-13	NS	0.099	U	NS	NS	0.04	U	NS	0.04	U	0.04
	9-Jul-13	0.059	U	NS	0.040	U	0.040	U	NS	0.040	U	0.040
	18-Oct-13	NS	0.079	U	NS	NS	0.079	U	NS	0.079	U	0.079
	9-Jan-14	0.079	U	NS	0.079	U	0.079	U	NS	0.079	U	NS
	24-Apr-14	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.12
	1-Aug-14	0.079	U	NS	0.120	U	0.120	U	NS	0.079	U	NS
	27-Aug-14	NS	NS	NS	NS	NS	0.040	U	NS	NS	NS	NS
trans-1,2-Dichloroethene*	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	0.059	U	NS
	22-Oct-14	NS	0.059	U	NS	NS	0.059	U	NS	0.059	U	0.079
	20-Jan-15	0.04	U	NS	0.040	U	0.040	U	NS	0.040	U	0.040
30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	22-Apr-15	NS	0.041 ^v	U	NS	NS	0.040 ^v	U	NS	0.040	U	0.046
	21-Jul-15	0.2	U	NS	0.8	U	4	U	NS	0.2	U	2.000 ^v
23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-15	NS	0.2	U	NS	NS	0.2	U	NS	0.2	U	0.2
4-Dec-15 resample	NS	0.2	U	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.040
	20-Apr-16	NS	0.040	U	NS	NS	0.040	U	NS	0.040	U	0.040
	20-Jul-16	0.20	U	NS	0.20	U	0.20	U	NS	0.20	U	0.2
	21-Oct-16	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	31-Jan-17	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.14
	17-Apr-17	NS	0.071	U	NS	NS	0.079	U	NS	0.059	U	0.059
	26-Jul-17	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
	12-Oct-17	NS	0.04	U	NS	NS	0.04	U	NS	0.099	U	0.099
	10-Jan-18	0.04	U	NS	0.04	U	0.04	U	NS	0.11	U	0.04
	11-Apr-18	NS	0.079	U	NS	NS	0.79	U	NS	0.04	U	0.79
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	U	NS
	27-Jul-18	0.20	U	NS	0.20	U	0.20	U	NS	0.20	U	NS
	24-Oct-18	NS	0.2	U	NS	NS	0.2	U	NS	0.2	U	0.2
	16-Jan-19	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	12-Apr-19	NS	0.04	U	NS	NS	0.04	U	NS	0.059	U	0.059
	29-Jul-19	0.059	U	NS	0.059	U	0.04	U	NS	0.04	U	1
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	U	NS
	29-Oct-19	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.2 ^v
	21-Jan-20	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.2 ^v
	22-Apr-20	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	23-Jul-20	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	NS
	29-Oct-20	NS	0.04	U	NS	NS	0.04	U	NS	0.04	U	0.04
	19-Jan-21	0.04	U	NS	0.04	U	0.04	U	NS	0.04	U	0.04
	15-Apr-2											

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.09	U	NS	NS	NS	NS	NS	0.09	U	0.09	U
	27-Mar-08	NS		0.092	U	NS	NS	NS	0.092	U	0.092	U
	25-Apr-08	NS		NS	U	NS	NS	NS	0.092	U	0.092	U
	29-May-08	NS		NS	U	NS	0.09	U	NS	0.09	U	NS
	27-Jun-08	0.144	U	NS	NS	NS	0.092	U	NS	NS	0.092	U
	31-Jul-08	NS		0.092	U	NS	NS	NS	NS	NS	NS	0.092
	28-Aug-08	NS		NS	U	NS	NS	NS	0.092	U	0.092	U
	30-Sep-08	NS		NS	U	NS	0.09	U	NS	NS	0.09	U
	27-Oct-08	0.09	U	NS	NS	NS	0.09	U	NS	0.09	U	0.09
	25-Nov-08	NS		0.09	U	NS	NS	0.09	U	NS	0.09	U
	18-Dec-08	NS		NS	U	0.09	U	NS	NS	0.09	U	0.09
	21-Jan-09	NS		NS	U	NS	0.09	U	NS	0.09	U	0.09
	25-Feb-09	0.09	U	NS		NS	0.09	U	NS	0.09	U	NS
	26-Mar-09	NS		0.462	U	NS	NS	0.924	U	NS	0.092	U
	29-Apr-09	NS		NS	U	0.092	U	NS	0.092	U	0.092	U
	22-Jul-09	0.462	U	NS	18.8	U	0.924	U	NS	0.462	U	0.092
	9-Oct-09	NS		0.092	U	NS	0.092	U	NS	0.092	U	0.092
	15-Jan-10	0.092	U	NS	0.092	U	0.092	U	NS	0.092	U	0.092
	21-Apr-10	NS		0.092	U	NS	NS	0.462	U	NS	0.092	U
	16-Jul-10	0.092	U	NS	0.092	U	0.092	U	NS	0.698	U	0.092
	15-Oct-10	NS		0.092	U	NS	NS	0.092	U	NS	0.092	U
	26-Jan-11	0.924	U	0.092	U	NS	0.092	U	NS	0.462	U	0.462
	28-Feb-11	NS		NS	U	0.924	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.092	U	NS	0.092	U	NS	0.092	U	0.092
	26-Jul-11	0.308	U	NS	0.308	U	0.092	U	0.462	U	NS	0.462
	28-Oct-11	NS		2.3	U	NS	NS	2.3	U	NS	2.3	U
	23-Jan-12	0.23	U	NS	0.23	U	0.23	U	NS	0.23	U	0.23
	13-Apr-12	NS		0.46	U	NS	0.46	U	NS	0.46	U	0.46
2-Jul-12 (resample)	NS		NS	NS	U	NS	NS	NS	NS	NS	1.2	U
	23-Jun-12	0.46	U	NS	0.46	U	0.46	U	NS	0.46	U	0.46
	1-Nov-12	NS		0.046	U	NS	NS	0.046	U	0.046	U	0.046
	1-Feb-13	0.092	U	NS	0.092	U	0.092	U	NS	0.092	U	0.092
	29-Apr-13	NS		0.12	U	NS	NS	0.046	U	0.046	U	0.098
	9-Jul-13	0.14	U	NS	0.092	U	0.092	U	NS	0.092	U	NS
	18-Oct-13	NS		0.092	U	NS	NS	0.092	U	0.092	U	0.092
	9-Jan-14	0.092	U	NS	0.092	U	0.092	U	NS	0.092	U	NS
	24-Apr-14	NS		0.046 ^{L-v}	U	NS	NS	0.046 ^{L-v}	U	NS	0.046 ^{L-v}	U
	1-Aug-14	0.092	U	NS	0.14	U	0.14	U	NS	NS	0.092	U
	27-Aug-14	NS		NS	U	NS	NS	0.046	U	NS	NS	NS
1,2-Dichloropropane	12-Sep-14 (resample)	NS		NS	U	NS	NS	NS	NS	0.069 ^{L-v}	U	NS
	22-Oct-14	NS		0.069	U	NS	NS	0.069	U	0.069	U	0.092
	20-Jan-15	0.046	U	NS	0.046	U	0.046	U	NS	0.046	U	0.046
30-Mar-15 (resample)	NS		NS	NS	U	NS	NS	NS	NS	NS	0.052	U
	22-Apr-15	NS		0.047	U	NS	NS	0.046	U	0.046	U	0.053
	21-Jul-15	0.2	U	NS	0.9	U	5	U	NS	0.3	U	0.200 ^v
23-Sep-15 resample	NS		NS	NS	U	NS	NS	NS	NS	0.2	U	NS
	29-Oct-15	NS		0.3	U	NS	NS	0.3	U	0.4	U	0.2
4-Dec-15 resample	NS		NS	NS	U	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.046	U	NS	0.046	U	0.046	U	NS	0.046	U	0.046
	20-Apr-16	NS		0.046	U	NS	NS	0.046	U	0.046	U	0.046
	20-Jul-16	0.23	U	NS	0.23	U	0.23	U	NS	0.27	U	0.24
	21-Oct-16	NS		0.046	U	NS	NS	0.046	U	0.046	U	0.046
	31-Jan-17	0.046	U	NS	0.046	U	0.046	U	NS	0.046	U	NS
	17-Apr-17	NS		0.069	U	NS	NS	0.069	U	0.069	U	0.069
	26-Jul-17	0.046	U	NS	0.046	U	0.046	U	NS	0.046	U	NS
	12-Oct-17	NS		0.046	U	NS	NS	0.046	U	0.14	U	0.12
	10-Jan-18	0.046	U	NS	0.046	U	0.046	U	NS	0.13	U	0.12
	11-Apr-18	NS		0.092	U	NS	NS	0.92 ^v	U	NS	0.092	U
	23-May-18	NS		NS	U	NS	NS	NS	U	NS	0.069	U
	27-Jul-18	0.23	U	NS	0.23	U	0.23	U	NS	0.23	U	NS
	24-Oct-18	NS		0.23	U	NS	NS	0.23	U	0.23	U	0.23
	16-Jan-19	0.046	U	NS	0.046	U	0.046	U	NS	0.046	U	NS
	12-Apr-19	NS		0.046	U	NS	NS	0.046	U	0.058	U	0.069
	29-Jul-19	0.069	U	NS	0.069	U	0.046	U	NS	0.046	U	1.1
	26-Sep-19	NS		NS	U	NS	NS	NS	U	NS	0.069	U
	29-Oct-19	NS		0.046	U	NS	NS	0.046	U	0.046	U	0.23 ^v
	21-Jan-20	0.05	U	NS	0.05	U	0.05	U	NS	0.05	U	0.05
	22-Apr-20	NS		0.092 ^L	U	NS	NS	0.092 ^L	U	0.092 ^L	U	0.092 ^L
	23-Jul-20	0.046	U	NS	0.046	U	0.046	U	NS	0.092	U	0.092
	29-Oct-20	NS		0.046	U	NS	NS	0.046	U	0.046	U	0.046
	19-Jan-21	0.092	U	NS								

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
cis-1,3-Dichloropropene	8-Feb-08	0.09	U	NS	NS	NS	NS	NS	0.09	U	0.09	U
	27-Mar-08	NS		0.091	U	NS	NS	NS	0.091	U	0.091	U
	25-Apr-08	NS		NS	U	0.091	U	NS	NS	U	0.091	U
	29-May-08	NS		NS	U	0.09	U	NS	NS	U	0.09	U
	27-Jun-08	0.141	U	NS	NS	NS	U	NS	0.091	U	0.091	U
	31-Jul-08	NS		0.091	U	NS	NS	NS	NS	U	0.091	U
	28-Aug-08	NS		NS	U	0.091	U	NS	NS	U	0.091	U
	27-Oct-08	NS		NS	U	0.18	U	NS	NS	U	0.18	U
	27-Oct-08	0.18	U	NS	U	0.18	U	NS	NS	U	0.18	U
	25-Nov-08	NS		0.18	U	NS	U	NS	0.18	U	0.18	U
	18-Dec-08	NS		NS	U	0.18	U	NS	NS	U	0.18	U
	21-Jan-09	NS		NS	U	0.18	U	NS	NS	U	0.18	U
	25-Feb-09	0.18	U	NS		NS	U	NS	NS	U	0.18	U
	26-Mar-09	NS		0.453	U	NS		NS	0.907	U	NS	0.91
	29-Apr-09	NS		NS	U	0.091	U	NS	NS	U	0.091	U
	22-Jul-09	0.453	U	NS	U	18.5	U	0.907	U	NS	0.091	U
	9-Oct-09	NS		0.091	U	NS	U	0.091	U	NS	18.9	U
	15-Jan-10	0.091	U	NS	U	0.091	U	NS	0.091	U	0.091	U
	21-Apr-10	NS		0.091	U	NS		0.453	U	NS	0.091	U
	16-Jul-10	0.091	U	NS	U	0.091	U	NS	0.685	U	NS	0.091
	15-Oct-10	NS		0.091	U	NS		0.091	U	NS	0.091	U
	26-Jan-11	0.907	U	0.091	U	NS	U	0.091	U	0.453	U	0.453
	28-Feb-11	NS		NS	U	0.907	U	NS	NS	U	NS	NS
	27-Apr-11	NS		0.091	U	NS	U	0.091	U	NS	0.091	U
	26-Jul-11	0.303	U	NS	U	0.303	U	0.091	U	0.454	U	0.454
	28-Oct-11	NS		2.3	U	NS		NS	2.3	U	2.3	U
	23-Jan-12	0.45	U	NS	U	0.45	U	NS	0.45	U	NS	0.45
	13-Apr-12	NS		0.2	U	NS	U	0.23	U	NS	0.23	U
	2-Jul-12 (resample)	NS		NS	U	NS	U	NS	NS	U	1.1	U
	23-Jun-12	0.45	U	NS		0.45	U	NS	0.45	U	0.45	U
	1-Nov-12	NS		0.045	U	NS		0.045	U	NS	0.045	U
	1-Feb-13	0.045	U	NS	U	0.045	U	NS	0.045	U	0.045	U
	29-Apr-13	NS		0.11	U	NS		0.045	U	NS	0.045	U
	9-Jul-13	0.068	U	NS	U	0.045	U	NS	0.045	U	0.045	U
	18-Oct-13	NS		0.091	U	NS		0.091	U	NS	0.091	U
	9-Jan-14	0.091	U	NS	U	0.091	U	NS	0.091	U	0.091	U
	24-Apr-14	NS		0.045	U	NS		0.045	U	NS	0.045	U
	1-Aug-14	0.091	U	NS	U	0.14	U	NS	NS	U	0.091	U
	27-Aug-14	NS		NS	U	NS		0.045	U	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	U	NS		NS	NS	U	NS	NS
	22-Oct-14	NS		0.068	U	NS		0.068	U	0.068	U	0.068
	20-Jan-15	0.045	U	NS	U	0.045	U	NS	0.045	U	0.068	U
	30-Mar-15 (resample)	NS		NS	U	NS		NS	NS	U	0.051	U
	22-Apr-15	NS		0.047	U	NS		0.045	U	0.066	U	0.052
	21-Jul-15	0.2	U	NS		0.9	U	5	U	NS	0.200 ^v	U
	23-Sept-15 resample	NS		NS		NS		NS	NS	U	NS	NS
	29-Oct-15	NS		0.3	U	NS		0.3	U	NS	0.2	U
	4-Dec-15 resample	NS		0.2	U	NS		NS	NS	U	NS	NS
	27-Jan-16	0.045	U	NS	U	0.045	U	0.045	U	NS	0.045	U
	20-Apr-16	NS		0.045	U	NS		0.045	U	0.045	U	0.045
	20-Jul-16	0.23	U	NS		0.23	U	NS	0.23	U	0.23	U
	21-Oct-16	NS		0.045	U	NS		0.045	U	0.045	U	0.045
	31-Jan-17	0.045	U	NS		0.045	U	NS	0.045	U	0.045	U
	17-Apr-17	NS		0.068	U	NS		0.068	U	0.068	U	0.068
	26-Jul-17	0.045	U	NS		0.045	U	NS	0.045	U	0.045	U
	12-Oct-17	NS		0.045	U	NS		0.045	U	0.14	U	0.11
	10-Jan-18	0.045	U	NS		0.045	U	NS	0.045	U	0.045	U
	11-Apr-18	NS		0.091	U	NS		0.91	U	0.91	U	0.91
	23-May-18	NS		NS		NS		NS	NS	U	0.068	U
	27-Jul-18	0.23	U	NS		0.23	U	NS	0.23	U	0.23	U
	24-Oct-18	NS		0.23	U	NS		0.23	U	NS	0.23	U
	16-Jan-19	0.045	U	NS		0.045	U	NS	0.045	U	0.045	U
	12-Apr-19	NS		0.045	U	NS		0.045	U	0.057	U	0.068
	29-Jul-19	0.068	U	NS		0.068	U	NS	0.045	U	0.045	U
	26-Sep-19	NS		NS		NS		NS	NS	U	0.068	U
	29-Oct-19	NS		0.045	U	NS		0.045	U	0.045	U	0.23 ^v
	21-Jan-20	0.05	U	NS		0.05	U	0.05	U	NS	0.05	U
	22-Apr-20	NS		0.045 ^v	U	NS		0.045 ^v	U	0.045 ^v	U	0.045 ^v
	23-Jul-20	0.045	U	NS		0.045	U	NS	0.091	U	NS	0.091
	29-Oct-20	NS		0.045	U	NS		0.045	U	0.045	U	0.045
	19-Jan-21	0.045	U	NS		0.045	U	NS	0.045	U	0.045	U
	15-Apr-21	NS		0.045	U	NS		0.045	U	0.045	U	0.045
	21-Jul-21	0.045	U	NS		0.045	U	NS	0.045	U	0.045	U
	20-Oct-21	NS		0.045	U	NS		0.045	U	0.045	U	0.045
	9-Feb-22	0.045</										

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3		
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
	8-Feb-08	0.09	U	NS	NS	NS	NS	NS	0.09	U	0.09	U	
	27-Mar-08	NS		0.091	U	NS	NS	NS	0.091	U	0.091	U	
	25-Apr-08	NS		NS	U	0.091	U	NS	0.091	U	0.091	U	
	29-May-08	NS		NS	U	0.09	U	NS	0.09	U	0.09	U	
	27-Jun-08	0.141	U	NS	NS	NS	0.091	U	NS	NS	0.091	U	
	31-Jul-08	NS		0.091	U	NS	NS	NS	NS	0.091	U	0.091	U
	28-Aug-08	NS		NS	U	0.091	U	NS	0.091	U	0.091	U	
	30-Sep-08	NS		NS	U	0.18	U	NS	0.18	U	0.18	U	
	27-Oct-08	0.18	U	NS	NS	NS	0.18	U	NS	0.18	U	0.18	U
	25-Nov-08	NS		0.18	U	NS	NS	NS	0.18	U	0.18	U	
	18-Dec-08	NS		NS	U	0.18	U	NS	0.18	U	0.18	U	
	21-Jan-09	NS		NS	U	0.18	U	NS	0.18	U	0.18	U	
	25-Feb-09	0.18	U	NS		NS	0.18	U	NS	0.18	U	0.18	U
	26-Mar-09	NS		0.453	U	NS	NS	NS	0.907	U	NS	0.091	U
	29-Apr-09	NS		NS	U	0.091	U	NS	0.091	U	0.091	U	
	22-Jul-09	0.453	U	NS	0.453	U	0.907	U	NS	0.453	U	0.091	U
	9-Oct-09	NS		0.079	U	NS	0.091	U	NS	0.091	U	18.9	U
	15-Jan-10	0.091		NS	0.091	U	0.091	NS	0.091	U	0.091	U	
	21-Apr-10	NS		0.091	U	NS	NS	0.453	U	0.453	U	0.091	U
	16-Jul-10	0.091	U	NS	0.091	U	0.091	U	0.685	U	NS	0.091	U
	15-Oct-10	NS		0.091	U	NS	NS	0.091	U	0.091	U	0.091	U
	26-Jan-11	0.907	U	0.091	U	NS	0.091	U	0.453	U	0.453	U	
	28-Feb-11	NS		NS	0.907	U	NS	NS	NS	NS	NS	NS	
	27-Apr-11	NS		0.091	U	NS	NS	0.091	U	0.091	U	0.091	U
	26-Jul-11	0.303	U	NS	0.303	U	0.091	U	0.454	U	NS	0.454	U
	28-Oct-11	NS		2.3	U	NS	NS	2.3	U	2.3	U	2.3	U
	23-Jan-12	0.45	U	NS	0.45	U	0.45	U	0.45	U	NS	0.45	U
	13-Apr-12	NS		1.2	U	NS	0.23	U	NS	0.23	U	0.23	U
trans-1,3-Dichloropropene	2-Jul-12 (resample)	NS		NS	1.1	U							
	23-Jun-12	0.45	U	NS	0.45	U	0.45	U	NS	0.45	U	0.45	U
	1-Nov-12	NS		0.045	U	NS	NS	0.045	U	0.045	U	0.045	U
	1-Feb-13	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	U
	29-Apr-13	NS		0.11	U	NS	NS	0.045	U	0.045	U	0.045	U
	9-Jul-13	0.068	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	U
	18-Oct-13	NS		0.091	U	NS	NS	0.091	U	0.091	U	0.091	U
	9-Jan-14	0.091	U	NS	0.091	U	0.091	U	NS	0.091	U	0.091	U
	24-Apr-14	NS		0.045	U	NS	NS	0.045	U	0.045	U	0.045	U
	1-Aug-14	0.091	U	NS	0.14	U	0.14	U	NS	0.091	U	0.091	U
	27-Aug-14	NS		NS	NS	NS	NS	0.045	U	NS	NS	NS	
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	0.068	U	0.068	U	
	22-Oct-14	NS		0.068	U	NS	NS	0.068	U	0.068	U	0.068	U
	20-Jan-15	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	U
	30-Mar-15 (resample)	NS		NS									
	22-Apr-15	NS		0.047	U	NS	NS	0.045	U	NS	0.045	U	
	21-Jul-15	0.2	U	NS	0.9	U	5	U	NS	0.3	U	0.200 ^v	U
	23-Sept-15 resample	NS		NS									
	29-Oct-15	NS		0.3	U	NS	NS	0.3	U	0.4	U	0.2	U
	4-Dec-15 resample	NS		0.2	U	NS							
	27-Jan-16	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	U
	20-Apr-16	NS		0.045	U	NS	NS	0.045	U	0.045	U	0.045	U
	20-Jul-16	0.23	U	NS	0.23	U	0.23	U	NS	0.23	U	0.23	U
	21-Oct-16	NS		0.045	U	NS	NS	0.045	U	NS	0.045	U	0.045
	31-Jan-17	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	
	17-Apr-17	NS		0.068	U	NS	NS	0.068	U	0.068	U	0.068	
	26-Jul-17	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	
	12-Oct-17	NS		0.045	U	NS	NS	0.045	U	0.14	U	0.11	U
	10-Jan-18	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	
	11-Apr-18	NS		0.091	U	NS	NS	0.91	U	0.91	U	0.91	U
	23-May-18	NS		NS	0.27								
	27-Jul-18	0.23	U	NS	0.23	U	0.23	U	NS	0.23	U	0.23	
	24-Oct-18	NS		0.23	U	NS	NS	0.23	U	0.23	U	0.23	
	16-Jan-19	0.045	U	NS	0.045	U	0.045	U	NS	0.045	U	0.045	
	12-Apr-19	NS		0.045	U	NS	NS	0.045	U	0.057	U	0.068	
	29-Jul-19	0.068	U	NS	0.068	U	0.045	U	NS	0.045	U	0.045	
	26-Sep-19	NS		NS	0.068								
	29-Oct-19	NS		0.045	U	NS	NS	0.045	U	0.045	U	0.23 ^v	
	21-Jan-20	0.05	U	NS	0.05	U	0.05	U	NS	0.05	U	0.05	
	22-Apr-20	NS		0.045	U	NS	NS	0.045	U	0.045	U	0.045	
	23-Jul-20	0.045	U	NS	0.045	U	0.045	U	NS	0.091	U	0.091	
	29-Oct-20	NS		0.045									

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
Ethylbenzene	8-Feb-08	0.21	NS	NS	NS	0.23	NS	NS	0.33	4.89	NS	
	27-Mar-08	NS	0.295	NS	NS	0.157	NS	NS	NS	0.645	0.372	
	25-Apr-08	NS	NS	0.291	NS	NS	0.32	NS	NS	NS	0.565	
	29-May-08	NS	NS	NS	1.49	NS	NS	2.2	2.82	1.01	NS	
	27-Jun-08	4.34	NS	NS	0.472	NS	NS	NS	NS	0.606	0.699	
	31-Jul-08	NS	*	NS	NS	NS	NS	NS	0.758	NS	0.577	
	28-Aug-08	NS	NS	0.83	NS	NS	0.482	NS	0.711	0.666	NS	
	30-Sep-08	NS	NS	NS	2.2	U	NS	NS	NS	2.2	U	2.2
	27-Oct-08	18.4	NS	NS	2.2	U	NS	NS	NS	NS	NS	2.2
	25-Nov-08	NS	2.2	U	NS	NS	2.2	U	NS	2.2	U	NS
	18-Dec-08	NS	NS	2.2	U	NS	NS	2.2	U	NS	2.2	U
	21-Jan-09	NS	NS	NS	2.2	U	NS	NS	2.2	U	NS	2.2
	25-Feb-09	10.8	NS	NS	2.2	U	NS	NS	2.2	U	2.2	U
	26-Mar-09	NS	0.516	NS	NS	0.868	U	NS	NS	NS	0.845	1.18
	29-Apr-09	NS	NS	0.19	NS	NS	0.191	NS	NS	NS	0.304	0.325
	22-Jul-09	11.7	NS	11.7	0.868	U	NS	1.15	NS	38.2	1.04	NS
	9-Oct-09	NS	0.564	NS	0.56	NS	0.291	18.1	U	0.542	NS	0.542
	15-Jan-10	6.95	NS	0.568	0.542	NS	0.659	NS	NS	0.712	0.72	NS
	21-Apr-10	NS	0.304	NS	1.34	NS	1.8	1.76	2.12	NS	1.56	
	16-Jul-10	8.23	NS	2.4	1.8	NS	1.44	NS	NS	1.51	1.42	NS
	15-Oct-10	NS	0.534	NS	0.625	NS	0.521	0.573	1.07	NS	0.833	
	26-Jan-11	1.26	1.62	NS	1.66	NS	1.26	NS	1.21	4.14	4.68	NS
	28-Feb-11	NS	NS	0.868	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.243	NS	0.239	NS	0.286	3.86	0.364	NS	0.508	
	26-Jul-11	3.91	NS	0.942	0.339	NS	0.434	U	NS	0.304	0.434	U
	28-Oct-11	NS	2.2	U	NS	2.2	U	2.2	U	3.8	NS	2.2
	23-Jan-12	3	NS	0.79	0.56	NS	0.82	NS	NS	1.7	12	NS
	13-Apr-12	NS	0.43	U	NS	0.43	U	0.43	U	1.5	NS	0.43
	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	2.2	U	NS
	23-Jun-12	5.1	NS	0.53	0.43	U	0.47	NS	NS	0.76	0.46	NS
	1-Nov-12	NS	0.55	NS	0.57	NS	0.8	0.75	0.87	NS	1.3	
	1-Feb-13	1.3	NS	0.18	0.15	NS	0.23	NS	NS	0.54	0.52	NS
	29-Apr-13	NS	0.33	NS	0.39	NS	0.37	0.49	0.63	NS	0.8	
	9-Jul-13	5.1	NS	0.087	U	0.68	NS	0.59	NS	1.1	1.0	NS
	18-Oct-13	NS	1.7	NS	1.9	NS	2.0	2.6	1.5	NS	1.9	
	9-Jan-14	2.7	NS	2.0	2.6	NS	2.8	NS	6.2	5.5	NS	
	24-Apr-14	NS	0.087	U	NS	0.087	U	0.087	U	0.092	0.087	U
	1-Aug-14	1.7	NS	0.84	0.65	NS	NS	NS	NS	0.45	0.85	NS
	27-Aug-14	NS	NS	NS	NS	NS	0.96	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	0.13	U	0.13	U	0.15	0.13	0.27	0.27
	22-Oct-14	NS	0.13	U	NS	0.096	U	0.087	U	0.13	0.24	0.29
	20-Jan-15	0.400	NS	0.087	U	NS	NS	NS	NS	NS	0.29	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.29	NS
	22-Apr-15	NS	0.22	NS	0.12	NS	0.26	0.21/0.24	0.44	NS	0.53	
	21-Jul-15	0.54	NS	0.590 ^j	4	U	0.56	NS	0.65 ^v	0.90 ^v	NS	
	23-Sept-15 resample	NS	NS	NS	NS	0.14 ^j	NS	0.22 ^j	0.28	0.27	NS	
	29-Oct-15	NS	0.2	U	NS	NS	NS	NS	NS	0.27	NS	0.33
	4-Dec-15 resample	NS	0.2	U	NS	NS	NS	NS	NS	NS	NS	
	27-Jan-16	0.63	NS	0.087	0.12	NS	0.12	NS	0.51	0.54	NS	
	20-Apr-16	NS	0.3	NS	0.39	NS	0.56	NS	0.71	NS	0.61	
	20-Jul-16	5.8	NS	0.75	0.43	U	0.5	NS	2.7	1.1	NS	
	21-Oct-16	NS	0.14	NS	0.35	NS	0.24	0.62	1.2	NS	0.52	
	31-Jan-17	0.56	NS	0.16	0.17	NS	0.14	NS	0.86	0.61	NS	
	17-Apr-17	NS	0.13	U	NS	0.13	U	0.13	U	0.17	NS	0.17
	26-Jul-17	0.53	NS	0.27	0.21	NS	0.38	NS	0.4	0.35	NS	
	12-Oct-17	NS	0.16	NS	0.2	NS	0.26	U	0.36	0.32	NS	0.31
	10-Jan-18	0.5	NS	0.11	0.22	NS	0.19	NS	0.94	NS	0.4	
	11-Apr-18	NS	0.13	NS	0.87	U	0.87	U	0.87	0.37	NS	0.87
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	0.19	NS	
	27-Jul-18	0.43	U	NS	0.43	U	0.43	U	0.43	U	0.43	U
	24-Oct-18	NS	0.43	U	NS	0.43	U	0.7	0.43	0.49	NS	0.43
	16-Jan-19	0.51	NS	0.087	U	0.11	NS	0.13	NS	0.26	0.31	NS
	12-Apr-19	NS	0.1	NS	0.11	NS	0.11	U	0.2	0.19	0.37	U
	29-Jul-19	3.6	NS	3.7	4.6	NS	5.5	NS	2.4	3.3	NS	
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	1.4	NS	
	29-Oct-19	NS	0.64	NS	0.48	NS	0.2	0.66	1.1 ^v	1.6 ^v	0.97 ^v	
	21-Jan-20	0.24	NS	0.30	0.27	NS	0.19	NS	0.92	1.10	NS	
	22-Apr-20	NS	0.087	U	NS	0.087	U	0.087	U	0.29	NS	0.39
	23-Jul-20	0.92	NS	0.29	0.27	NS	0.4	NS	0.71	1.3	NS	
	29-Oct-20	NS	0.19	NS	0.2	NS	0.16	0.27	0.43	NS	0.68	
	19-Jan-21</td											

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	2.46	U	NS	NS	NS	NS	NS	2.46	U	2.46	U
	27-Mar-08	NS		2.46	U	NS	NS	NS	NS	NS	2.46	U
	25-Apr-08	NS		NS	U	2.46	U	NS	NS	2.46	U	2.46
	29-May-08	NS		NS	U	2.46	U	NS	NS	2.46	U	NS
	27-Jun-08	3.83	U	NS	NS	NS	U	NS	2.46	U	2.46	U
	31-Jul-08	NS		2.46	U	NS	U	NS	NS	2.46	U	2.46
	28-Aug-08	NS		NS	U	2.46	U	NS	NS	2.46	U	NS
	30-Sep-08	NS		NS	U	4.9	U	NS	NS	4.9	U	4.9
	27-Oct-08	5.2		NS	U	NS	U	NS	4.9	U	NS	4.9
	25-Nov-08	NS		4.9	U	NS	U	NS	4.9	U	4.9	U
	18-Dec-08	NS		NS	U	4.9	U	NS	NS	4.9	U	4.9
	21-Jan-09	NS		NS	U	4.9	U	NS	NS	4.9	U	4.9
	25-Feb-09	4.9	U	NS		NS	U	NS	NS	4.9	U	NS
	26-Mar-09	NS		12.3	U	NS		NS	24.6	U	NS	2.46
	29-Apr-09	NS		NS	U	2.46	U	NS	NS	2.46	U	2.46
	22-Jul-09	12.3	U	NS	U	12.3	U	NS	12.3	U	3.78	U
	9-Oct-09	NS		2.74	U	NS	U	NS	2.46	U	513	U
	15-Jan-10	2.46	U	NS	U	2.46	U	NS	2.46	U	2.46	U
	21-Apr-10	NS		2.46	U	NS	U	NS	12.3	U	2.46	U
	16-Jul-10	2.46	U	NS	U	2.66	U	NS	18.5	U	2.46	U
	15-Oct-10	NS		2.46	U	NS	U	NS	2.46	U	2.46	U
	26-Jan-11	24.6	U	2.46	U	NS	U	NS	12.3	U	12.3	U
	28-Feb-11	NS		NS	U	24.6	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		2.46	U	NS	U	NS	2.46	U	2.46	U
	26-Jul-11	8.21	U	NS	U	8.21	U	NS	12.3	U	2.46	U
	28-Oct-11	NS		6.2	U	NS	U	NS	6.2	U	6.2	U
	23-Jan-12	1.2	U	NS	U	1.2	U	NS	1.2	U	1.2	U
	13-Apr-12	NS		1.2	U	NS	U	NS	1.2	U	1.2	U
Isopropylbenzene	2-Jul-12 (resample)	NS		NS		NS		NS	NS	NS	6.2	U
	23-Jun-12	1.2	U	NS		1.2	U	NS	1.2	U	1.2	U
	1-Nov-12	NS		0.25	U	NS		NS	0.25	U	0.25	U
	1-Feb-13	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	29-Apr-13	NS		0.62	U	NS		NS	0.25	U	0.25	U
	9-Jul-13	0.37	U	NS		0.25	U	NS	0.25	U	0.25	U
	18-Oct-13	NS		0.25	U	NS		NS	0.25	U	0.25	U
	9-Jan-14	0.25	U	NS		0.25	U	NS	0.25	U	0.49	NS
	24-Apr-14	NS		0.25	U	NS		NS	0.25	U	0.25	U
	1-Aug-14	0.25		NS		0.37	U	NS	NS	U	0.25	U
	27-Aug-14	NS		NS		NS		NS	0.25	U	NS	NS
	12-Sept-14 (resample)	NS		NS		NS		NS	NS	U	NS	NS
	22-Oct-14	NS		0.37	U	NS		NS	0.37	U	0.37	U
	20-Jan-15	0.25	U	NS		0.25	U	NS	0.25	U	0.37	U
	30-Mar-15 (resample)	NS		NS		NS		NS	NS	NS	0.28	U
	22-Apr-15	NS		0.26	U	NS		NS	0.25	U	0.36	U
	21-Jul-15	0.140 ^j		NS		1	U	5	U	0.19 ^j	NS	0.21 ^{j,u}
	23-Sept-15 resample	NS		NS		NS		NS	NS	U	0.2	NS
	29-Oct-15	NS		0.3	U	NS		NS	0.3	U	0.2	U
	4-Dec-15 resample	NS		0.2	U	NS		NS	NS	NS	NS	NS
	27-Jan-16	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	20-Apr-16	NS		0.25	U	NS		NS	0.25	U	0.25	U
	20-Jul-16	1.2	U	NS		1.2	U,M,W	1.2	U	1.2	U	1.2
	21-Oct-16	NS		0.25	U	NS		NS	0.25	U	0.25	U
	31-Jan-17	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	17-Apr-17	NS		0.37	U	NS		NS	0.37	U	0.37	U
	26-Jul-17	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	12-Oct-17	NS		0.25	U	NS		NS	0.25	U	0.76	U
	10-Jan-18	0.25	U	NS		0.25	U	NS	0.25	U	0.62	U
	11-Apr-18	NS		0.25	U	NS		NS	2.5	U	2.5	U
	23-May-18	NS		NS		NS		NS	NS	NS	0.37	U
	27-Jul-18	1.2	U	NS		1.2	U	NS	1.2	U	1.2	U
	24-Oct-18	NS		1.2	U	NS		1.2	U	1.2	U	1.2
	16-Jan-19	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	12-Apr-19	NS		0.25	U	NS		NS	0.31	U	0.37	U
	29-Jul-19	0.37	U	NS		0.37	U	NS	0.25	U	0.25	U
	26-Sep-19	NS		NS		NS		NS	NS	NS	0.37	U
	29-Oct-19	NS		0.25	U	NS		NS	0.25	U	1.2 ^v	U
	21-Jan-20	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	22-Apr-20	NS		0.25	U	NS		NS	0.25	U	0.25	U
	23-Jul-20	0.25	U	NS		0.25	U	NS	0.5	U	0.5	U
	29-Oct-20	NS		0.25	U	NS		NS	0.25	U	0.25	U
	19-Jan-21	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	15-Apr-21	NS		0.25	U	NS		NS	0.25	U	0.25	U
	21-Jul-21	0.25	U	NS		0.25	U	NS	0.25	U	0.25	U
	20-Oct-21	NS		0.25	U	NS		NS	0.25	U	0.25	U</td

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	2.74	U	NS	NS	NS	NS	NS	2.74	U	2.74	U
	27-Mar-08	NS		2.74	U	NS	1.2	NS	NS	NS	2.74	U
	25-Apr-08	NS		2.74	U	NS	NS	NS	2.74	U	2.74	U
	29-May-08			NS	NS	2.74	U	NS	NS	2.74	U	NS
	27-Jun-08	4.27	U	NS	NS	NS	2.74	U	NS	NS	2.74	U
	31-Jul-08	NS		2.74	U	NS	NS	NS	NS	NS	2.74	U
	28-Aug-08	NS		NS	U	NS	5.5	U	NS	NS	2.74	U
	30-Sep-08	NS		NS	U	NS	5.5	U	NS	5.5	U	5.5
	27-Oct-08	12.5		NS	U	NS	5.5	U	NS	18.5	U	5.5
	25-Nov-08	NS		5.5	U	NS	NS	U	NS	5.5	U	NS
	18-Dec-08	NS		NS	U	NS	5.5	U	NS	5.5	U	5.5
	21-Jan-09	NS		NS	U	NS	5.5	U	NS	5.5	U	5.5
	25-Feb-09	5.5	U	NS		NS	5.5	U	NS	5.5	U	NS
	26-Mar-09	NS		13.7	U	NS	NS	27.4	U	NS	2.74	U
	29-Apr-09	NS		NS	U	2.74	U	NS	2.74	U	NS	2.74
	22-Jul-09	13.7	U	NS	U	13.7	U	27.4	U	NS	2.74	U
	9-Oct-09	NS		2.74	U	NS	2.74	U	NS	573	U	2.74
	15-Jan-10	2.72	U	NS	2.74	U	2.74	U	NS	2.74	U	2.74
	21-Apr-10	NS		2.74	U	NS	NS	13.7	U	13.7	U	2.74
	16-Jul-10	2.74	U	NS	2.74	U	2.74	U	NS	2.74	U	2.74
	15-Oct-10	NS		2.74	U	NS	2.74	U	NS	2.74	U	2.74
	26-Jan-11	27.4	U	2.74	U	NS	2.74	U	NS	13.7	U	NS
	28-Feb-11	NS		NS	U	27.4	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		2.74	U	NS	2.74	U	NS	2.74	U	2.74
	26-Jul-11	9.17	U	NS	U	9.17	U	2.74	U	13.7	U	13.7
	28-Oct-11	NS		6.3	U	NS	NS	6.3	U	6.3	U	6.3
	23-Jan-12	1.3	U	NS	U	1.3	U	NS	1.3	U	1.3	U
	13-Apr-12	NS		1.3	U	NS	1.3	U	NS	1.3	U	1.3
2-Jul-12 (resample)	NS		NS		NS		NS		NS		NS	
	23-Jun-12	1.3	U	NS	U	1.3	U	NS	1.3	U	1.3	U
	1-Nov-12	NS		0.25	U	NS	NS	0.25	U	0.27	U	0.25
	1-Feb-13	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	29-Apr-13	NS		0.63	U	NS	0.25	U	NS	0.25	U	0.25
	9-Jul-13	0.38	U	NS		0.28		0.29	NS	0.29	NS	0.53
	18-Oct-13	NS		0.38		NS	0.25	U	0.25	U	0.25	NS
	9-Jan-14	0.25	U	NS		0.33	0.040	NS	0.25	U	0.25	NS
	24-Apr-14	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	1-Aug-14	0.70		NS		0.88		1.4	NS	NS	0.45	NS
	27-Aug-14	NS		NS		NS		0.38	NS	NS	NS	NS
p-Isopropyltoluene	12-Sept-14 (resample)	NS		NS		NS		NS	NS	0.66	NS	NS
	22-Oct-14	NS		0.38 ^L	U	NS	0.38 ^L	U	0.38 ^L	U	0.38 ^L	U
	20-Jan-15	0.25	U	NS	U	0.25	U	NS	0.25	U	0.38	U
	30-Mar-15 (resample)	NS		NS		NS		NS	NS	NS	0.28	U
	22-Apr-15	NS		0.26	U	NS	0.25	U	NS	0.36	U	0.29
	21-Jul-15	0.3	U	NS	U	1	U	6	U	0.16 ^J	NS	0.30 ^U
	23-Sept-15 resample	NS		NS		NS		NS	NS	0.34	NS	NS
	29-Oct-15	NS		0.3	U	NS	NS	0.19 ^J	NS	0.5	U	0.19 ^J
	4-Dec-15 resample	NS		0.3	U	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.25	U	NS	U	0.25	U	0.25	U	0.25	U	0.25
	20-Apr-16	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	20-Jul-16	1.3	U	NS	U	1.3 ^{M,W}	U	1.3	U	1.3	U	1.3
	21-Oct-16	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	31-Jan-17	0.25	U	NS	U	0.25	U	NS	0.25	U	0.43	NS
	17-Apr-17	NS		0.38	U	NS	NS	0.38	U	0.38	U	0.38
	26-Jul-17	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	12-Oct-17	NS		0.25	U	NS	0.25	U	0.76	U	0.71	U
	10-Jan-18	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	NS
	11-Apr-18	NS		0.25	U	NS	NS	2.5	U	2.5	U	2.5
	23-May-18	NS		NS		NS		NS	NS	NS	0.38	U
	27-Jul-18	1.3	U	NS	U	1.3	U	NS	1.3	U	1.3	U
	24-Oct-18	NS		1.3	U	NS	NS	1.3	U	1.3	U	1.3
	16-Jan-19	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	NS
	12-Apr-19	NS		0.25	U	NS	0.25	U	0.31	U	0.38	U
	29-Jul-19	0.38	U	NS	U	0.38	U	0.26	NS	0.31	NS	0.41
	26-Sep-19	NS		NS		NS		NS	NS	NS	0.25	U
	29-Oct-19	NS		0.25	U	NS	0.25	U	NS	0.25	U	NS
	21-Jan-20	0.25	U	NS	U	0.25	U	NS	0.25	U	1.3 ^U	U
	22-Apr-20	NS		0.25	U	NS	0.25	U	0.25	U	0.25	U
	23-Jul-20	0.25	U	NS	U	0.25 ^M	U	0.25	U	0.5	U	0.5
	29-Oct-20	NS		0.25	U	NS	0.25	U	NS	0.25	U	0.25
	19-Jan-21	0.25	U	NS	U	0.25	U	NS	0.25	U	0.25	U
	15-Apr-21	NS		0.25	U	NS	NS	0.25	U	0.25	U	0.25
	21-Jul-21	0.5	U	NS	U	0.5	U	NS	0.5	U	0.5	U
	20-Oct-21	NS		0.25	U	NS	NS	0.25	U	0.25	U	0.25
	9-Feb-22	0.25	U	NS	U	0.25	U	NS				

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.07	U	NS	NS	NS	NS	NS	0.14	0.07	U	NS
	27-Mar-08	NS	0.072	U	NS	NS	NS	NS	0.165	0.126		
	25-Apr-08	NS	NS	0.072	U	NS	NS	NS	0.079	0.079		
	29-May-08	NS	NS	NS	U	0.07	U	NS	0.07	U	NS	
	27-Jun-08	0.436	U	NS	NS	0.072	U	NS	0.072	U	0.072	U
	31-Jul-08	NS	0.072	U	NS	NS	U	NS	0.072	U	0.072	U
	28-Aug-08	NS	NS	0.106	U	NS	NS	NS	0.14	NS	NS	
	30-Sep-08	NS	NS	NS	U	1.8	U	NS	1.8	U	1.8	U
	27-Oct-08	1.8	U	NS	NS	2.6	U	NS	3.2	NS	5.8	
	25-Nov-08	NS	1.8	U	NS	NS	U	NS	1.8	U	1.8	NS
	18-Dec-08	NS	NS	1.8	U	NS	NS	NS	1.8	U	1.8	U
	21-Jan-09	NS	NS	NS	U	1.8	U	NS	1.8	U	1.8	U
	25-Feb-09	5.8	U	NS	NS	1.8	U	NS	1.8	U	1.8	NS
	26-Mar-09	NS	0.36	U	NS	NS	U	0.72	NS	0.072	0.072	U
	29-Apr-09	NS	NS	0.072	U	NS	NS	0.072	U	NS	0.072	U
	22-Jul-09	0.36	U	NS	0.36	U	0.72	U	NS	0.072	0.072	U
	9-Oct-09	NS	0.072	U	NS	0.072	U	NS	0.072	U	0.086	NS
	15-Jan-10	0.079	NS	0.072	U	0.072	U	NS	0.072	U	0.072	U
	21-Apr-10	NS	0.072	U	NS	NS	U	0.36	U	0.072	U	0.072
	16-Jul-10	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	NS
	15-Oct-10	NS	0.072	U	NS	NS	U	0.072	U	0.072	U	0.072
	26-Jan-11	0.72	U	0.072	U	NS	0.072	U	0.396	U	0.36	U
	28-Feb-11	NS	NS	0.72	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.072	U	NS	0.072	U	NS	0.072	U	0.072	NS
	26-Jul-11	0.24	U	NS	0.24	U	0.072	U	0.36	U	0.072	U
	28-Oct-11	NS	1.8	U	NS	NS	U	1.8	U	1.8	U	1.8
	23-Jan-12	0.36	U	NS	0.36	U	0.36	U	NS	0.36	U	NS
	13-Apr-12	NS	0.36	U	NS	0.36	U	NS	0.36	U	0.36	U
Methyl tert butyl ether (MTBE)	2-Jul-12 (resample)	NS	NS	NS	U	NS	NS	NS	NS	NS	1.8	U
	23-Jun-12	0.36	U	NS	0.36	U	0.36	U	NS	0.36	U	NS
	1-Nov-12	NS	0.072	U	NS	NS	0.072	U	NS	0.072	U	0.072
	1-Feb-13	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	NS
	29-Apr-13	NS	0.18	U	NS	NS	0.072	U	NS	0.072	U	0.072
	9-Jul-13	0.17	NS	0.072	U	0.072	U	NS	0.072	U	0.072	U
	18-Oct-13	NS	0.072	U	NS	NS	0.072	U	NS	0.072	U	0.072
	9-Jan-14	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	NS
	24-Apr-14	NS	0.072	U	NS	0.11	U	0.12	NS	0.072	U	0.11
	1-Aug-14	0.072	U	NS	NS	NS	NS	NS	NS	0.072	U	NS
Methyl tert butyl ether (MTBE)	27-Aug-14	NS	NS	NS	NS	NS	NS	0.072	U	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	U	NS	NS	NS	0.11	U	NS	NS
	22-Oct-14	NS	0.11	U	NS	NS	0.11	U	0.11	U	0.14	U
	20-Jan-15	0.072	U	NS	0.072	U	0.072	U	NS	0.11	U	0.072
	30-Mar-15 (resample)	NS	NS	NS	U	NS	NS	NS	NS	NS	0.081	U
	22-Apr-15	NS	0.074 ^v	U	NS	NS	0.072 ^v	U	NS	0.10	U	0.083
	21-Jul-15	0.2	U	NS	0.7	U	4	U	NS	0.200 ^v	U	0.200 ^v
	23-Sept-15 resample	NS	NS	NS	U	NS	NS	NS	0.2	U	NS	0.096 ^j
	29-Oct-15	NS	0.2	U	NS	NS	0.2	U	0.3	U	0.2	U
	4-Dec-15 resample	NS	0.2	U	NS	NS	NS	NS	NS	NS	NS	NS
Methyl tert butyl ether (MTBE)	27-Jan-16	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	0.072
	20-Apr-16	NS	0.072	U	NS	NS	0.072	U	NS	0.072	U	0.072
	20-Jul-16	0.36	U	NS	0.46	U	0.36	U	0.36	U	0.36	U
	21-Oct-16	NS	0.072	U	NS	NS	0.072	U	NS	0.072	U	0.072
	31-Jan-17	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	NS
	17-Apr-17	NS	0.11	U	NS	NS	0.11	U	0.11	U	0.11	U
	26-Jul-17	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	NS
	12-Oct-17	NS	0.072	U	NS	NS	0.072	U	0.22	U	0.18	U
	10-Jan-18	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	0.072
	11-Apr-18	NS	0.072	U	NS	NS	0.72	U	0.72	U	0.72	U
Methyl tert butyl ether (MTBE)	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.11	U
	27-Jul-18	0.36	U	NS	0.36	U	0.36	U	0.36	U	0.36	U
	24-Oct-18	NS	0.36	U	NS	NS	0.36	U	0.36	U	0.36	U
	16-Jan-19	0.072	U	NS	0.072	U	0.072	U	NS	0.072	U	NS
	12-Apr-19	NS	0.072	U	NS	NS	0.072	U	0.09	U	0.11	U
	29-Jul-19	0.11	U	NS	0.11	U	0.072	U	NS	0.072	U	1
	26-Sep-19	NS	NS	NS	U	NS	NS	NS	NS	NS	0.11	U
	29-Oct-19	NS	0.072	U	NS	NS	0.072	U	NS	0.072	U	0.36 ^g
	21-Jan-20	0.07	U	NS	0.07	U	0.07	U	0.072	U	0.07	U
	22-Apr-20	NS	0.072	U	NS	NS	0.072	U	0.072	U	0.072	U
Methyl tert butyl ether (MTBE)	23-Jul-20	0.072	U	NS	0.072							

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	2.34	NS	NS	NS	1.74	U	NS	NS	1.74	U	NS
	27-Mar-08	NS	1.74	U	NS	NS	2.87	U	NS	NS	2.1	1.74
	25-Apr-08	NS	NS	1.74	U	NS	NS	1.74	U	1.74	NS	U
	29-May-08	NS	NS	NS	1.74	U	NS	NS	1.74	U	1.74	NS
	27-Jun-08	4.33	U	NS	NS	3.69	U	NS	NS	2.91	U	2.78
	31-Jul-08	NS	1.74	U	NS	NS	NS	NS	1.74	U	1.74	U
	28-Aug-08	NS	NS	1.74	U	NS	NS	1.74	U	1.74	U	NS
	30-Sep-08	NS	NS	1.7	U	NS	NS	1.7	U	1.7	U	1.7
	27-Oct-08	1.7	U	NS	NS	1.7	U	NS	NS	1.7	U	1.7
	25-Nov-08	NS	1.7	U	NS	NS	1.7	U	NS	1.7	U	NS
	18-Dec-08	NS	NS	1.7	U	NS	NS	1.7	U	NS	1.7	U
	21-Jan-09	NS	NS	NS	1.7	U	NS	NS	1.7	U	NS	1.7
	25-Feb-09	1.7	U	NS	NS	1.7	U	NS	NS	1.7	U	NS
	26-Mar-09	NS	16.1	U	NS	NS	17.4	U	NS	NS	1.74	1.8
	29-Apr-09	NS	NS	1.74	U	NS	NS	1.74	U	1.74	U	1.74
	22-Jul-09	86.8	U	NS	8.68	U	17.4	U	NS	1.74	U	1.74
	9-Oct-09	NS	1.74	U	NS	1.74	U	NS	1.74	U	362	1.74
	15-Jan-10	1.74	U	NS	1.74	U	NS	1.74	U	1.74	U	1.74
	21-Apr-10	NS	1.74	U	NS	NS	0.868	U	8.68	U	1.74	NS
	16-Jul-10	24	NS	21.5	U	19.5	NS	26.2	U	NS	27.1	26.5
	15-Oct-10	NS	3.47	U	NS	NS	3.47	U	NS	3.47	U	NS
	26-Jan-11	34.7	U	NS	3.47	U	NS	0.404	U	NS	17.4	3.47
	28-Feb-11	NS	NS	34.7	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	3.47	U	NS	NS	3.47	U	NS	3.47	U	3.47
	26-Jul-11	11.6	U	NS	11.6	U	3.47	U	17.4	U	5.7	17.4
	28-Oct-11	NS	17	U	NS	NS	17	U	17	U	140	17
	23-Jan-12	3.5	U	NS	3.5	U	3.5	U	NS	NS	3.5	NS
	13-Apr-12	NS	4.6	U	NS	7.3	NS	3.5	U	4.6	NS	3.5
Methylene chloride	2-Jul-12 (resample)	NS	NS	NS	U	NS	NS	NS	U	NS	17	NS
	23-Jun-12	3.5	U	NS	3.5	U	3.5	U	NS	NS	3.5	NS
	1-Nov-12	NS	0.74	U	NS	NS	1.1	U	0.69	U	1.1	6.2
	1-Feb-13	2	NS	0.93	U	1.6	NS	1.1	NS	NS	0.9	2.1
	29-Apr-13	NS	1.7	U	NS	1.4	NS	0.93	U	1.8	1.1	1.4
	9-Jul-13	1.8	NS	25	U	1.2	NS	1.1	NS	NS	31	3.6
	18-Oct-13	NS	0.69	U	NS	0.69	U	0.69	U	0.77	0.69	0.74
	9-Jan-14	0.85	NS	0.69	U	0.69	NS	0.69	U	NS	0.69	1.3
	24-Apr-14	NS	0.90	NS	NS	6.7	NS	2.8	U	1.5	0.69	1.0
	1-Aug-14	1.0	NS	1.7	U	1.7	NS	NS	NS	1.1	1.1	NS
	27-Aug-14	NS	NS	NS	NS	NS	2.9	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	U	NS	NS	NS	U	1.2	NS	NS
	22-Oct-14	NS	1.7	NS	NS	1.0	U	1.7	1.4	1.0	2.0	3.0
	20-Jan-15	33	NS	27	U	25	NS	31	NS	NS	32	0.69
30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	40	NS
	22-Apr-15	NS	0.85 ^v	NS	NS	1.00 ^v	NS	0.73	2.5/2.3	1.0	NS	1.3
	21-Jul-15	2.1	NS	3.5	U	3.1 ^v	NS	1.5	NS	NS	1.7 ^v	2.4 ^v
23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	U	2.4	NS	NS
	29-Oct-15	NS	1.6	NS	NS	1.4	NS	3.6	2.7	2	NS	4.7
4-Dec-15 resample	NS	1.6	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	2.3	NS	0.69	U	0.69	U	0.69	U	0.69	U	0.69
	20-Apr-16	NS	0.69	U	NS	0.69	U	0.69	U	0.69	4.4	NS
	20-Jul-16	3.5	U	NS	3.5	U	3.5	U	NS	3.5	8.6	NS
	21-Oct-16	NS	0.69	U	NS	4.6	NS	0.69	U	2.3	1.1	1.7
	31-Jan-17	0.69	U	NS	0.8	0.69	U	0.69	U	NS	0.69	U
	17-Apr-17	NS	1	U	NS	NS	1	U	NS	1	U	1
	26-Jul-17	0.69	U	NS	0.69	U	0.69	U	NS	0.69	U	NS
	12-Oct-17	NS	0.79	NS	NS	0.92	NS	2.1	U	2.8	2	1.7
	10-Jan-18	0.78	NS	0.69	U	0.69	NS	1.1	NS	1.1	NS	0.69
	11-Apr-18	NS	0.69	U	NS	6.9 ^v	U	6.9 ^v	U	8.8 ^v	1.7	6.9 ^v
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	1	NS
	27-Jul-18	3.5	U	NS	3.5	U	3.5	U	NS	3.5	U	NS
	24-Oct-18	NS	3.5	U	NS	NS	3.5	U	NS	3.5	U	3.5
	16-Jan-19	0.69	U	NS	0.69	U	0.69	U	NS	1.1	0.69	NS
	12-Apr-19	NS	0.69	U	NS	0.69	U	0.87	U	1.1	2.6	1
	29-Jul-19	1	U	NS	1	U	0.69	U	NS	0.69	U	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	1	NS
	29-Oct-19	NS	0.69	U	NS	0.69	U	0.69	U	1.8	3.5 ^v	3.5 ^v
	21-Jan-20	0.69	U	NS	0.69	U	0.69	U	NS	0.69	U	0.69
	22-Apr-20	NS	3.9	NS	NS	2.1	NS	1.7	3.8	2.7	NS	4.4
	23-Jul-20	5	NS	0.69	U	0.69	U	2.2	NS	1.4	1.4	NS
	29-Oct-20	NS	0.9	NS	NS	1.4	NS	0.69	U	0.69	NS	0.69
	19-Jan-21	0.87	NS	1.8	U	0.69	U	0.69	U	1.9	1.1 ^t	NS
	15-Apr-21	NS	0.85	NS	NS							

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	2.05	U	NS	NS	NS	2.05	U	NS	NS	2.05	U
	27-Mar-08	NS		2.05	U	NS	NS	U	NS	NS	15.2	2.05
	25-Apr-08	NS		NS	U	2.05	U	NS	NS	2.05	2.05	U
	29-May-08	NS		NS	U	NS	2.05	U	NS	2.05	U	NS
	27-Jun-08	3.19	U	NS	NS	NS	2.05	U	NS	NS	2.05	U
	31-Jul-08	NS		2.05	U	NS	NS	U	NS	NS	2.05	U
	28-Aug-08	NS		NS	U	NS	NS	U	NS	NS	2.05	U
	30-Sep-08	NS		NS	U	2	U	NS	NS	2	U	2
	27-Oct-08	2	U	NS	NS	NS	2	U	NS	2	U	2
	25-Nov-08	NS		3.5	U	NS	NS	U	NS	2	U	NS
	18-Dec-08	NS		NS	U	2	U	NS	NS	2	U	2
	21-Jan-09	NS		NS	U	2	U	NS	NS	2	U	2
	25-Feb-09	2	U	NS	NS	NS	2	U	NS	2	U	NS
	26-Mar-09	NS		10.2	U	NS	NS	U	NS	NS	2.05	U
	29-Apr-09	NS		NS	U	2.05	U	NS	NS	2.05	U	2.05
	22-Jul-09	10.2	U	NS	U	10.2	U	NS	10.2	U	2.05	U
	9-Oct-09	NS		2.05	U	NS	2.05	U	NS	2.05	U	2.05
	15-Jan-10	2.05	U	NS	U	2.05	U	NS	2.05	U	2.05	U
	21-Apr-10	NS		2.05	U	NS	NS	U	10.2	U	2.05	U
	16-Jul-10	2.05	U	NS	U	2.05	U	NS	15.4	U	2.05	U
	15-Oct-10	NS		2.05	U	NS	2.05	U	NS	2.05	U	2.05
	26-Jan-11	20.5	U	2.05	U	NS	2.05	U	10.2	U	10.2	U
	28-Feb-11	NS		NS	U	20.5	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		2.05	U	NS	2.05	U	NS	2.05	U	3.35
	26-Jul-11	6.84	U	NS	U	0.684	U	2.05	U	10.2	U	10.2
	28-Oct-11	NS		2	U	NS	NS	U	2	U	2	U
	23-Jan-12	0.41	U	NS	U	0.44	U	NS	0.41	U	0.41	U
	13-Apr-12	NS		0.41	U	NS	0.41	U	NS	0.41	U	0.41
2-Jul-12 (resample)	NS		NS	NS	U	NS	NS	U	NS	NS	2	U
	23-Jun-12	0.41	U	NS	U	0.41	U	NS	0.41	U	0.41	U
	1-Nov-12	NS		0.89	NS	NS	0.65	NS	0.9	0.84	1.1	NS
	1-Feb-13	0.12	NS	0.082	U	0.082	U	NS	0.095	NS	0.082	U
	29-Apr-13	NS		0.2	U	NS	0.21	NS	0.21	U	0.082	U
	9-Jul-13	0.66	NS	0.55	U	0.47	NS	0.51	NS	NS	0.92	NS
	18-Oct-13	NS		1.8	NS	NS	2.7	NS	2.2	2.3	3.0	NS
	9-Jan-14	0.18	NS	0.087	NS	0.15	0.21	NS	0.082	U	0.21	NS
	24-Apr-14	NS		NS	U	1.0/0.74	1.1/0.86	NS	0.13	0.082	0.38	0.66
	1-Aug-14	0.64	NS	NS	NS	NS	NS	NS	NS	NS	1.30	2.4/2.0
	27-Aug-14	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
4-Methyl-2-pentanone	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	U
	22-Oct-14	NS		0.13	NS	NS	0.12	U	0.12	0.26	0.12	U
	20-Jan-15	0.087	NS	0.085	NS	0.12	NS	0.088	NS	NS	0.35	NS
30-Mar-15 (resample)	NS		NS	NS	U	NS	NS	U	NS	NS	0.77	NS
	22-Apr-15	NS		0.57	NS	NS	0.34	NS	0.85	0.39/0.40	0.87	0.88
	21-Jul-15	0.2	U	NS	U	0.8	4	U	NS	0.2	1.4 ^v	2.7 ^v
23-Sept-15 resample	NS		NS	NS	U	NS	NS	U	NS	0.2	NS	NS
	29-Oct-15	NS		0.2	U	NS	NS	U	0.3	U	0.97	NS
4-Dec-15 resample	NS		NS	NS	U	NS	NS	U	NS	NS	NS	NS
	27-Jan-16	0.082	U	NS	U	0.082	U	0.082	U	NS	0.61	0.88
	20-Apr-16	NS		0.082	U	NS	0.084	NS	0.21	0.15	0.7	NS
	20-Jul-16	0.41	U	NS	U	1.2	0.59	NS	0.82	NS	2.4	1.7
	21-Oct-16	NS		0.49	NS	NS	0.56	NS	0.64	0.76	2.5	1.2
	31-Jan-17	0.1	NS	0.085	U	0.082	U	NS	0.082	U	0.32	0.83
	17-Apr-17	NS		0.12	U	NS	NS	U	0.17	NS	0.41	0.71
	26-Jul-17	0.64	NS	NS	U	0.86	0.76	NS	1.5	NS	1.1	NS
	12-Oct-17	NS		0.15	NS	NS	0.082	U	NS	0.25	0.32	0.39
	10-Jan-18	0.084	NS	0.082	U	0.082	U	NS	0.15	NS	0.28	0.55
	11-Apr-18	NS		0.082	U	NS	0.82	U	0.82	U	0.19 ^M	0.82
	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	0.12	U
	27-Jul-18	0.41	U	NS	U	0.41	U	NS	0.41	U	1.4	0.87
	24-Oct-18	NS		0.41	U	NS	NS	U	0.41	U	0.41	U
	16-Jan-19	0.082	U	NS	U	0.082	U	0.082	U	NS	0.082	U
	12-Apr-19	NS		0.082	U	NS	0.31	NS	0.1	U	0.12	U
	29-Jul-19	0.4	NS	0.12	U	0.74 ^v	NS	0.71 ^v	NS	NS	0.082 ^v	U
	26-Sep-19	NS		NS	NS	NS	NS	NS	NS	NS	1.8 ^v	NS
	29-Oct-19	NS		0.082	U	NS	0.082	U	NS	0.082	U	0.41 ^v
	21-Jan-20	0.08	U	NS	U	0.08	U	0.08	U	0.082	U	0.41 ^v
	22-Apr-20	NS		0.082	U	NS	0.082	U	0.082	U	0.082	U
	23-Jul-20	0.082	U	NS	U	0.082	U	0.082	U	0.082	U	0.082
	29-Oct-20	NS		0.082	U	NS	0.082	U	0.082	U	0.082	U
	19-Jan-21	0.082	U	NS	U	0.082	U	0.082	U	NS	0.082	U
	15-Apr-21	NS		0.082	U	NS	0.082	U	0.082	U	0.0	

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.09	U	NS	NS	NS	NS	NS	0.3	3.15	NS	
	27-Mar-08	NS		0.1	NS	NS	0.177	NS	NS	0.206	0.404	
	25-Apr-08	NS		NS	0.244	NS	NS	NS	0.559	NS	0.351	
	29-May-08	NS		NS	NS	0.17	NS	NS	0.3	0.36	0.27	NS
	27-Jun-08	0.732		NS	NS	0.354	NS	NS	NS	0.598	0.59	
	31-Jul-08	NS		0.276	NS	NS	NS	NS	0.255	NS	0.17	
	28-Aug-08	NS		NS	1.22	NS	NS	0.754	NS	1.02	NS	
	30-Sep-08	NS		NS	2.1	U	NS	NS	2.1	U	2.1	U
	27-Oct-08	2.1	U	NS	NS	2.1	U	NS	NS	2.1	NS	2.1
	25-Nov-08	NS		2.1	U	NS	NS	2.1	NS	2.1	U	NS
	18-Dec-08	NS		NS	2.1	U	NS	NS	NS	2.1	U	2.1
	21-Jan-09	NS		NS	2.1	U	NS	NS	2.1	U	NS	2.1
	25-Feb-09	2.1	U	NS	NS	2.1	U	NS	NS	2.1	U	NS
	26-Mar-09	NS		0.851	U	NS	NS	1.7	U	NS	0.292	0.361
	29-Apr-09	NS		NS	0.174	U	NS	NS	0.085	U	0.098	0.243
	22-Jul-09	0.426	U	NS	0.426	U	0.851	U	0.426	U	0.6	0.149
	9-Oct-09	NS		0.085	U	NS	0.098	NS	0.085	U	0.153	0.204
	15-Jan-10	0.106		NS	0.119		0.089	NS	0.098	NS	0.128	0.221
	21-Apr-10	NS		0.085	U	NS	0.426	U	0.426	U	0.481	0.579
	16-Jul-10	0.57		NS	0.911		0.66	NS	0.643	U	NS	0.34
	15-Oct-10	NS		0.698		NS	1.12	NS	0.779	0.919	0.877	0.864
	26-Jan-11	0.851	U	0.162		NS	0.179	NS	0.426	U	0.426	1.52
	28-Feb-11	NS		NS	0.851	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.311		NS	0.302	NS	0.366	U	0.753	0.749
	26-Jul-11	0.724		NS	0.779		0.868	U	0.788	U	1.23	0.681
	28-Oct-11	NS		2.1	U	NS	2.1	U	2.1	U	2.1	U
	23-Jan-12	0.84		NS	0.43	U	0.43	U	0.43	U	0.46	16
	13-Apr-12	NS		0.43	U	NS	0.43	U	0.43	U	0.43	0.43
Styrene	2-Jul-12 (resample)	NS		NS		NS	NS	NS	NS	NS	NS	2.1
	23-Jun-12	1.7		NS	1.4		1.9	NS	1.9	NS	2.4	2.6
	1-Nov-12	NS		0.14		NS	0.15	NS	0.46	0.17	0.3	0.34
	1-Feb-13	0.085	U	NS	0.085		0.085	U	0.085	U	0.22	0.26
	29-Apr-13	NS		0.22		NS	0.27	NS	0.3	0.36	0.53	0.53
	9-Jul-13	0.43		NS	0.60		0.39	NS	0.43	NS	0.12	0.48
	18-Oct-13	NS		0.25		NS	0.26	NS	0.35	0.50	NS	0.57
	9-Jan-14	0.10		NS	0.10		0.12	NS	0.14	NS	0.44	0.53
	24-Apr-14	NS		0.085		NS	0.085	U	0.085	U	0.21	0.28
	1-Aug-14	0.32		NS	0.64		2.8/3.8	NS	NS	NS	0.45	0.51
	27-Aug-14	NS		NS		NS	NS	2.7/2.9	NS	NS	NS	NS
	12-Sept-14 (resample)	NS		NS		NS	NS	NS	0.81	U	NS	U
	22-Oct-14	NS		0.13	U	NS	0.13	U	0.13	U	1.1	0.98
	20-Jan-15	0.085	U	NS	0.085	U	0.085	U	0.085	U	0.67	0.085
30-Mar-15 (resample)	NS		NS	NS		NS	NS	NS	NS	NS	1.4	NS
	22-Apr-15	NS		0.098		NS	0.085	U	0.099	U	0.12	0.80
	21-Jul-15	0.160 ⁺		NS	0.460 ⁺	4	U	NS	0.23 ^j	NS	1.3 ^v	2.9 ^v
23-Sept-15 resample	NS		NS	NS		NS	NS	NS	0.13 ^j	NS	NS	NS
	29-Oct-15	NS		0.2	U	NS	0.21 ^j	NS	0.4	U	0.2	0.71
4-Dec-15 resample	NS		0.2	U	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.085	U	NS	0.085	U	0.085	U	0.085	U	1.3	3.7
	20-Apr-16	NS		0.085	U	NS	0.09	NS	0.13	0.085	1.5	0.52
	20-Jul-16	0.79 ^l	L	NS	0.88 ^l		0.97 ^l	NS	1 ^l	NS	3.9 ^l	5.9 ^l
	21-Oct-16	NS		0.12		NS	0.18	NS	0.17	0.22	3.2	0.63
	31-Jan-17	0.085	U	NS	0.085	U	0.085	U	NS	NS	0.97	2.8
	17-Apr-17	NS		0.13	U	NS	0.13	NS	0.15	0.41	0.68	0.61
	26-Jul-17	0.18		NS	0.22		0.21	NS	0.32	NS	0.53	2.3
	12-Oct-17	NS		0.14		NS	0.17	NS	0.26	U	0.43	0.79
	10-Jan-18	0.085	U	NS	0.085	U	0.085	U	NS	NS	0.18	0.82
	11-Apr-18	NS		0.085	U	NS	0.85	U	0.85	U	0.085	0.85
	23-May-18	NS		NS		NS	NS	NS	NS	NS	0.42	U
	27-Jul-18	0.43	U	NS	0.43	U	0.43	U	NS	NS	0.68	0.43
	24-Oct-18	NS		0.43	U	NS	0.43	U	0.43	U	0.43	U
	16-Jan-19	0.085	U	NS	0.085	U	0.085	U	NS	NS	0.25	0.29
	12-Apr-19	NS		0.11		NS	0.085	U	0.11	U	0.42	0.88
	29-Jul-19	0.61		NS	0.78		1.1	NS	1.3	NS	0.48	2.8
	26-Sep-19	NS		NS		NS	NS	NS	NS	NS	0.43	NS
	29-Oct-19	NS		0.085	U	NS	0.19	NS	0.085	U	0.43 ^v	0.43 ^v
	21-Jan-20	0.09	U	NS	0.16		0.22	NS	0.12	NS	0.42	1.20
	22-Apr-20	NS		0.085	U	NS	0.085	U	0.085	U	0.12	0.28
	23-Jul-20	0.25		NS	0.085	U	0.085	U	0.34	NS	0.54	1.9
	29-Oct-20	NS		0.12		NS	0.13	NS	0.11	0.13	0.26	0.4
	19-Jan-21	0.085	U									

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.14	U	NS	NS	NS	NS	NS	0.14	U	0.14	U
	27-Mar-08	NS		0.137	U	NS	NS	NS	0.137	U	NS	0.137
	25-Apr-08	NS		NS	U	0.137	U	NS	NS	U	NS	0.137
	29-May-08	NS		NS	U	NS	U	NS	0.14	U	0.14	U
	27-Jun-08	0.214	U	NS	NS	NS	U	NS	0.137	U	NS	0.137
	31-Jul-08	NS		0.137	U	NS	U	NS	NS	U	NS	0.137
	28-Aug-08	NS		NS	U	0.137	U	NS	NS	U	NS	0.137
	30-Sep-08	NS		NS	U	0.14	U	NS	NS	U	0.14	U
	27-Oct-08	0.14	U	NS	NS	NS	U	NS	0.14	U	NS	0.14
	25-Nov-08	NS		0.14	U	NS	U	NS	0.14	U	0.14	U
	18-Dec-08	NS		NS	U	0.14	U	NS	NS	U	0.14	U
	21-Jan-09	NS		NS	U	0.19	U	NS	NS	U	0.14	U
	25-Feb-09	0.14	U	NS	NS	NS	U	NS	NS	U	0.14	U
	26-Mar-09	NS		0.686	U	NS	U	NS	1.37	U	NS	0.137
	29-Apr-09	NS		NS	U	0.137	U	NS	NS	U	0.137	U
	22-Jul-09	0.686	U	NS	28	U	1.37	U	NS	U	0.137	U
	9-Oct-09	NS		0.137	U	NS	U	0.137	U	NS	0.137	U
	15-Jan-10	0.109	U	NS	0.137	U	1.37	U	NS	U	0.137	U
	21-Apr-10	NS		0.137	U	NS	U	0.686	U	NS	0.686	U
	16-Jul-10	0.137	U	NS	0.137	U	0.137	U	NS	U	0.137	U
	15-Oct-10	NS		0.137	U	NS	U	0.137	U	NS	0.137	U
	26-Jan-11	1.37	U	0.137	U	NS	U	0.686	U	NS	0.686	U
	28-Feb-11	NS		NS	U	1.37	U	NS	NS	U	NS	NS
	27-Apr-11	NS		0.137	U	NS	U	0.137	U	NS	0.137	U
	26-Jul-11	0.458	U	NS	0.458	U	0.137	U	NS	U	0.687	U
	28-Oct-11	NS		6.2	U	NS	U	6.2	U	U	6.2	U
	23-Jan-12	1.2	U	NS	1.2	U	1.2	U	NS	U	1.2	U
	13-Apr-12	NS		1.2	U	NS	U	1.2	U	NS	1.2	U
2-Jul-12 (resample)	NS		NS	NS	U	NS	U	NS	NS	U	NS	6.2
	23-Jun-12	1.2	U	NS	1.2	U	1.2	U	NS	U	1.2	U
	1-Nov-12	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	1-Feb-13	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	29-Apr-13	NS		0.62	U	NS	U	0.25	U	NS	0.25	U
	9-Jul-13	0.37	U	NS	0.25	U	0.25	U	NS	U	0.036	U
	18-Oct-13	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	9-Jan-14	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	24-Apr-14	NS		0.25	U	NS	U	0.25 ^L	U	NS	0.25 ^L	U
	1-Aug-14	0.25	U	NS	0.37	U	0.37	U	NS	U	0.25	U
	27-Aug-14	NS		NS	U	NS	U	0.25	U	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	U	NS	U	NS	U	NS	NS	NS
	22-Oct-14	NS		0.37	U	NS	U	0.37	U	NS	0.37	U
	20-Jan-15	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
30-Mar-15 (resample)	NS		NS	NS	U	NS	U	NS	U	NS	NS	NS
	22-Apr-15	NS		0.29	U	NS	U	0.25	U	NS	0.25	U
	27-Jan-16	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	20-Apr-16	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	20-Jul-16	1.2	U	NS	1.2	U	1.2	U	NS	U	1.2	U
	21-Oct-16	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	31-Jan-17	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	17-Apr-17	NS		0.37	U	NS	U	0.37	U	NS	0.37	U
	26-Jul-17	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	12-Oct-17	NS		0.25	U	NS	U	0.25	U	NS	0.76	U
	10-Jan-18	0.25	U	NS	0.25	U	0.25	U	NS	U	0.62	U
	11-Apr-18	NS		0.25	U	NS	U	2.5	U	NS	0.25	U
	23-May-18	NS		NS	U	NS	U	NS	U	NS	0.37	U
	27-Jul-18	1.2	U	NS	1.2	U	1.2	U	NS	U	1.2	U
	24-Oct-18	NS		1.2	U	NS	U	1.2	U	NS	1.2	U
	16-Jan-19	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	12-Apr-19	NS		0.25	U	NS	U	0.25	U	NS	0.31	U
	29-Jul-19	0.37	U	NS	0.37	U	0.25 ^L	U	NS	U	0.37	U
	26-Sep-19	NS		NS	U	NS	U	NS	U	NS	NS	NS
	29-Oct-19	NS		0.25 ^L	U	NS	U	0.25 ^L	U	NS	0.25 ^L	U
	21-Jan-20	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	22-Apr-20	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	23-Jul-20	0.25	U	NS	0.25	U	0.25	U	NS	U	0.5	U
	29-Oct-20	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	19-Jan-21	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	15-Apr-21	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	21-Jul-21	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	20-Oct-21	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	9-Feb-22	0.25	U	NS	0.25	U	0.25	U	NS	U	0.25	U
	7-Apr-22	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	28-Jul-22	0.25	U	NS	0.5	U	0.5	U	NS	U	0.75	U
	18-Oct-22	NS		0.25	U	NS	U	0.25	U	NS	0.25	U
	24-Jan-23	0.25	U	NS	0.25	U	0.25	U	NS	U		

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
8-Feb-08	0.14	U	NS	NS	NS	0.14	U	NS	NS	0.14	U	0.14
27-Mar-08	NS		0.137	U	NS	NS	0.137	U	NS	NS	0.137	U
25-Apr-08	NS		NS	U	0.137	U	NS	NS	0.137	U	NS	0.137
29-May-08	NS		NS	U	0.14	U	NS	NS	0.14	U	0.14	U
27-Jun-08	0.214	U	NS	NS	NS	0.137	U	NS	NS	0.137	U	0.137
31-Jul-08	NS		0.137	U	NS	NS	U	NS	NS	0.137	U	0.137
28-Aug-08	NS		NS	U	0.137	U	NS	NS	0.137	U	0.137	U
30-Sep-08	NS		NS	U	0.14	U	NS	NS	0.14	U	0.14	U
27-Oct-08	0.14	U	NS	NS	NS	0.14	U	NS	NS	0.14	U	0.14
25-Nov-08	NS		0.14	U	NS	NS	U	0.14	NS	0.14	U	NS
18-Dec-08	NS		NS	U	0.14	U	NS	NS	0.14	U	0.14	U
21-Jan-09	NS		NS	U	0.14	U	NS	NS	0.14	U	0.14	U
25-Feb-09	0.14	U	NS	NS	NS	0.14	U	NS	NS	0.14	U	NS
26-Mar-09	NS		0.686	U	NS	NS	U	1.37	U	NS	0.137	U
29-Apr-09	NS		NS	U	0.137	U	NS	NS	0.137	U	NS	0.137
22-Jul-09	0.686	U	NS	28	U	0.137	U	NS	0.686	U	0.137	U
9-Oct-09	NS		0.137	U	NS	0.137	U	NS	0.137	U	28.6	U
15-Jan-10	0.109	U	NS	0.137	U	0.137	U	NS	0.109	U	0.137	U
21-Apr-10	NS		0.137	U	NS	NS	U	0.686	U	0.686	U	0.137
16-Jul-10	0.137	U	NS	0.137	U	0.137	U	NS	1.04	U	0.137	U
15-Oct-10	NS		0.137	U	NS	NS	U	0.137	NS	0.137	U	0.137
26-Jan-11	1.37	U	0.137	U	NS	0.137	U	NS	0.686	U	0.686	U
28-Feb-11	NS		NS	U	1.37	U	NS	NS	NS	NS	NS	NS
27-Apr-11	NS		0.137	U	NS	0.137	U	NS	0.137	U	0.137	U
26-Jul-11	0.458	U	NS	0.458	U	0.137	U	NS	0.687	U	NS	0.687
28-Oct-11	NS		3.4	U	NS	NS	U	3.4	U	3.4	U	3.4
23-Jan-12	0.69	U	NS	0.69	U	0.69	U	NS	0.69	U	0.69	U
13-Apr-12	NS		0.34	U	NS	0.34	U	NS	0.34	U	0.34	U
2-Jul-12 (resample)	NS		NS	U	NS	NS	U	NS	NS	NS	1.7	U
23-Jun-12	0.69	U	NS	0.69	U	0.69	U	NS	0.69	U	0.69	U
1-Nov-12	NS		0.069	U	NS	NS	U	0.069	U	0.069	U	0.069
1-Feb-13	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.069	U
29-Apr-13	NS		0.17	U	NS	NS	U	0.069	U	0.069	U	0.069
9-Jul-13	0.10	U	NS	0.069	U	0.069	U	NS	0.069	U	0.010	U
18-Oct-13	NS		0.14	U	NS	NS	U	0.14	U	0.14	U	0.14
9-Jan-14	0.14	U	NS	0.14	U	0.14	U	NS	0.14	U	0.14	U
24-Apr-14	NS		0.069	U	NS	0.069 ^L	U	NS	.069 ^L	U	0.069 ^{L-V}	U
1-Aug-14	0.14	U	NS	0.21	U	0.21	U	NS	NS	0.140	U	0.21
27-Aug-14	NS		NS	U	NS	NS	U	0.069 ^L	U	NS	NS	NS
12-Sept-14 (resample)	NS		NS	U	NS	NS	U	NS	NS	0.10	U	NS
22-Oct-14	NS		0.10	U	NS	NS	U	0.10	U	0.10	U	0.14
20-Jan-15	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.10	U
30-Mar-15 (resample)	NS		NS	U	NS	NS	U	NS	NS	NS	0.077	U
22-Apr-15	NS		0.070	U	NS	0.069	U	NS	0.069	U	0.069	U
21-Jul-15	0.3	U	NS	1	U	7	U	NS	0.4	U	0.300 ^U	U
23-Sept-15 resample	NS		NS	U	NS	NS	U	NS	NS	0.3	U	NS
29-Oct-15	NS		0.4	U	NS	NS	U	0.4	U	0.3	U	0.3
4-Dec-15 resample	NS		0.3	U	NS	NS	U	NS	NS	NS	NS	NS
27-Jan-16	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.069	U
20-Apr-16	NS		0.069	U	NS	NS	U	0.069	U	0.069	U	0.069
20-Jul-16	0.34	U	NS	0.34	U	0.34	U	NS	0.34	U	0.34	U
21-Oct-16	NS		0.069	U	NS	NS	U	0.069	U	0.069	U	0.069
31-Jan-17	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.069	U
17-Apr-17	NS		0.10	U	NS	NS	U	0.10	U	0.10	U	0.1
26-Jul-17	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.069	U
12-Oct-17	NS		0.069	U	NS	NS	U	0.069	U	0.21	U	0.17
10-Jan-18	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.069	U
11-Apr-18	NS		0.14	U	NS	NS	U	1.4	U	1.4	U	1.4
23-May-18	NS		NS	U	NS	NS	U	NS	NS	NS	NS	NS
27-Jul-18	0.34	U	NS	0.34	U	0.34	U	NS	0.34	U	0.34	U
24-Oct-18	NS		0.34	U	NS	NS	U	0.34	U	0.34	U	0.34
16-Jan-19	0.069	U	NS	0.069	U	0.069	U	NS	0.069	U	0.069	U
12-Apr-19	NS		0.069	U	NS	NS	U	0.069	U	0.1	U	0.1
29-Jul-19	0.1	U	NS	0.1	U	0.069	U	NS	0.069	U	0.069	U
26-Sep-19	NS		NS	U	NS	NS	U	NS	NS	NS	0.1	U
29-Oct-19	NS		0.069	U	NS	NS	U	0.22	NS	0.069	U	0.34 ^D
21-Jan-20	0.07	U	NS	0.07	U	0.07	U	NS	0.07	U	0.07	U
22-Apr-20	NS		0.069	U	NS	NS	U	0.069	U	0.069	U	0.069
23-Jul-20	0.069	U	NS	0.069	U	0.069	U	NS	0.14	U	0.14	U
29-Oct-20	NS		0.069	U	NS	NS	U	0.069	U	0.069	U	

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3		
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	
	8-Feb-08	0.35	NS	NS	0.14	U	NS	NS	0.53	5.05	NS		
	27-Mar-08	NS	0.888	NS	0.875	NS	NS	NS	6.99	5.25			
	25-Apr-08	NS	NS	0.322	NS	0.99	NS	0.83	NS	0.867			
	29-May-08	NS	NS	1.36	NS	NS	NS	0.24	0.3	3.21	NS		
	27-Jun-08	1.32	NS	NS	29.6	NS	NS	NS	NS	5.08	1.8		
	31-Jul-08	NS	0.667	NS	NS	NS	NS	0.618	NS	0.572			
	28-Aug-08	NS	NS	1.55	NS	NS	1.52	NS	1.37	6.26	NS		
	30-Sep-08	NS	NS	3.4	NS	NS	NS	3.4	U	6.1	3.4	U	
	27-Oct-08	4.2	U	NS	10	NS	NS	4.2	U	NS	4.2	U	
	25-Nov-08	NS	21.3	NS	NS	4.6	NS	3.4	U	8.9	NS		
	18-Dec-08	NS	NS	3.4	NS	NS	3.4	NS	NS	3.4	U	3.4	U
	21-Jan-09	NS	NS	NS	NS	NS	NS	3.4	U	NS	3.4	U	
	25-Feb-09	3.4	U	NS	8.3	NS	NS	3.4	U	3.4	U	3.7	NS
	26-Mar-09	NS	1.28	NS	NS	1.36	NS	NS	NS	7.11	2.08		
	29-Apr-09	NS	NS	0.271	NS	NS	0.305	NS	0.237	NS	0.691		
	22-Jul-09	1.63	NS	1.63	2.1	NS	NS	NS	11.8	3.25	NS		
	9-Oct-09	NS	0.556	NS	2.07	NS	0.678	28.3	U	1.17	NS	1.46	
	15-Jan-10	1.31	NS	0.644	1.35	NS	0.691	NS	0.447	0.501	NS		
	21-Apr-10	NS	7.2	NS	31.4	NS	35.5	36.8	62.1	NS	36.1		
	16-Jul-10	12.4	NS	12.7	10.9	NS	10	NS	15.4	19.2	NS		
	15-Oct-10	NS	21.9	NS	37.6	NS	21.3	21.8	22.1	NS	31.6		
	26-Jan-11	1.36	U	0.691	NS	1.27	NS	0.813	2.13	8.3	NS		
	28-Feb-11	NS	NS	1.36	U	NS	NS	NS	NS	NS	NS		
	27-Apr-11	NS	1.44	NS	7.22	NS	1.53	1.56	1.46	NS	1.98		
	26-Jul-11	3.34	NS	0.834	2.59	NS	9.29	NS	0.976	6.78	NS		
	28-Oct-11	NS	3.4	U	NS	8.5	NS	3.4	U	3.4	U	3.4	U
	23-Jan-12	1	NS	0.68	U	1.7	NS	NS	0.76	26	NS		
	13-Apr-12	NS	19	NS	18	NS	12	18	18	NS	15		
	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	9.6	NS		
	23-Jun-12	1.5	NS	0.68	U	3.5	NS	0.8	NS	0.68	U	8.9	NS
	1-Nov-12	NS	7.4	NS	NS	11	NS	0.78	0.57	1.3	NS	1.6	
	1-Feb-13	1.8	NS	0.76	0.99	NS	4.5	NS	NS	1.8	7.7	NS	
	29-Apr-13	NS	8.1	NS	NS	4.7	NS	1.1	1	1.3	NS	1.8	
	9-Jul-13	2.0	NS	2.1	3.1	NS	2.9	NS	NS	2.6	8.8	NS	
	18-Oct-13	NS	14	NS	7.3	NS	0.61	0.32	0.32	NS	1.4		
	9-Jan-14	0.6	NS	0.22	1.1	NS	1.8	NS	0.46	11	NS		
	24-Apr-14	NS	4.7	NS	5.7	NS	0.41	0.068	0.51	10	0.30		
	1-Aug-01	2.3	NS	3.3/4.9	2.1	NS	NS	NS	0.97	4.0/5.9	NS		
	27-Aug-14	NS	NS	NS	NS	NS	2.4/3.5	NS	NS	NS	NS		
Tetrachloroethene*	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	0.34	NS	NS	NS	U	
	22-Oct-14	NS	6.9	NS	NS	5.0	0.61	0.43	0.10	0.10	4.0	NS	
	20-Jan-15	0.9	NS	0.20	0.37	NS	1.0	NS	0.52	0.21	NS		
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	3.0	NS		
	22-Apr-15	NS	5.3	NS	2.6	NS	0.85	0.48/0.52	1.7	NS	1.5		
	21-Jul-15	0.34	NS	1	7	U	NS	3.2	NS	0.44 ^v	4.0 ^v	NS	
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	1.5	NS	NS	NS		
	29-Oct-15	NS	18	NS	3.6	NS	1.2	6.6	0.18 ^j	NS	0.65		
	4-Dec-15 resample	NS	14	NS	NS	NS	NS	NS	NS	NS	NS		
	27-Jan-16	3.1	NS	0.19	0.71	NS	0.63	NS	0.19	6.7	NS		
	20-Apr-16	NS	9.7	NS	3.4	NS	0.22	0.11	0.14	NS	0.47		
	20-Jul-16	0.5	NS	0.99	1.6	NS	4.8	NS	0.71	5.6	NS		
	21-Oct-16	NS	40	NS	4.6	NS	0.75	0.83	0.39	NS	0.93		
	31-Jan-17	0.33	NS	0.23	0.79	NS	0.75	NS	0.15	12	NS		
	17-Apr-17	NS	8.1	NS	3.2	NS	0.99	0.16	0.21	NS	1.1		
	26-Jul-17	0.26	NS	0.34	1.3	NS	1.1	NS	0.22	5.4	NS		
	12-Oct-17	NS	7.5	NS	4.2	NS	0.44	0.43	0.41	NS	1.7		
	10-Jan-18	0.21	NS	0.15	0.64	NS	2	NS	0.33	NS	4.9		
	11-Apr-18	NS	10	NS	1.8	NS	1.4	U	0.24	NS	2		
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	1.4	NS		
	27-Jul-18	0.68	U	NS	0.68	U	2.2	NS	0.68	18	NS		
	24-Oct-18	NS	6.1	NS	6.8	NS	0.68	0.68	0.68	NS	0.68	U	
	16-Jan-19	0.44	NS	0.27	0.97	NS	1.8	NS	0.24	5.9	NS		
	12-Apr-19	NS	11	NS	2.3	NS	0.29	0.2	0.2	NS	2.2		
	29-Jul-19	0.86	NS	0.92	1.4	NS	6.7	NS	0.4	5.9	NS		
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	4.7	NS		
	29-Oct-19	NS	21	NS	7.2	NS	0.14	0.16	0.68 ^v	7 ^v	0.68 ^v	U	
	21-Jan-20	0.20	NS	0.14	0.41	NS	1.30	NS	1.20	7.30	NS		
	22-Apr-20	NS	2	NS	0.91	NS	0.14	0.14	0.53	NS	0.88		
	23-Jul-20	0.74	NS	0.75	0.84	NS	4.5	NS	0.84	8.2	NS		
	29-Oct-20	NS	7.3	NS	2.6	NS	0.44	1.6	0.44	NS	0.89		
	19-Jan-21	1.4	NS										

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	1.63	NS	NS	NS	1.8	NS	NS	2.72	455	NS	
	27-Mar-08	NS	2.24	NS	NS	1.45	NS	NS	11.3	16.1		
	25-Apr-08	NS	NS	1.39	NS	NS	1.34	NS	11.2	NS	21.8	
	29-May-08	NS	NS	NS	7.74	NS	NS	11.6	21	13	NS	
	27-Jun-08	14.7	NS	NS	NS	2.33	NS	NS	NS	10.6	22.2	
	31-Jul-08	NS	4.15	NS	NS	NS	NS	NS	10.2	NS	6.11	
	28-Aug-08	NS	NS	6.48	NS	NS	3.44	NS	10	11.2	NS	
	30-Sep-08	NS	NS	NS	1.9	U	NS	NS	6.1	NS	7.5	8.6
	27-Oct-08	56.3	NS	NS	NS	3.2	NS	NS	NS	6.6	NS	8.2
	25-Nov-08	NS	7.8	NS	NS	7.8	NS	NS	29.9	18.6	NS	
	18-Dec-08	NS	NS	2	NS	NS	1.9	U	NS	4.8	4.9	
	21-Jan-09	NS	NS	NS	1.9	U	NS	NS	1.9	U	NS	1.9
	25-Feb-09	7	NS	NS	1.9	U	NS	NS	1.9	U	13.8	NS
	26-Mar-09	NS	3.53	NS	NS	3.92	NS	NS	NS	7.23	9.75	
	29-Apr-09	NS	NS	1.99	NS	NS	0.651	NS	0.149	NS	4.56	
	22-Jul-09	38.7	NS	38.7	2.22	NS	4.71	NS	NS	80.1	5.32	NS
	9-Oct-09	NS	3.53	NS	3.06	NS	1.07	23.6	3.12	NS	3.67	
	15-Jan-10	12.8	NS	4.17	4.33	NS	5.81	NS	4.81	4.85	NS	
	21-Apr-10	NS	0.9	NS	NS	2.97	NS	3.75	5.2	2.84	NS	5.08
	16-Jul-10	22.2	NS	17.9	5.98	NS	5.54	NS	NS	5.77	5.85	NS
	15-Oct-10	NS	1.67	NS	NS	2.1	NS	1.72	3.37	2.23	NS	3.26
	26-Jan-11	6.06	6.82	NS	6.82	NS	4.74	NS	5.95	12.1	11.9	NS
	28-Feb-11	NS	NS	1.88	NS	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.836	NS	0.682	NS	1.25	3.62	2.08	NS	1.62	
	26-Jul-11	8.29	NS	3.96	1.15	NS	1.62	NS	NS	2.31	1.68	NS
	28-Oct-11	NS	1.9	NS	NS	1.9	U	1.9	U	3.3	4.7	3.8
	23-Jan-12	7.9	NS	3.8	1.9	NS	3.4	NS	NS	5.2	15	NS
	13-Apr-12	NS	0.75	NS	0.38	U	0.38	U	1.3	2.4	NS	1.5
Toluene	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	1.9	U	NS
	23-Jun-12	8.5	NS	3.5	1.5	NS	2.5	NS	NS	2.4	1.8	NS
	1-Nov-12	NS	2	NS	NS	1.7	NS	2.3	2.8	2.8	NS	4.5
	1-Feb-13	2.4	NS	0.69	0.69	NS	0.71	NS	NS	1.4	1.6	NS
	29-Apr-13	NS	1.7	NS	NS	1.3	NS	1.7	2.1	3.1	NS	3.9
	9-Jul-13	11	NS	3.0	2.0	NS	2.5	NS	NS	6.8	3.4	NS
	18-Oct-13	NS	2.3	NS	3.1	NS	2.8	7.5	1.3	NS	1.9	
	9-Jan-14	10	NS	7.6	8.6	NS	10	NS	NS	20	16	NS
	24-Apr-14	NS	0.23	NS	0.22	NS	0.25	0.36	0.28	0.25	1.1	
	1-Aug-14	2.7	NS	2.8/3.2	1.3/1.4	NS	NS	NS	NS	1.6	1.9	NS
	27-Aug-14	NS	NS	NS	NS	NS	2.2/2.8	NS	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	1.5	NS	NS	NS	U
	22-Oct-14	NS	0.34	NS	0.32	0.48	0.94	0.51	1.2	1.2	1.2	NS
	20-Jan-15	1.5	NS	0.6	0.6	NS	0.44	NS	NS	1.4	1.5	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	1.2	NS
	22-Apr-15	NS	0.95	NS	0.59	NS	1.2	1.4/1.6	3.4	NS	4.3	
	21-Jul-15	3.8	NS	4.5	4	U	NS	2	NS	5.4 ^v	7.6 ^v	NS
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	1.4	NS	NS	NS	
	29-Oct-15	NS	0.41	NS	0.55	NS	0.64	1.1	1.2	NS	2.8	
	4-Dec-15 resample	NS	0.42	NS	NS	NS	NS	NS	NS	NS	NS	
	27-Jan-16	1.5	NS	0.5	0.4	NS	0.44	NS	NS	1.2	0.89	NS
	20-Apr-16	NS	0.62	NS	0.77	NS	1.3	0.85	3.5	NS	1.8	
	20-Jul-16	1.2 ^w	NS	1.9 ^w	0.77 ^w	NS	1.2 ^w	NS	1.6 ^w	44 ^w	NS	
	21-Oct-16	NS	0.56	NS	2.6	NS	1.8	4.2	1.9	NS	2.5	
	31-Jan-17	1.1	NS	1.2	1.0	NS	0.98	NS	NS	2.2	1.8	NS
	17-Apr-17	NS	1.0	NS	1.1	NS	1.3	1.5	1.0	NS	1.5	
	26-Jul-17	1.1	NS	1.5	0.73	NS	1.2	NS	1.8	1.4	NS	
	12-Oct-17	NS	0.41	NS	0.47	NS	0.55	1	0.99	NS	0.81	
	10-Jan-18	0.88	NS	0.99	1.1	NS	1	NS	2.4	NS	1.7	
	11-Apr-18	NS	0.61	NS	0.75	U	0.75	U	0.75	3.4	NS	1.9
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	0.72	NS	
	27-Jul-18	1.2	NS	1.9	0.75	NS	1.6	NS	1.4	0.9	NS	
	24-Oct-18	NS	0.49	NS	0.38	U	0.47	1.2	1.4	NS	1.5	
	16-Jan-19	1.4	NS	0.65	0.7	NS	0.77	NS	1.6	1.2	NS	
	12-Apr-19	NS	0.48	NS	0.34	NS	0.24	1.1	1.5	NS	0.88	
	29-Jul-19	1.6	NS	2	1.9	NS	3.2	NS	1.3	2.2	NS	
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	2.2	NS
	29-Oct-19	NS	3	NS	0.89	NS	0.79	3.4	2.7 ^v	4.5 ^v	2.7 ^v	
	21-Jan-20	0.82	NS	1.30	1.50	NS	1.00	NS	3.40	4.20	NS	
	22-Apr-20	NS	0.13	NS	0.59	NS	0.081	U	0.46	1.1	NS	1.4
	23-Jul-20	4.2	NS	2.8	2.3	NS	3.8	NS	3.5	4.8	NS	
	29-Oct-20	NS	0.92	NS	0.9	NS	0.88	3.2	2	NS	2.5	
	19-Jan-21	0.59	NS	0.45	0.3	NS	0.					

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.11	U	NS	NS	NS	NS	NS	0.11	U	0.56	NS
	27-Mar-08	NS		0.109	U	NS	NS	NS	0.109	U	0.522	0.266
	25-Apr-08	NS		NS	U	0.109	U	NS	NS	U	0.119	
	29-May-08	NS		NS	U	NS	0.12	NS	NS	U	0.54	NS
	27-Jun-08	0.17	U	NS	NS	NS	0.458	NS	NS	NS	0.377	0.138
	31-Jul-08	NS		0.109	U	NS	NS	NS	NS	U	0.109	U
	28-Aug-08	NS		NS	U	0.109	U	NS	NS	U	0.492	NS
	30-Sep-08	NS		NS	U	2.7	U	NS	NS	U	2.7	U
	27-Oct-08	3.4	U	NS	U	NS	3.4	U	NS	U	3.4	U
	25-Nov-08	NS		2.7	U	NS	NS	2.7	U	NS	2.7	U
	18-Dec-08	NS		NS	U	2.7	U	NS	NS	U	2.7	U
	21-Jan-09	NS		NS	U	2.7	U	NS	NS	U	2.7	U
	25-Feb-09	2.7	U	NS	U	NS	2.7	U	NS	U	2.7	U
	26-Mar-09	NS		1.59	U	NS	NS	1.09	U	NS	0.682	0.213
	29-Apr-09	NS		NS	U	0.174	U	NS	0.147	NS	0.158	NS
	22-Jul-09	0.545	U	NS	U	22.2	U	1.09	U	NS	0.109	0.278
	9-Oct-09	NS		0.109	U	NS	0.158	NS	0.191	22.8	U	0.136
	15-Jan-10	0.109	U	NS	U	0.109	U	0.109	U	NS	0.109	NS
	21-Apr-10	NS		0.109	U	NS	0.545	U	0.545	U	0.109	1.09
	16-Jul-10	0.109	U	NS	U	0.109	U	0.824	U	NS	0.109	NS
	15-Oct-10	NS		0.272	U	NS	0.349	NS	0.109	U	0.109	0.109
	26-Jan-11	1.09	U	0.109	U	NS	0.109	U	0.545	U	0.545	NS
	28-Feb-11	NS		NS	U	1.09	U	NS	NS	U	NS	NS
	27-Apr-11	NS		0.109	U	NS	0.109	U	0.109	U	0.109	0.109
	26-Jul-11	0.364	U	NS	U	0.364	U	0.109	U	0.873	U	0.546
	28-Oct-11	NS		2.7	U	NS	NS	2.7	U	NS	2.7	U
	23-Jan-12	0.55	U	NS	U	0.55	U	NS	1.5	U	0.55	1.3
	13-Apr-12	NS		0.27	U	NS	0.27	U	NS	U	0.27	0.27
2-Jul-12 (resample)	NS		NS	NS	U	NS	NS	NS	NS	U	NS	NS
	23-Jun-12	0.55	U	NS	U	0.55	U	0.55	U	NS	0.55	0.7
	1-Nov-12	NS		0.25	NS	NS	0.27	NS	0.055	U	0.055	0.14
	1-Feb-13	0.055	U	NS	U	0.055	U	0.83	NS	NS	0.055	NS
	29-Apr-13	NS		0.15	NS	NS	0.076	NS	0.055	U	0.055	0.055
	9-Jul-13	0.082	U	NS	U	0.061	NS	0.33	NS	NS	0.055	NS
	18-Oct-13	NS		0.23	NS	NS	0.19	NS	0.11	U	0.11	0.28
	9-Jan-14	0.11	U	NS	U	0.11	U	0.41	NS	NS	0.11	NS
	24-Apr-14	NS		0.055	U	NS	0.055	U	0.055	U	0.055	0.16
	1-Aug-14	0.11	U	NS	U	0.16	U	NS	NS	U	0.11	NS
1,1,1-Trichloroethane*	27-Aug-14	NS		NS	NS	NS	NS	0.35	NS	NS	NS	NS
	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	0.082	U	0.082	NS
	22-Oct-14	NS		0.19	NS	NS	0.19	0.082	U	0.082	U	0.28
	20-Jan-15	0.055	U	NS	U	0.055	U	0.31	NS	NS	0.082	0.055
	30-Mar-15 (resample)	NS		NS	NS	NS	NS	NS	0.055	U	0.14	NS
	22-Apr-15	NS		0.056	U	NS	0.055	U	0.055	U	0.055	0.063
	21-Jul-15	0.3	U	NS	U	1	5	U	0.27 ^j	NS	0.3 ^v	0.3 ^v
	23-Sept-15 resample	NS		NS	NS	NS	NS	NS	NS	U	NS	NS
	29-Oct-15	NS		0.36	NS	NS	0.3	U	0.5	U	0.3	0.3
	4-Dec-15 resample	NS		0.23 ^j	NS	NS	NS	NS	NS	NS	NS	NS
4-Jan-16	27-Jan-16	0.055	U	NS	U	0.055	U	0.24	NS	NS	0.055	0.4
	20-Apr-16	NS		0.2	NS	NS	0.098	NS	0.055	U	0.055	0.074
	20-Jul-16	0.27	U	NS	U	0.27	U	0.59	U	NS	0.28	NS
	21-Oct-16	NS		0.59	NS	NS	0.19	NS	0.083	U	0.094	1.4
	31-Jan-17	0.13	NS	NS	U	0.055	U	0.2	NS	NS	0.055	NS
	17-Apr-17	NS		0.12	NS	NS	0.082	U	0.082	U	0.082	0.082
	26-Jul-17	0.055	U	NS	U	0.055	U	0.12	NS	NS	0.055	NS
	12-Oct-17	NS		0.12	NS	NS	0.15	NS	0.17	U	0.28	0.14
	10-Jan-18	0.055 ^b	U	NS	U	0.055 ^b	U	0.29 ^b	NS	NS	0.055 ^b	0.37 ^b
	11-Apr-18	NS		0.12	NS	NS	1.1	U	1.1	U	0.110	1.1
27-Jul-18	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	0.082	NS
	27-Jul-18	0.27	U	NS	U	0.27	U	0.27	U	NS	0.27	NS
	24-Oct-18	NS		0.27	U	NS	0.27	U	0.27	U	0.27	0.27
	16-Jan-19	0.055	U	NS	U	0.055	U	0.2	NS	NS	0.055	NS
	12-Apr-19	NS		0.16	NS	NS	0.055	U	0.068	U	0.082	0.082
	29-Jul-19	0.082	U	NS	U	0.082	U	0.1	NS	NS	0.076	1.3
	26-Sep-19	NS		NS	NS	NS	NS	NS	NS	NS	NS	NS
	29-Oct-19	NS		0.22	NS	NS	0.055	U	0.055	U	0.27 ^v	0.27 ^v
	21-Jan-20	0.06	U	NS	U	0.06	U	0.15	NS	NS	0.06	0.24
	22-Apr-20	NS		0.055	U	NS	0.055	U	0.055	U	0.055	0.055
19-Jan-21	23-Jul-20	0.055	U	NS	U	0.055	U	0.11	U	NS	0.11	0.27
	29-Oct-20	NS		0.055	U	NS	0.098	NS	0.055	U	0	

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.11	U	NS	NS	NS	NS	NS	0.11	U	0.11	U
	27-Mar-08	NS	U	0.109	U	NS	NS	NS	0.109	U	NS	0.109
	25-Apr-08	NS	U	NS	0.109	U	NS	NS	0.109	U	NS	0.109
	29-May-08	NS	U	NS	NS	U	NS	NS	0.11	U	0.11	U
	27-Jun-08	0.17	U	NS	NS	NS	0.109	U	NS	NS	0.109	U
	31-Jul-08	NS	U	0.109	U	NS	NS	NS	NS	0.109	U	0.109
	28-Aug-08	NS	U	NS	0.109	U	NS	NS	0.109	U	0.109	U
	30-Sep-08	NS	U	NS	NS	U	NS	NS	0.11	U	0.11	U
	27-Oct-08	0.11	U	NS	NS	U	NS	NS	NS	0.11	U	0.11
	25-Nov-08	NS	U	0.11	U	NS	NS	0.11	U	NS	0.11	U
	18-Dec-08	NS	U	NS	0.11	U	NS	NS	0.11	U	0.11	U
	21-Jan-09	NS	U	NS	NS	U	NS	NS	0.11	U	0.11	U
	25-Feb-09	0.11	U	NS	NS	U	NS	NS	NS	0.11	U	NS
	26-Mar-09	NS	U	0.545	U	NS	NS	1.09	U	NS	0.109	U
	29-Apr-09	NS	U	NS	0.109	U	NS	NS	0.109	U	NS	0.109
	22-Jul-09	0.545	U	NS	22.2	U	1.09	U	0.545	U	NS	0.109
	9-Oct-09	NS	U	0.109	U	NS	0.109	U	NS	0.109	U	0.109
	15-Jan-10	0.109	U	NS	0.109	U	1.09	U	0.081	U	NS	0.109
	21-Apr-10	NS	U	0.109	U	NS	NS	0.545	U	NS	0.545	U
	16-Jul-10	0.109	U	NS	0.109	U	NS	0.824	U	NS	1.09	U
	15-Oct-10	NS	U	0.109	U	NS	0.109	U	NS	0.109	U	0.109
	26-Jan-11	1.09	U	0.109	U	NS	0.109	U	0.545	U	NS	0.545
	28-Feb-11	NS	U	NS	1.09	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	U	0.109	U	NS	0.109	U	NS	0.109	U	0.109
	26-Jul-11	0.364	U	NS	0.364	U	0.109	U	0.546	U	NS	0.546
	28-Oct-11	NS	U	2.7	U	NS	NS	2.7	U	2.7	U	2.7
	23-Jan-12	0.55	U	NS	0.55	U	0.55	U	NS	NS	0.55	U
	13-Apr-12	NS	U	0.27	U	NS	0.27	U	NS	0.27	U	0.27
2-Jul-12 (resample)	NS	U	NS	NS	U	NS	NS	NS	NS	NS	1.4	U
	23-Jun-12	0.55	U	NS	0.55	U	0.55	U	0.5	U	NS	0.55
	1-Nov-12	NS	U	0.055	U	NS	NS	0.055	U	0.055	U	0.055
	1-Feb-13	0.055	U	NS	0.055	U	0.055	U	NS	0.055	U	0.055
	29-Apr-13	NS	U	0.14	U	NS	0.055	U	NS	0.055	U	0.055
	9-Jul-13	0.082	U	NS	0.055	U	0.055	U	NS	0.055	U	0.055
	18-Oct-13	NS	U	0.11	U	NS	0.11	U	NS	0.11	U	0.11
	9-Jan-14	0.11	U	NS	0.11	U	0.11	U	NS	0.11	U	NS
	24-Apr-14	NS	U	0.055	U	NS	0.055	U	NS	0.055	U	0.055
	1-Aug-14	0.11	U	NS	0.16	U	0.16	U	NS	0.11	U	NS
1,1,2-Trichloroethane	27-Aug-14	NS	U	NS	NS	U	NS	0.055	U	NS	NS	NS
	12-Sept-14 (resample)	NS	U	NS	NS	U	NS	NS	0.082	U	NS	NS
	22-Oct-14	NS	U	0.082	U	NS	0.082	U	0.082	U	0.082	U
	20-Jan-15	0.055	U	NS	0.055	U	0.055	U	NS	NS	0.055	U
	30-Mar-15 (resample)	NS	U	NS	NS	U	NS	NS	NS	NS	NS	NS
	22-Apr-15	NS	U	0.056	U	NS	0.055	U	NS	0.055	U	0.063
	21-Jul-15	0.3	U	NS	1	U	5	U	NS	NS	0.3	U
	23-Sept-15 resample	NS	U	NS	NS	U	NS	NS	NS	NS	NS	NS
	29-Oct-15	NS	U	0.3	U	NS	NS	0.3	U	0.5	U	0.3
	4-Dec-15 resample	NS	U	0.3	U	NS	NS	NS	NS	NS	NS	NS
27-Jan-16	0.055	U	NS	0.055	U	0.055	U	0.055	U	NS	0.055	U
	20-Apr-16	NS	U	0.055	U	NS	0.055	U	0.055	U	0.055	U
	20-Jul-16	0.27	U	NS	0.27	U	0.27	U	NS	NS	0.27	U
	21-Oct-16	NS	U	0.055	U	NS	0.055	U	0.055	U	0.055	U
	31-Jan-17	0.055	U	NS	0.055	U	0.055	U	NS	NS	0.055	U
	17-Apr-17	NS	U	0.082	U	NS	NS	0.082	U	0.082	U	0.082
	26-Jul-17	0.055	U	NS	0.055	U	0.055	U	NS	NS	0.055	U
	12-Oct-17	NS	U	0.055	U	NS	0.055	U	0.17	U	0.14	U
	10-Jan-18	0.055	U	NS	0.055	U	0.055	U	NS	NS	0.055	U
	11-Apr-18	NS	U	0.11	U	NS	1.1	U	1.1	U	0.11	U
23-May-18	NS	U	NS	NS	U	NS	NS	NS	NS	NS	0.082	U
	27-Jul-18	0.27	U	NS	0.27	U	0.27	U	NS	NS	0.27	U
	24-Oct-18	NS	U	0.27	U	NS	0.27	U	NS	0.27	U	0.27
	16-Jan-19	0.055	U	NS	0.055	U	0.055	U	NS	NS	0.055	U
	12-Apr-19	NS	U	0.055	U	NS	0.055	U	0.068	U	0.082	U
	29-Jul-19	0.082	U	NS	0.082	U	0.055	U	NS	NS	1.5	U
	26-Sep-19	NS	U	NS	NS	U	NS	NS	NS	NS	0.082	U
	29-Oct-19	NS	U	0.055	U	NS	0.055	U	0.055	U	0.27 ^b	U
	21-Jan-20	0.06	U	NS	0.06	U	0.06	U	NS	0.06	U	0.27 ^b
	22-Apr-20	NS	U	0.055	U	NS	0.055	U	0.055	U	0.055	U
23-Jul-20	0.055	U	NS	0.055	U	0.055	U	0.11	U	NS	0.11	U

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.12	NS	NS	0.11	U	NS	NS	0.2	19.6	NS
	27-Mar-08	NS	0.107	U	NS	0.152	NS	NS	NS	13.4	5.34
	25-Apr-08	NS	NS	0.199	NS	1.35	NS	0.668	NS	3.39	
	29-May-08	NS	NS	NS	26.5	NS	NS	0.15	0.37	13.6	NS
	27-Jun-08	0.408	NS	NS	258	NS	NS	NS	NS	13.6	6.56
	31-Jul-08	NS	1.24	NS	NS	NS	NS	NS	0.126	NS	3.26
	28-Aug-08	NS	NS	0.558	NS	3.56	NS	0.432	18.4	NS	
	30-Sep-08	NS	NS	NS	56.2	NS	NS	0.8	NS	22.7	3.95
	27-Oct-08	0.8	U	NS	117	NS	NS	NS	2.99	NS	0.8
	25-Nov-08	NS	2.92	NS	NS	1.89	NS	NS	0.54	U	39.8
	18-Dec-08	NS	0.54	U	NS	NS	0.54	U	NS	4.56	2.48
	21-Jan-09	NS	NS	NS	19.6	NS	NS	0.54	U	NS	4.99
	25-Feb-09	0.44	NS	NS	99.5	NS	NS	NS	0.56	10.7	NS
	26-Mar-09	NS	9.2	NS	NS	3.88	NS	NS	NS	25.1	5.49
	29-Apr-09	NS	NS	0.22	NS	1.2	NS	0.392	NS	2.96	
	22-Jul-09	0.537	U	NS	0.537	U	NS	NS	0.354	10.3	NS
	9-Oct-09	NS	0.091	U	NS	26	NS	22.4	U	0.182	3.26
	15-Jan-10	0.591	NS	0.242	17.7	NS	0.172	NS	0.107	U	18.5
	21-Apr-10	NS	0.107	U	NS	34	NS	0.94	0.537	U	0.891
	16-Jul-10	0.333	NS	0.333	8.14	NS	0.811	U	NS	0.107	27.8
	15-Oct-10	NS	2.26	NS	129	NS	1.92	0.177	0.317	NS	1.3
	26-Jan-11	1.07	U	1.63	NS	0.537	U	0.617	1.23	27.1	NS
	28-Feb-11	NS	NS	1.07	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.231	NS	78.1	NS	0.891	0.107	U	0.107	1.56
	26-Jul-11	1.18	NS	0.358	U	29.6	NS	NS	NS	0.247	20.5
	28-Oct-11	NS	2.7	U	NS	110	NS	2.7	U	2.7	U
	23-Jan-12	0.88	NS	0.54	U	6.8	NS	NS	NS	0.54	44
	13-Apr-12	NS	0.27	U	NS	83	NS	0.27	U	0.27	NS
Trichloroethene*	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	32	NS
	23-Jun-12	1.1	NS	0.54	U	92	NS	0.75	NS	0.54	35
	1-Nov-12	NS	2.4	NS	NS	92	NS	1.9	0.32	0.28	6.9
	1-Feb-13	0.85	NS	0.064	21	NS	5.6	NS	NS	0.077	20
	29-Apr-13	NS	1.7	NS	NS	46	NS	0.84	0.12	0.44	1.9
	9-Jul-13	0.60	NS	0.22	27	NS	2.6	NS	NS	0.14	22
	18-Oct-13	NS	3.3	NS	NS	76	NS	2.2	0.48	0.66	15
	9-Jan-14	0.49	NS	0.11	U	36	NS	1.8	NS	0.13	43
	24-Apr-14	NS	1.0	NS	NS	58	NS	0.81	0.13	1.0	2.4
	1-Aug-14	2.70	NS	0.23	15/19	NS	NS	NS	NS	1.2	16/18
Trichloroethene*	27-Aug-14	NS	NS	NS	NS	NS	2.6/3.4	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	0.30	NS	NS	NS
	22-Oct-14	NS	1.3	NS	NS	88	0.97	1.4	0.19	0.17	18
	20-Jan-15	0.52	NS	0.054	U	24	NS	1.3	NS	0.081	U
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	0.80	0.078	U	0.054
	22-Apr-15	NS	0.96	NS	NS	35	NS	0.80	0.57	NS	3.6
	21-Jul-15	0.2	U	NS	1	U	15	NS	NS	0.99 ^v	24 ^v
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	0.44	NS	NS	NS
	29-Oct-15	NS	4.1	NS	NS	54	NS	3.3	0.89	0.55	7.3
	4-Dec-15 resample	NS	2.1	NS	NS	NS	NS	NS	NS	NS	NS
Trichloroethene*	27-Jan-16	2.3	NS	0.13	25	NS	0.98	NS	NS	0.27	36
	20-Apr-16	NS	1.8	NS	NS	76	NS	0.8	0.17	0.39	9.4
	20-Jul-16	0.47	NS	0.6	28	NS	3.8	NS	NS	0.63	21
	21-Oct-16	NS	7.6	NS	NS	66	NS	1.1	0.31	0.18	5.7
	31-Jan-17	0.23	NS	0.11	32	NS	0.71	NS	NS	0.054	44
	17-Apr-17	NS	1.4	NS	NS	58	NS	0.66	0.081	U	NS
	26-Jul-17	0.23	NS	0.13	33	NS	1.4	NS	NS	0.31	25
	12-Oct-17	NS	1.8	NS	NS	88	NS	0.76	0.38	0.15	NS
	10-Jan-18	0.19	NS	0.054	U	29	NS	2.1	NS	0.43	65
	11-Apr-18	NS	2.1	NS	NS	41	NS	1.1	U	0.13	37
Trichloroethene*	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	7.0	NS
	27-Jul-18	0.27	U	NS	0.27	U	140	NS	0.27	U	74
	24-Oct-18	NS	1.7	NS	NS	110	NS	0.69	0.27	U	NS
	16-Jan-19	0.29	NS	0.054	U	47	NS	1.4	NS	0.054	42
	12-Apr-19	NS	1.8	NS	NS	45	NS	0.38	0.081	U	21
	29-Jul-19	0.4	NS	0.15	23	NS	4.7	NS	NS	0.24	21
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	22
	29-Oct-19	NS	4.8	NS	NS	33	NS	0.054	0.11	0.27 ^v	23 ^v
	21-Jan-20	0.15	NS	0.05	U	10.00	NS	1.10	NS	0.06	11 ^v
	22-Apr-20	NS	0.54	NS	NS	20	NS	0.19	0.054	U	1.4
Trichloroethene*	23-Jul-20	0.69	NS	0.12	18	NS	2.6	NS	NS	0.11	32
	29-Oct-20	NS	2.3	NS	NS	45	NS	0.6	0.2	0.18	1.9
	19-Jan-21	1	NS	0.054	U	5.8	NS	0.054	U	0.71	10 ^v
	15-Apr-21	NS	0.66	NS	NS	18	NS	0.054	U	0.11	NS
	21-Jul-21	0.24	NS	0.054	U	3	NS	0.72	NS	0.16	14
	20-Oct-21	NS	1.5	NS	NS	43	NS	0.41	0.1	0.13	1.2
	9-Feb-22	0									

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	1.22	NS	NS	NS	1.22	NS	NS	1.06	15.9	NS
	27-Mar-08	NS	1.27	NS	NS	1.18	NS	NS	NS	12	9.02
	25-Apr-08	NS	NS	1.18	NS	NS	5.2	NS	1.66	NS	3.83
	29-May-08	NS	NS	NS	33.5	NS	NS	0.98	1.05	10.6	NS
	27-Jun-08	1.29	NS	NS	NS	75.2	NS	NS	NS	8.85	8.89
	31-Jul-08	NS	1.01	NS	NS	NS	NS	NS	0.958	NS	5.1
	28-Aug-08	NS	NS	2.53	NS	NS	18	NS	1.79	15.6	NS
	30-Sep-08	NS	NS	NS	53.8	NS	NS	2.8	U	NS	14.5
	27-Oct-08	2.8	U	NS	10	NS	44.4	NS	6.1	NS	2.8
	25-Nov-08	NS	NS	2.8	U	NS	12.2	NS	2.8	U	NS
	18-Dec-08	NS	NS	NS	NS	NS	4.9	NS	NS	4.8	7.1
	21-Jan-09	NS	NS	NS	26.9	NS	NS	7.2	2.8	U	NS
	25-Feb-09	2.8	U	NS	NS	14.8	NS	NS	2.8	U	7.1
	26-Mar-09	NS	1.43	NS	NS	2.81	U	NS	NS	19.6	10.3
	29-Apr-09	NS	NS	1.45	NS	NS	4.23	NS	1.27	NS	3.17
	22-Jul-09	1.46	NS	1.46	19.9	NS	NS	NS	1.28	6.46	NS
	9-Oct-09	NS	0.156	NS	20	NS	11	58.6	U	1.65	NS
	15-Jan-10	1.39	NS	2.1	16.6	NS	1.78	NS	NS	1.34	15.4
	21-Apr-10	NS	0.466	NS	NS	10.1	NS	4.83	1.4	U	4.95
	16-Jul-10	2.6	NS	1.84	16.4	NS	2.12	U	NS	2.23	19.8
	15-Oct-10	NS	9.63	NS	NS	72.2	NS	13.7	5.65	9.85	10
	26-Jan-11	2.81	U	1.16	NS	13.8	NS	1.4	U	1.71	26
	28-Feb-11	NS	NS	2.81	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	1.12	NS	NS	12.8	NS	3.24	1.27	1.17	NS
	26-Jul-11	4.27	NS	1.31	41.2	U	15.3	NS	NS	1.62	10
	28-Oct-11	NS	2.8	U	NS	30	NS	5.1	2.8	U	2.9
	23-Jan-12	2.1	NS	1.5	28	NS	29	NS	NS	1.4	16
	13-Apr-12	NS	1.9	NS	15	NS	6.4	2.1	2	NS	8.8
Trichlorofluoromethane	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	21
	23-Jun-12	2.4	NS	1.1	85	NS	2.2	NS	NS	1.2	15
	1-Nov-12	NS	3.3	NS	NS	33	NS	6.7	1.2	1.2	NS
	1-Feb-13	2.1	NS	1.6	15	NS	17	NS	NS	1.6	5.6
	29-Apr-13	NS	2.6	NS	8.3	NS	3.1	1.5	1.6	NS	2.7
	9-Jul-13	1.4	NS	2.2	33	NS	3.3	NS	NS	3.6	5.5
	18-Oct-13	NS	4.0	NS	19	NS	6.9	3.0	1.6	NS	20
	9-Jan-14	1.6	NS	1.8	21	NS	11	NS	1.8	11	NS
	24-Apr-14	NS	2.3	NS	10	NS	3.5	1.7	2.4	9.3	4.3
	1-Aug-14	2.9	NS	1.7/1.6	23/26	NS	NS	NS	NS	2.4	6.2
	27-Aug-14	NS	NS	NS	NS	NS	7.0/6.6	NS	NS	NS	NS
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	1.5	NS	NS	NS
	22-Oct-14	NS	2.7	NS	NS	28	4.2	7.0	1.7	1.4	7.4
	20-Jan-15	1.6	NS	1.5	9.1	NS	5.2	NS	NS	1.3	1.4
30-Mar-15 (resample)	NS	NS	7.8 ^v	NS	NS	15 ^v	NS	3.5	1.7/2.0	NS	2.8
	22-Apr-15	NS	1.0 ^j	19	NS	3.2	NS	NS	0.98 ^v	2.9 ^v	3.4
	21-Jul-15	0.87	NS	1.0 ^j	19	NS	3.2	NS	NS	NS	NS
23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	0.98	NS	NS	NS
	29-Oct-15	NS	4.3	NS	NS	11	NS	2.6	0.93	0.8	1.8
4-Dec-15 resample	NS	2.5	NS	NS	NS	NS	7.6 ^{m,v}	NS	NS	NS	NS
	27-Jan-16	2.5 ^{m,v}	NS	1.9 ^{m,v}	19 ^{m,v}	NS	7.6 ^{m,v}	NS	2.4 ^{m,v}	7.6 ^{m,v}	NS
	20-Apr-16	NS	2.3	NS	NS	8.8	NS	2.5	1.6	1.4	4.3
	20-Jul-16	1.3	NS	1.6	16	NS	4.2	NS	NS	1.7	4
	21-Oct-16	NS	4.7	NS	NS	15	NS	3.8	1.5	1.3	5.9
	31-Jan-17	1.4	NS	1.5	35	NS	3.9	NS	NS	1.4	9.1
	17-Apr-17	NS	2.7	NS	NS	8.6	NS	3.1	1.7	1.7	8.2
	26-Jul-17	0.98	NS	0.98	19	NS	1.9	NS	NS	1.1	3.4
	12-Oct-17	NS	2.3	NS	NS	18	NS	3.8	1.8	1.5	2.2
	10-Jan-18	1.2	NS	1.3	9.1	NS	4.6	NS	NS	1.1	11
	11-Apr-18	NS	2.1	NS	NS	5.3	NS	4.5	U	1.4	9.9
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	2.2	NS
	27-Jul-18	2.2	U	NS	2.2	U	24	NS	NS	2.2	6
	24-Oct-18	NS	2.6	NS	NS	14	NS	3.4	2.2	U	NS
	16-Jan-19	1.1	NS	1.2	16	NS	2.9	NS	1.2	5.1	NS
	12-Apr-19	NS	1.8	NS	NS	4.5	NS	2	1.2	1.1	7.8
	29-Jul-19	1.6	NS	1.2	13	NS	3.9	NS	NS	1.3	4.3
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	4.6
	29-Oct-19	NS	3.6	NS	NS	5.6	NS	1.7	1.7	2.2 ^v	2.2 ^v
	21-Jan-20	1.30	NS	1.20	7.70	NS	3.10	NS	NS	1.20	4.90
	22-Apr-20	NS	2	NS	NS	4.6	NS	2.1	1.6	1.7	2.5
	23-Jul-20	1.7	NS	1.8 ^w	19 ^w	NS	3.3	NS	NS	1.4	5
	29-Oct-20	NS	2.2	NS	NS	9.5	NS	3	1.5	1.4	2.7
	19-Jan-21	1.4	NS	1.1	3.6	NS	1.1	NS	NS	1.4	2.5 ^t
	15-Apr-21	NS	1.6	NS	NS	3.4	NS	1.4	1.3	1.3	1.4
	21-Jul-21	1.4	NS	1.3	4.4	NS	1.7	NS	NS	1.4	2.4
	20-Oct-21	NS	2	NS	NS	7.8	NS	2.3	1.4	1.4	1.9
	9-Feb-22	1.5	NS	1.5	5	NS	3.3	NS	NS	1.4	4.4
	7-Apr-22	NS	1.4	NS	NS	1.6	NS	3.4	1.2	1.2	1.8
	28-Jul-22	1.3 ^m	NS	1.5	1.4	NS	4.4	NS	NS		

Summary of Subslab Air Sampling Data

Alvarez School

Volatile Organic Compounds

February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.21	NS	NS	NS	0.23	NS	NS	0.69	1.93	NS	
	27-Mar-08	NS	0.304	NS	NS	0.152	NS	NS	0.958	0.681		
	25-Apr-08	NS	NS	1.72	NS	NS	0.644	NS	0.517	NS	0.338	
	29-May-08	NS	NS	NS	0.6	NS	NS	1	1.26	0.48	NS	
	27-Jun-08	7.46	NS	NS	NS	1.15	NS	NS	NS	0.638	0.736	
	31-Jul-08	NS	1.86	NS	NS	NS	NS	NS	0.885	NS	0.685	
	28-Aug-08	NS	NS	0.838	NS	NS	NS	NS	0.669	0.653	NS	
	30-Sep-08	NS	NS	NS	2.5	U	NS	NS	NS	2.5	2.5	U
	27-Oct-08	11.4	NS	NS	NS	2.5	U	NS	NS	NS	5.2	NS
	25-Nov-08	NS	2.5	U	NS	NS	2.5	U	NS	6.4	NS	
	18-Dec-08	NS	NS	2.5	U	NS	NS	2.5	U	NS	2.5	U
	21-Jan-09	NS	NS	NS	2.5	U	NS	NS	2.5	2.5	NS	2.5
	25-Feb-09	17.5	NS	NS	NS	4	NS	NS	6.2	2.9	NS	
	26-Mar-09	NS	0.491	U	NS	NS	0.982	U	NS	1.09	1.55	
	29-Apr-09	NS	NS	0.265	U	NS	NS	0.378	NS	0.707	0.801	
	22-Jul-09	3.49	NS	NS	20	U	0.982	NS	NS	56.4	0.86	NS
	9-Oct-09	NS	0.707	NS	NS	0.781	NS	0.648	20.5	1.36	0.584	
	15-Jan-10	2.87	NS	0.354	0.29	NS	0.314	NS	1.06	1.17	NS	
	21-Apr-10	NS	0.211	NS	NS	0.933	NS	1.42	1.13	0.653	0.702	
	16-Jul-10	8.3	NS	8.23	8.09	NS	6.27	NS	NS	4.28	5.05	NS
	15-Oct-10	NS	1.29	NS	NS	1.61	NS	1.1	1.38	1.86	NS	2.35
	26-Jan-11	1.23	1.4	NS	1.6	NS	0.491	U	NS	6.93	10.4	NS
	28-Feb-11	NS	NS	0.982	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.845	NS	NS	0.855	NS	1.24	1.06	2.06	NS	1.09
	26-Jul-11	1.29	NS	2.67	0.61	NS	0.541	NS	NS	2.48	0.541	NS
	28-Oct-11	NS	2.5	U	NS	2.5	U	NS	2.5	U	3.7	NS
	23-Jan-12	3	NS	0.76	0.49	U	NS	0.71	NS	NS	2.7	NS
	13-Apr-12	NS	0.49	U	NS	0.49	U	NS	1.1	3.9	NS	1.3
2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	2.5	U	NS
	23-Jun-12	4.1	NS	1.3	1.2	NS	1.1	NS	NS	2.1	1.1	NS
	1-Nov-12	NS	1.7	NS	NS	2.5	NS	3.1	3	3.2	NS	3.3
	1-Feb-13	1.2	NS	0.23	0.21	NS	0.3	NS	NS	1	0.86	NS
	29-Apr-13	NS	0.54	NS	NS	0.74	NS	0.66	0.83	1	NS	0.84
	9-Jul-13	4.2	NS	1.6	1.8	NS	1.8	NS	NS	2	2.0	NS
	18-Oct-13	NS	4.8	NS	NS	4.3	NS	5.6	6.4	5.0	NS	5.7
	9-Jan-14	2.7	NS	2.7	3.8	NS	3.8	NS	NS	12.0	13.0	NS
	24-Apr-14	NS	0.098	U	NS	0.098	U	0.13	0.098	0.5	0.1	2.6
	1-Aug-14	4.1	NS	6.5/5.1	3.0/3.6	NS	NS	NS	NS	2.6	6.3/4.3	NS
	27-Aug-14	NS	NS	NS	NS	1.1	NS	NS	NS	NS	NS	NS
1,2,4-Trimethylbenzene	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	NS	1.2	NS	NS	U
	22-Oct-14	NS	0.37	NS	NS	0.28	0.6	0.59	0.50	1.0	1.2	NS
	20-Jan-15	0.19	NS	0.098	U	0.098	U	0.098	U	NS	0.3	0.4
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.55	NS
	22-Apr-15	NS	0.27	NS	NS	0.17	NS	0.24	0.33/0.37	0.33	NS	0.43
	21-Jul-15	0.44	NS	1.1	5	U	NS	0.89	NS	0.47 ^v	0.66 ^v	NS
23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	NS	1.7	NS	NS	
	29-Oct-15	NS	0.43	NS	NS	0.78	NS	0.87	0.64	0.48	NS	0.76
4-Dec-15 resample	NS	0.2	U	NS	NS	NS	NS	NS	NS	NS	NS	
	27-Jan-16	0.32	NS	0.098	U	0.17	NS	0.098	U	NS	0.55	0.38
	20-Apr-16	NS	0.39	NS	NS	0.57	NS	0.79	0.49	1	NS	0.94
	20-Jul-16	2.2	NS	2.6	2.3	NS	2.4	NS	NS	3.2	2.6	NS
	21-Oct-16	NS	0.8	NS	NS	0.74	NS	1.1	1.2	1.6	NS	1.3
	31-Jan-17	1.3	NS	0.61	0.69	NS	0.74	NS	NS	5.1	4.9	NS
	17-Apr-17	NS	0.16	NS	NS	0.21	NS	0.2	0.2	0.29	NS	0.33
	26-Jul-17	0.28	NS	0.098	U	0.3	NS	0.36	NS	0.34	0.29	NS
	12-Oct-17	NS	0.95	NS	NS	0.58	NS	2.6	2.1	1.9	NS	1.6
	10-Jan-18	0.14	NS	0.098	U	0.18	NS	0.12	NS	0.88	NS	0.76
	11-Apr-18	NS	0.31 ^m	NS	NS	0.98	U	0.98	U	0.098	U	0.98
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.15	U
	27-Jul-18	0.49	U	NS	0.49	U	NS	0.49	U	0.49	U	NS
	24-Oct-18	NS	0.49	U	NS	0.49	U	0.49	U	0.49	U	0.49
	16-Jan-19	0.098	U	NS	0.098	U	0.098	U	0.098	U	0.098	U
	12-Apr-19	NS	0.098	U	NS	0.098	U	0.12	U	0.15	U	0.15
	29-Jul-19	2.9	NS	3.1	4.3	NS	5.3	NS	NS	1.9	3.3	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.5	NS
	29-Oct-19	NS	1.9	NS	NS	1.5	NS	0.3	1.7	2.2 ^v	2.7 ^v	2 ^v
	21-Jan-20	0.17	NS	0.25	0.24	NS	0.22	NS	NS	2.10	3.10	NS
	22-Apr-20	NS	0.098	U	NS	0.098	U	0.098	U	0.098	NS	0.098
	23-Jul-20	0.098	U	NS	0.098	U	0.2	U	NS	3.9	4.9	NS
	29-Oct-20	NS	0.098	U	NS	0.098	U	0.098	U	0.098		

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.1	U	NS	NS	NS	NS	NS	0.47	0.66	NS	
	27-Mar-08	NS		0.14	NS	NS	0.098	U	NS	NS	0.349	0.275
	25-Apr-08	NS		NS	1.6	NS	NS	NS	0.192	NS	0.134	
	29-May-08	NS		NS	NS	0.18	NS	NS	0.32	0.43	NS	
	27-Jun-08	5.16		NS	NS	0.463	NS	NS	NS	NS	0.236	0.25
	31-Jul-08	NS		0.713	NS	NS	NS	NS	0.276	NS	0.224	
	28-Aug-08	NS		NS	0.497	NS	NS	NS	0.215	NS	0.248	NS
	30-Sep-08	NS		NS	2.5	U	NS	NS	2.5	U	NS	2.5
	27-Oct-08	7.8		NS	NS	2.5	U	NS	NS	U	NS	2.5
	25-Nov-08	NS		2.5	U	NS	NS	2.5	NS	U	NS	2.5
	18-Dec-08	NS		NS	2.5	U	NS	NS	2.5	U	NS	2.5
	21-Jan-09	NS		NS	2.5	U	NS	NS	2.5	U	NS	2.5
	25-Feb-09	9.1		NS	NS	2.5	U	NS	NS	U	NS	2.5
	26-Mar-09	NS		0.491	U	NS	NS	0.982	U	NS	0.337	0.425
	29-Apr-09	NS		NS	0.147	U	NS	NS	0.128	NS	0.211	0.241
	22-Jul-09	3		NS	20	U	0.982	U	NS	NS	22.7	0.275
	9-Oct-09	NS		0.216	U	NS	0.241	NS	0.187	20.5	0.388	0.226
	15-Jan-10	2.15		NS	0.118	U	0.098	U	0.108	NS	0.29	0.334
	21-Apr-10	NS		0.098	U	NS	0.491	U	0.491	U	0.177	0.206
	16-Jul-10	2.76		NS	1.88		1.81	NS	1.67	NS	1.08	1.25
	15-Oct-10	NS		0.418	NS	NS	0.383	NS	0.275	0.324	0.545	0.54
	26-Jan-11	0.982	U	0.437	NS	0.472	NS	0.491	U	0.491	1.99	2.87
	28-Feb-11	NS		NS	0.982	U	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.255	U	NS	0.27	NS	0.368	0.329	0.599	0.354
	26-Jul-11	0.688		NS	0.885		0.182	NS	0.492	U	0.664	0.492
	28-Oct-11	NS		2.5	U	NS	2.5	U	NS	2.5	U	2.5
	23-Jan-12	0.99		NS	0.49	U	0.49	U	0.49	U	0.71	0.83
	13-Apr-12	NS		0.49	U	NS	0.49	U	0.49	U	1.1	0.49
2-Jul-12 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	NS	2.5	U
	23-Jun-12	1.6		NS	0.49	U	0.49	U	0.49	U	0.49	0.49
	1-Nov-12	NS		0.25	NS	NS	0.39	NS	0.53	0.5	0.56	0.63
	1-Feb-13	0.42		NS	0.098	U	0.098	U	0.098	U	0.3	0.24
	29-Apr-13	NS		0.25	U	NS	0.22	NS	0.18	0.22	0.3	0.27
	9-Jul-13	1.5		NS	0.39		0.37	NS	0.38	NS	0.43	0.44
	18-Oct-13	NS		0.53	NS	NS	0.52	NS	0.75	0.99	0.44	0.53
	9-Jan-14	0.77		NS	0.69		0.96	NS	0.98	NS	2.9	3.1
	24-Apr-14	NS		0.098	U	NS	0.098	U	0.098	U	0.14	0.098
	1-Aug-14	0.90		NS	1.00		0.60	NS	NS	NS	0.46	0.86
	27-Aug-14	NS		NS	NS		NS	0.23	NS	NS	NS	NS
1,3,5-Trimethylbenzene	12-Sept-14 (resample)	NS		NS	NS	NS	NS	NS	0.15	U	0.15	U
	22-Oct-14	NS		0.15	U	NS	0.15	U	0.15	U	0.15	0.20
	20-Jan-15	0.098	U	NS	0.098	U	0.098	U	0.098	U	0.15	0.11
	30-Mar-15 (resample)	NS		NS	NS	NS	NS	NS	NS	NS	0.11	U
	22-Apr-15	NS		0.10	U	NS	0.098	U	0.098	U	0.14	0.12
	21-Jul-15	0.2	U	NS	1	U	5	U	NS	NS	0.20 ^v	0.14 ^{j,v}
23-Sept-15 resample	NS		NS	NS	NS	NS	NS	NS	0.48	NS	NS	NS
	29-Oct-15	NS		0.3	U	NS	NS	0.16 ^j	NS	0.4	0.13 ^j	0.17 ^j
4-Dec-15 resample	NS		0.2	U	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	0.1		NS	0.098	U	0.098	U	0.098	U	0.13	0.098
	20-Apr-16	NS		0.098	U	NS	0.098	U	0.098	U	0.26	0.18
	20-Jul-16	0.78		NS	1.2		0.88	NS	0.96	NS	1.3	1
	21-Oct-16	NS		0.17	NS	NS	0.18	NS	0.19	0.28	0.53	0.34
	31-Jan-17	0.36		NS	0.13		0.15	NS	0.15	NS	1.3	1.2
	17-Apr-17	NS		0.15	U	NS	0.15	U	0.15	U	0.15	0.15
	26-Jul-17	0.098	U	NS	0.098	U	0.098	U	0.098	U	0.098	U
	12-Oct-17	NS		0.16	NS	NS	0.16	NS	0.3	U	0.4	0.25
	10-Jan-18	0.098	U	NS	0.098	U	0.098	U	0.098	U	0.17	0.12
	11-Apr-18	NS		0.098	U	NS	0.98	U	0.98	U	0.098	0.98
	23-May-18	NS		NS	NS	NS	NS	NS	NS	NS	0.15	U
	27-Jul-18	0.49	U	NS	0.49	U	0.49	U	0.49	U	0.49	NS
	24-Oct-18	NS		0.49	U	NS	0.49	U	0.49	U	0.49	0.49
	16-Jan-19	0.1		NS	0.098	U	0.098	U	0.098	U	0.098	0.12
	12-Apr-19	NS		0.098	U	NS	0.098	U	0.12	U	0.15	0.25
	29-Jul-19	0.68		NS	0.75		1	NS	1.2	NS	0.53	1.8
	26-Sep-19	NS		NS	NS		NS	NS	NS	NS	NS	0.15
	29-Oct-19	NS		0.4	NS	NS	0.47	NS	0.098	U	0.55 ^v	0.73 ^v
	21-Jan-20	0.10	U	NS	0.10	U	0.10	U	0.10	U	0.54	0.87
	22-Apr-20	NS		0.098	U	NS	0.098	U	0.098	U	0.29	0.41
	23-Jul-20	0.3		NS	0.098	U	0.098	U	0.2	U	0.2	NS
	29-Oct-20	NS		0.098	U	NS	0.098	U	0.098	U	0.34	0.37
	19-Jan-21	0.098	U	NS	0.098	U	0.098	U	0.098	U	0.2	0.27 ^f
	15-Apr-21	NS										

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
	8-Feb-08	0.05	U	NS	NS	NS	NS	NS	0.05	U	0.05	U
	27-Mar-08	NS		0.051	U	NS	NS	NS	0.051	U	0.051	U
	25-Apr-08	NS		NS	U	NS	NS	NS	0.75		NS	U
	29-May-08	NS		NS	U	0.05	U	NS	0.05	U	0.05	U
	27-Jun-08	0.08	U	NS	NS	NS	0.051	U	NS	NS	0.051	U
	31-Jul-08	NS		0.051	U	NS	NS	NS	NS	NS	0.051	U
	28-Aug-08	NS		NS	U	0.051	U	NS	0.051	U	0.051	U
	30-Sep-08	NS		NS	U	0.1	U	NS	0.1	U	0.1	U
	27-Oct-08	0.1	U	NS	U	NS	0.1	U	NS	0.1	NS	U
	25-Nov-08	NS		0.1	U	NS	NS	0.1	U	NS	0.1	U
	18-Dec-08	NS		NS	U	0.1	U	NS	0.1	U	0.1	U
	21-Jan-09	NS		NS	U	0.1	U	NS	NS	0.1	NS	U
	25-Feb-09	0.1	U	NS		NS	0.1	U	NS	0.1	U	NS
	26-Mar-09	NS		0.255	U	NS		0.511	U	NS	0.051	U
	29-Apr-09	NS		NS	U	0.061	U	NS	0.051	U	NS	U
	22-Jul-09	0.255	U	NS	U	0.255	U	NS	0.255	U	0.051	U
	9-Oct-09	NS		1.72		NS	0.051	U	NS	0.102	10.7	
	15-Jan-10	0.051	U	NS		0.061	U	NS	0.051	U	0.051	U
	21-Apr-10	NS		0.051	U	NS		0.255	U	0.255	U	0.051
	16-Jul-10	0.051	U	NS		1.98	U	NS	0.386	U	0.051	U
	15-Oct-10	NS		0.051	U	NS		0.051	U	0.051	U	0.051
	26-Jan-11	0.511	U	0.051	U	NS	0.051	U	0.255	U	0.255	U
	28-Feb-11	NS		NS		0.511	U	NS	NS	NS	NS	NS
	27-Apr-11	NS		0.051	U	NS		0.051	U	0.051	U	0.051
	26-Jul-11	0.17	U	NS		0.17	U	0.256	U	NS	0.051	NS
	28-Oct-11	NS		1.3	U	NS		1.3	U	1.3	U	1.3
	23-Jan-12	0.26	U	NS		0.26	U	NS	0.26	U	0.26	U
	13-Apr-12	NS		0.13	U	NS		0.13	U	0.13	U	0.13
2-Jul-12 (resample)	NS		NS		NS		NS		NS		NS	NS
	23-Jun-12	0.26	U	NS		0.26	U	0.26	U	NS	0.26	U
	1-Nov-12	NS		0.026	U	NS		0.026	U	0.026	U	0.026
	1-Feb-13	0.065		NS		0.026	U	0.026	U	NS	0.026	U
	29-Apr-13	NS		0.41		NS		0.045	NS	0.026	U	0.026
	9-Jul-13	0.038	U	NS		0.026	U	0.085	U	NS	0.026	U
	18-Oct-13	NS		0.051	U	NS		0.074	NS	0.051	U	0.051
	9-Jan-14	0.092		NS		0.051	U	NS	0.051	U	0.051	U
	24-Apr-14	NS		0.026	U	NS		0.026	U	0.026	U	0.077
	1-Aug-14	0.21		NS		0.38	U	0.077	U	NS	0.051	U
	27-Aug-14	NS		NS		NS		0.026	U	NS	NS	NS
Vinyl chloride*	12-Sept-14 (resample)	NS		NS		NS		NS	NS	0.038	U	NS
	22-Oct-14	NS		0.038	U	NS		0.038	U	0.038	U	0.051
	20-Jan-15	0.093 ^v		NS		0.14 ^v	U	0.026	U	0.24	0.038	U
30-Mar-15 (resample)	NS		NS		NS		NS		NS	NS	0.038	U
	22-Apr-15	NS		0.069 ^v		NS		0.060 ^v	NS	0.026	U	0.029
	21-Jul-15	0.090 ^j		NS		0.5	U	3	0.097 ^j	NS	0.096 ^{j,u}	0.100 ^v
23-Sept-15 resample	NS		NS		NS		NS		NS	0.1	NS	NS
	29-Oct-15	NS		0.13 ^j		NS		0.1	U	0.1	U	0.1
4-Dec-15 resample	NS		0.14		NS		NS		NS	NS	NS	NS
	27-Jan-16	0.026	U	NS		0.2		0.026	U	0.064	U	0.026
	20-Apr-16	NS		0.23		NS		0.072	NS	0.026	U	0.026
	20-Jul-16	0.13 ^l	U	NS		0.29 ^l		0.13 ^l	U	0.54 ^l	NS	0.13 ^l
	21-Oct-16	NS		0.34		NS		0.026	U	NS	0.026	NS
	31-Jan-17	0.11		NS		0.27		0.026	U	0.15	NS	0.026
	17-Apr-17	NS		0.19		NS		0.038	U	0.038	U	0.038
	26-Jul-17	0.026	U	NS		0.3		0.026	U	NS	0.026	U
	12-Oct-17	NS		0.31		NS		0.026	U	0.077	U	0.064
	10-Jan-18	0.19		NS		0.24		0.026	U	0.32	NS	0.026
	11-Apr-18	NS		0.051	U	NS		0.51 ^v	U	0.51 ^v	U	0.51 ^v
	23-May-18	NS		NS		NS		NS		NS	0.077	U
	27-Jul-18	0.26	U	NS		0.26	U	NS	0.26	U	0.26	U
	24-Oct-18	NS		0.26	U	NS		0.26	U	0.26	U	0.26
	16-Jan-19	0.27		NS		0.2		0.051	U	0.33	NS	0.051
	12-Apr-19	NS		0.35		NS		0.051	U	NS	0.077	U
	29-Jul-19	0.077	U	NS		0.077	U	0.051	U	0.051	U	0.077
	26-Sep-19	NS		NS		NS		NS		NS	0.077	U
	29-Oct-19	NS		0.051	U	NS		0.051	U	0.051	U	0.26 ^g
	21-Jan-20	0.05	U	NS		0.05	U	0.05	U	NS	0.05	U
	22-Apr-20	NS		0.051	U	NS		0.051	U	0.051	U	0.051
	23-Jul-20	0.051	U	NS		0.68		0.051	U	0.1	U	0.1
	29-Oct-20	NS		0.051	U	NS		0.051	U	0.051	U	0.051
	19-Jan-21	0.2		NS		0.051	U	NS	0.051	U	0.051	U
	15-Apr-21	NS		0.051	U	NS		0.051	U	0.051	U	0.051
	21-Jul-21	0.051	U	NS		0.41		0.051	U	0.051	U	0.051
	20-Oct-21	NS		0.051	U							

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
p/m-Xylene	8-Feb-08	0.55	NS	NS	NS	0.63	NS	NS	1.04	18.3	NS	
	27-Mar-08	NS	0.893	NS	NS	0.389	NS	NS	2.17	1.33		
	25-Apr-08	NS	NS	0.815	NS	NS	0.97	NS	2.54	1.81		
	29-May-08	NS	NS	NS	5	NS	NS	7.58	10.1	3.34	NS	
	27-Jun-08	12.6	NS	NS	NS	1.5	NS	NS	1.91	2.33		
	31-Jul-08	NS	2.4	NS	NS	NS	NS	NS	2.08	NS	1.55	
	28-Aug-08	NS	NS	2.33	NS	NS	1.44	NS	2.13	1.94	NS	
	30-Sep-08	NS	NS	NS	4.3	U	NS	NS	4.3	4.3	U	4.3
	27-Oct-08	41.6	NS	NS	NS	4.3	U	NS	4.3	NS	4.3	U
	25-Nov-08	NS	4.7	NS	NS	4.3	U	NS	8.5	8.9	NS	
	18-Dec-08	NS	NS	4.3	U	NS	4.3	U	NS	4.3	U	4.3
	21-Jan-09	NS	NS	NS	4.3	U	NS	NS	4.3	4.3	U	4.3
	25-Feb-09	37.6	NS	NS	NS	4.3	U	NS	8	9.3	NS	
	26-Mar-09	NS	1.35	NS	NS	1.74	U	NS	NS	2.59	3.56	
	29-Apr-09	NS	NS	0.468	NS	NS	0.516	NS	0.933	NS	1.06	
	22-Jul-09	25.6	NS	25.6	1.74	U	NS	NS	165	3.52	NS	
	9-Oct-09	NS	1.62	NS	1.63	NS	0.915	36.2	1.74	NS	1.7	
	15-Jan-10	18.4	NS	1.52	1.48	NS	1.76	NS	2.35	2.65	NS	
	21-Apr-10	NS	0.703	NS	NS	3.28	NS	4.58	4.34	6.22	NS	4.77
	16-Jul-10	21.8	NS	7.01	6.36	NS	4.82	NS	NS	4.95	4.91	NS
	15-Oct-10	NS	1.81	NS	NS	2.18	NS	1.7	1.88	3.4	NS	2.88
	26-Jan-11	3.08	4.24	NS	4.37	NS	3.06	NS	3.17	11.5	13.6	NS
	28-Feb-11	NS	NS	1.74	U	NS	NS	NS	NS	NS	NS	
	27-Apr-11	NS	0.694	NS	NS	0.707	NS	0.889	1.15	1.09	NS	1.44
	26-Jul-11	9.99	NS	3.96	1.02	NS	0.999	NS	NS	0.956	1.26	NS
	28-Oct-11	NS	4.3	U	NS	4.3	U	NS	4.3	4.3	U	4.3
	23-Jan-12	7.9	NS	2	1.3	NS	2	NS	NS	4.4	14	NS
	13-Apr-12	NS	0.87	U	NS	0.87	U	NS	0.87	3.6	NS	1.1
	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	4.3	U	NS
	23-Jun-12	12	NS	1.1	0.87	U	NS	0.94	NS	1.7	1.1	NS
	1-Nov-12	NS	2.1	NS	NS	2.4	NS	3.3	2.9	3.6	NS	5.3
	1-Feb-13	3.4	NS	0.44	0.38	NS	0.59	NS	NS	1.5	1.4	NS
	29-Apr-13	NS	1	NS	NS	1.2	NS	1.2	1.5	1.9	NS	2.4
	9-Jul-13	12	NS	1.9	1.8	NS	1.7	NS	NS	3.2	0.70	NS
	18-Oct-13	NS	5.0	NS	NS	5.6	NS	6.3	8.0	4.7	NS	5.9
	9-Jan-14	8.6	NS	7.2	9.3	NS	9.7	NS	NS	23	22.00	NS
	24-Apr-14	NS	0.17	U	NS	0.17	U	NS	0.17	0.28	0.17	U
	1-Aug-14	4.8	NS	2.8/3.0	1.8/2.1	NS	NS	NS	NS	1.5	2.4/2.8	NS
	27-Aug-14	NS	NS	NS	NS	3.6	NS	NS	NS	NS	NS	
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	NS	1.3	NS	NS	U
	22-Oct-14	NS	0.26	U	NS	0.26	U	0.30	0.5	0.26	0.76	0.92
	20-Jan-15	1.1	NS	0.21	0.30	NS	0.20	NS	NS	0.7	0.90	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	1.1	NS
	22-Apr-15	NS	0.71	NS	NS	0.40	NS	0.8	0.66/0.76	1.3	NS	1.6
	21-Jul-15	1.5	NS	1.7 ^j	9	U	NS	1.9	NS	1.8 ^v	2.3 ^v	NS
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	0.71	NS	NS	NS
	29-Oct-15	NS	0.29 ^j	NS	NS	0.47 ^j	NS	0.73	0.90	0.8	NS	1
	4-Dec-15 resample	NS	0.4	U	NS	NS	NS	NS	NS	NS	NS	NS
	27-Jan-16	2.4	NS	0.51	0.64	NS	0.64	NS	NS	2.5	2.7	NS
	20-Apr-16	NS	1	NS	NS	1.5	NS	2.1	1.4	2.7	NS	2.5
	20-Jul-16	16	NS	1.4	0.91	NS	1.3	NS	NS	9.3	3.2	NS
	21-Oct-16	NS	0.43	NS	NS	1.1	NS	0.77	2	4.1	NS	1.7
	31-Jan-17	2	NS	0.5	0.55	NS	0.45	NS	NS	3.3	1.9	NS
	17-Apr-17	NS	0.26	U	NS	0.27	NS	0.27	0.26	0.57	NS	0.49
	26-Jul-17	1.6	NS	0.93	0.74	NS	1.4	NS	NS	1.3	0.96	NS
	12-Oct-17	NS	0.58	NS	NS	0.68	NS	0.83	1	0.89	NS	0.96
	10-Jan-18	1.4	NS	0.33	0.62	NS	0.53	NS	NS	3.4	NS	1.3
	11-Apr-18	NS	0.35	NS	NS	1.7	U	NS	1.7	0.97	NS	1.7
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	0.31	NS	
	27-Jul-18	0.87	U	NS	0.87	U	0.87	U	NS	0.87	0.87	U
	24-Oct-18	NS	0.87	U	NS	0.87	U	NS	2	0.87	1.6	NS
	16-Jan-19	1.5	NS	0.24	0.35	NS	0.42	NS	NS	0.88	1.1	NS
	12-Apr-19	NS	0.3	NS	NS	0.36	NS	0.28	0.52	0.6	NS	1.2
	29-Jul-19	17	NS	17	21	NS	25	NS	NS	12	13	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	4	NS
	29-Oct-19	NS	2.4	NS	NS	1.8	NS	0.64	2.6	4.4 ^v	6.1 ^v	4 ^v
	21-Jan-20	0.83	NS	1.10	0.94	NS	0.69	NS	NS	3.30	3.80	NS
	22-Apr-20	NS	0.17	U	NS	0.17	U	NS	0.17	1.2	NS	1.6
	23-Jul-20	2.7	NS	0.99	0.99	NS	1.2	NS	NS	2.5	4.6	NS
	29-Oct-20	NS	0.53	NS	NS	0.55	NS	0.45	0.71	1.5	NS	2.3
	19-Jan-21	0.4	NS	0.22	0.19	NS	0.26	NS	NS	1.1	0.98 ^f	NS
	15-Apr-21	NS	0.25	NS	NS	0.17	U	NS	0.17	0.23	0.62	0.32
	21-Jul											

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3	
	Sample Date	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual	Qual
o-Xylene	8-Feb-08	0.2	NS	NS	0.23	NS	NS	NS	0.48	7.73	NS	
	27-Mar-08	NS	0.273	NS	NS	0.142	NS	NS	NS	0.844	0.478	
	25-Apr-08	NS	NS	0.37	NS	NS	0.406	NS	0.735	NS	0.62	
	29-May-08	NS	NS	NS	1.48	NS	NS	2.26	2.84	1.02	NS	
	27-Jun-08	4.12	NS	NS	0.55	NS	NS	NS	NS	0.672	0.794	
	31-Jul-08	NS	0.835	NS	NS	NS	NS	NS	0.748	NS	0.564	
	28-Aug-08	NS	NS	0.804	NS	NS	0.511	NS	0.797	0.725	NS	
	30-Sep-08	NS	NS	NS	2.2	U	NS	NS	2.2	U	2.2	U
	27-Oct-08	9.8	NS	NS	2.2	U	NS	NS	2.2	U	NS	4
	25-Nov-08	NS	2.2	U	NS	NS	2.2	U	NS	N	2.2	U
	18-Dec-08	NS	NS	2.2	U	NS	NS	2.2	U	NS	2.2	U
	21-Jan-09	NS	NS	NS	2.2	U	NS	NS	2.2	U	NS	2.2
	25-Feb-09	8.9	NS	NS	2.2	U	NS	NS	2.2	U	3.2	NS
	26-Mar-09	NS	0.486	NS	NS	0.868	U	NS	NS	NS	0.922	1.28
	29-Apr-09	NS	NS	0.174	NS	NS	0.208	NS	0.369	NS	0.499	
	22-Jul-09	5.34	NS	5.34	0.868	U	NS	1.39	NS	72.7	1.27	NS
	9-Oct-09	NS	0.542	NS	0.586	NS	0.343	18.1	U	0.629	NS	0.616
	15-Jan-10	4.51	NS	0.49	0.49	NS	0.56	NS	0.833	0.846	NS	
	21-Apr-10	NS	0.256	NS	NS	1.17	NS	1.56	1.41	1.24	NS	1.14
	16-Jul-10	5.07	NS	2.84	2.63	NS	2.1	NS	NS	1.88	2.05	NS
	15-Oct-10	NS	0.672	NS	NS	0.837	NS	0.659	0.729	1.22	NS	1.14
	26-Jan-11	1.08	1.5	NS	1.54	NS	1.11	NS	1.15	4.32	5.16	NS
	28-Feb-11	NS	NS	0.868	U	NS	NS	NS	NS	NS	NS	NS
	27-Apr-11	NS	0.286	NS	0.286	NS	0.369	0.456	0.451	NS	0.551	
	26-Jul-11	1.87	NS	1.45	0.334	NS	0.434	U	NS	0.365	0.434	NS
	28-Oct-11	NS	2.2	U	NS	2.2	U	2.2	U	3.3	NS	2.2
	23-Jan-12	2.3	NS	0.76	0.54	NS	0.79	NS	NS	1.7	4.6	NS
	13-Apr-12	NS	0.43	U	NS	0.43	U	0.43	U	1.4	NS	0.43
	2-Jul-12 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	2.2	U	NS
	23-Jun-12	3	NS	0.43	U	0.43	U	0.43	U	0.59	0.44	NS
	1-Nov-12	NS	0.72	NS	NS	0.85	NS	1.1	1.1	1.3	NS	1.8
	1-Feb-13	1	NS	0.19	0.17	NS	0.24	NS	NS	0.64	0.52	NS
	29-Apr-13	NS	0.43	NS	NS	0.46	NS	0.41	0.52	0.065	NS	0.86
	9-Jul-13	3.2	NS	0.86	0.90	NS	0.84	NS	NS	1.3	0.28	NS
	18-Oct-13	NS	1.7	NS	NS	1.9	NS	2.1	2.9	1.4	NS	1.7
	9-Jan-14	3.4	NS	3.0	4.00	NS	4.1	NS	9.8	9.6	NS	
	24-Apr-14	NS	0.087	U	NS	0.087	U	0.087	U	0.087	0.087	U
	1-Aug-14	1.9	NS	1.6/1.8	1.10	NS	NS	NS	NS	0.79	1.2/1.6	NS
	27-Aug-14	NS	NS	NS	NS	1.3	NS	NS	NS	NS	NS	
	12-Sept-14 (resample)	NS	NS	NS	NS	NS	NS	0.52	NS	NS	NS	NS
	22-Oct-14	NS	0.13	U	NS	0.13	U	0.2	0.13	0.28	0.35	NS
	20-Jan-15	0.29	NS	0.087	U	0.10	NS	0.087	U	0.23	0.34	NS
	30-Mar-15 (resample)	NS	NS	NS	NS	NS	NS	NS	NS	NS	0.36	NS
	22-Apr-15	NS	0.26	NS	NS	0.13	NS	0.25	0.22/0.25	0.38	NS	0.54
	21-Jul-15	0.48	NS	0.59 ^j	4	U	NS	0.53	NS	0.54 ^v	0.73 ^v	NS
	23-Sept-15 resample	NS	NS	NS	NS	NS	NS	NS	1.3	NS	NS	
	29-Oct-15	NS	0.16 ^j	NS	NS	0.21 ^j	NS	0.34 ^j	0.28	0.32	NS	0.44
	4-Dec-15 resample	NS	0.4	U	NS	NS	NS	NS	NS	NS	NS	
	27-Jan-16	0.51	NS	0.13	0.17	NS	0.17	NS	0.63	0.84	NS	
	20-Apr-16	NS	0.36	NS	NS	0.52	NS	0.77	0.49	0.92	0.78	
	20-Jul-16	3.4 ^w	NS	0.84 ^w	0.43 ^{t,w}	U	NS	0.6 ^w	W	2.7 ^w	1.3 ^y	NS
	21-Oct-16	NS	0.18	NS	NS	0.38	NS	0.27	0.72	1.3	NS	0.62
	31-Jan-17	0.88	NS	0.31	0.32	NS	0.27	NS	NS	1.7	1.2	NS
	17-Apr-17	NS	0.13	U	NS	0.13	U	0.13	U	0.25	NS	0.2
	26-Jul-17	0.45	NS	0.28	0.25	NS	0.46	NS	0.41	0.34	NS	
	12-Oct-17	NS	0.36	NS	0.44	NS	0.52	0.56	0.46	NS	0.42	
	10-Jan-18	0.44	NS	0.12	0.2	NS	0.2	NS	NS	1.2	NS	0.53
	11-Apr-18	NS	0.13	NS	0.87	U	NS	0.87	U	0.35	NS	0.87
	23-May-18	NS	NS	NS	NS	NS	NS	NS	NS	0.16	NS	
	27-Jul-18	0.43	U	NS	0.43	U	0.43	U	0.43	U	0.43	U
	24-Oct-18	NS	0.43	U	NS	0.43	U	0.43	U	0.63	NS	0.57
	16-Jan-19	0.44	NS	0.089	0.13	NS	0.16	NS	NS	0.31	0.38	NS
	12-Apr-19	NS	0.11	NS	NS	0.12	NS	0.11	U	0.25	NS	0.51
	29-Jul-19	6.7	NS	6.9	8	NS	10	NS	NS	4.6	5.3	NS
	26-Sep-19	NS	NS	NS	NS	NS	NS	NS	NS	NS	1.7	NS
	29-Oct-19	NS	1.2	NS	NS	0.96	NS	0.32	1.2	1.8 ^v	2.8 ^v	1.7 ^v
	21-Jan-20	0.33	NS	0.44	0.41	NS	0.32	NS	NS	1.5	1.8	NS
	22-Apr-20	NS	0.087	U	NS	0.087	U	0.087	U	0.47		

Summary of Subslab Air Sampling Data
Alvarez School
Volatile Organic Compounds
February 2008 - April 2023

Volatile Organic Compounds via TO-15	MP-1	MP-2	MP-3	MP-4	MP-5	MP-6	MP-7	MP-8	IMP-1	IMP-2	IMP-3
	Sample Date	Qual	Qual	Qual							
[*] Site Specific Compound of Concern per ATSDR Health Consultation, December 4, 2006.											
^M Laboratory fortified blank/laboratory control sample recovery is outside of control limits. Reported value for this compound is likely to be biased on the high side.											
^L Laboratory fortified blank/laboratory control sample recovery is outside of control limits. Reported value for this compound is likely to be biased on the low side.											
^V Continuing calibration did not meet method specifications and was biased on the low side for this compound. Increased uncertainty is associated with the reported value which is likely to be biased on the low side.											
^W Continuing calibration did not meet method specifications and was biased on the low side for this compound. Increased uncertainty is associated with the reported value which is likely to be biased on the high side.											
^E Reported result is estimated due to value over calibration range											
^J Estimated result as the result was between the MDL and the RDL.											
^O One or more method internal standards were recovered outside of the control limits. Sample re-analysis not possible due to sample volume and detection limit constraints.											
^D Elevated method reporting limits due to diluted matrices. Con-test internal standards failed and samples were re-pressurized and diluted.											
^K Initial calibration did not meet standard and was biased on the low side. Reported result is estimated.											
^F Elevated reporting limits due to sample miss injection. Samples were re-pressurized for analysis. Applies to IMP-2 sample.											
^G Initial calibration verification did not meet method specifications and was biased on the high side for this compound											
NOTES:											
All data presented in micrograms per cubic meter ($\mu\text{g}/\text{m}^3$).											
Two values displayed with a slash indicates dilutions resulting in two different concentrations. Where two reporting limits were given for multiple dilutions, the lower RL was documented in this table.											
U = Designation indicates that the compound was not detected by the laboratory. Reporting limit shown in the data column.											
NS = Not sampled.											

APPENDIX D

Rooftop Emission Analytical Summary

Sub Slab Depressurization System Emissions Calculations

Alvarez School

Sample Date: 28 July 2022

Volatile Organic Compounds	ROOFTOP FAN 1				ROOFTOP FAN 2				ROOFTOP FAN 3				CUMULATIVE EMISSIONS (3 fans combined)					
	Measured Flow Speed (fpm):		2151	Measured Flow Rate (cfm):	105.6	Measured Flow Speed (fpm):		2048	Measured Flow Rate (cfm):	100.5	Measured Flow Speed (fpm):		1895	Measured Flow Rate (cfm):	93.0			
	Concentration (ug/m³)	Hourly Emission (lbs/hour)	Daily Emission (lbs/day)	Yearly Emission (lbs/year)	Concentration (ug/m³)	Hourly Emission (lbs/hour)	Daily Emission (lbs/day)	Yearly Emission (lbs/year)	Concentration (ug/m³)	Hourly Emission (lbs/hour)	Daily Emission (lbs/day)	Yearly Emission (lbs/year)	Hourly Emission (lbs/hour)	Daily Emission (lbs/day)	Yearly Emission (lbs/year)			
Acetone	28		1.11E-05	2.65E-04	9.68E-02	15	5.64E-06	1.35E-04	4.94E-02	22	7.65E-06	1.84E-04	6.70E-02	2.43E-05	5.84E-04	2.13E-01		
Acrylonitrile	0.5	U	1.97E-07	4.74E-06	1.73E-03	0.75	U	2.82E-07	6.76E-06	2.47E-03	0.5	U	1.74E-07	4.17E-06	1.52E-03	6.53E-07	1.57E-05	5.72E-03
Benzene	0.67		2.64E-07	6.35E-06	2.32E-03	0.52		1.95E-07	4.69E-06	1.71E-03	0.73		2.54E-07	6.09E-06	2.22E-03	7.14E-07	1.71E-05	6.25E-03
Bromodichloromethane	0.067	U	2.64E-08	6.35E-07	2.32E-04	0.067	U	2.52E-08	6.04E-07	2.21E-04	0.067	U	2.33E-08	5.59E-07	2.04E-04	7.49E-08	1.80E-06	6.56E-04
Bromoform	0.21	U	8.29E-08	1.99E-06	7.26E-04	0.21	U	7.89E-08	1.89E-06	6.91E-04	0.21	U	7.30E-08	1.75E-06	6.40E-04	2.35E-07	5.64E-06	2.06E-03
2-Butanone	5.5		2.17E-06	5.21E-05	1.90E-02	3.7		1.39E-06	3.34E-05	1.22E-02	5.1		1.77E-06	4.26E-05	1.55E-02	5.33E-06	1.28E-04	4.67E-02
n-Butylbenzene	0.63	U	2.49E-07	5.97E-06	2.18E-03	0.95	U	3.57E-07	8.57E-06	3.13E-03	0.63	U	2.19E-07	5.26E-06	1.92E-03	8.25E-07	1.98E-05	7.22E-03
sec-Butylbenzene	0.5	U	1.97E-07	4.74E-06	1.73E-03	0.75	U	2.82E-07	6.76E-06	2.47E-03	0.5	U	1.74E-07	4.17E-06	1.52E-03	6.53E-07	1.57E-05	5.72E-03
Carbon Tetrachloride	0.56		2.21E-07	5.30E-06	1.94E-03	0.39		1.47E-07	3.52E-06	1.28E-03	0.45		1.56E-07	3.76E-06	1.37E-03	5.24E-07	1.26E-05	4.59E-03
Chlorobenzene	0.092	U	3.63E-08	8.72E-07	3.18E-04	0.092	U	3.46E-08	8.30E-07	3.03E-04	0.092	U	3.20E-08	7.68E-07	2.80E-04	1.03E-07	2.47E-06	9.01E-04
Chloroethane	0.053	U	2.09E-08	5.02E-07	1.83E-04	0.13		4.89E-08	1.17E-06	4.28E-04	0.053	U	1.84E-08	4.42E-07	1.61E-04	8.82E-08	2.12E-06	7.73E-04
Chloroform	0.34		1.34E-07	3.22E-06	1.18E-03	0.69		2.59E-07	6.22E-06	2.27E-03	0.46		1.60E-07	3.84E-06	1.40E-03	5.53E-07	1.33E-05	4.85E-03
Chloromethane	0.083	U	3.28E-08	7.86E-07	2.87E-04	0.083	U	3.12E-08	7.49E-07	2.73E-04	0.083	U	2.89E-08	6.93E-07	2.53E-04	9.28E-08	2.23E-06	8.13E-04
Dibromochloromethane	0.085	U	3.36E-08	8.05E-07	2.94E-04	0.085	U	3.19E-08	7.67E-07	2.80E-04	0.085	U	2.96E-08	7.09E-07	2.59E-04	9.51E-08	2.28E-06	8.33E-04
1,2-Dibromoethane	0.077	U	3.04E-08	7.29E-07	2.66E-04	0.077	U	2.89E-08	6.94E-07	2.53E-04	0.077	U	2.68E-08	6.43E-07	2.35E-04	8.61E-08	2.07E-06	7.54E-04
1,2-Dichlorobenzene	0.12	U	4.74E-08	1.14E-06	4.15E-04	0.12	U	4.51E-08	1.08E-06	3.95E-04	7		4.17E-08	1.00E-06	3.66E-04	1.34E-07	3.22E-06	1.18E-03
1,3-Dichlorobenzene	3.9		1.54E-06	3.69E-05	1.35E-02	0.12	U	4.51E-08	1.08E-06	3.95E-04	7		2.43E-06	5.84E-05	2.13E-02	4.02E-06	9.64E-05	3.52E-02
1,4-Dichlorobenzene	0.12	U	4.74E-08	1.14E-06	4.15E-04	0.12	U	4.51E-08	1.08E-06	3.95E-04	0.12	U	4.17E-08	1.00E-06	3.66E-04	1.34E-07	3.22E-06	1.18E-03
Dichlorodifluoromethane	2.6		1.03E-06	2.46E-05	8.99E-03	1.9		7.14E-07	1.71E-05	6.25E-03	0.99	U	3.44E-08	8.26E-07	3.02E-04	1.77E-06	4.26E-05	1.55E-02
1,1-Dichloroethane	0.04	U	1.58E-08	3.79E-07	1.38E-04	0.04	U	1.50E-08	3.61E-07	1.32E-04	0.04	U	1.39E-08	3.34E-07	1.22E-04	4.47E-08	1.07E-06	3.92E-04
1,2-Dichloroethane	0.04	U	1.58E-08	3.79E-07	1.38E-04	0.04	U	1.50E-08	3.61E-07	1.32E-04	0.04	U	1.39E-08	3.34E-07	1.22E-04	4.47E-08	1.07E-06	3.92E-04
1,1-Dichloroethene	0.04	U	1.58E-08	3.79E-07	1.38E-04	0.04	U	1.50E-08	3.61E-07	1.32E-04	0.04	U	1.39E-08	3.34E-07	1.22E-04	4.47E-08	1.07E-06	3.92E-04
cis-1,2-Dichloroethene	0.059		2.33E-08	5.59E-07	2.04E-04	0.04	U	1.50E-08	3.61E-07	1.32E-04	0.54		1.88E-07	4.51E-06	1.64E-03	2.26E-07	5.43E-06	1.98E-03
trans-1,2-Dichloroethene	0.04	U	1.58E-08	3.79E-07	1.38E-04	0.04	U	1.50E-08	3.61E-07	1.32E-04	0.044		1.53E-08	3.67E-07	1.34E-04	4.61E-08	1.11E-06	4.04E-04
1,2-Dichloropropane	0.046	U	1.82E-08	4.36E-07	1.59E-04	0.046	U	1.73E-08	4.15E-07	1.51E-04	0.046	U	1.60E-08	3.84E-07	1.40E-04	5.14E-08	1.23E-06	4.51E-04
cis-1,3-Dichloropropene	0.045	U	1.78E-08	4.26E-07	1.56E-04	0.045	U	1.69E-08	4.06E-07	1.48E-04	0.045	U	1.56E-08	3.76E-07	1.37E-04	5.03E-08	1.21E-06	4.41E-04
trans-1,3-Dichloropropene	0.045	U	1.78E-08	4.26E-07	1.56E-04	0.045	U	1.69E-08	4.06E-07	1.48E-04	0.045	U	1.56E-08	3.76E-07	1.37E-04	5.03E-08	1.21E-06	4.41E-04
Ethylbenzene	0.59		2.33E-07	5.59E-06	2.04E-03	0.58		2.18E-07	5.23E-06	1.91E-03	1		3.48E-07	8.35E-06	3.05E-03	7.99E-07	1.92E-05	7.00E-03
Isopropylbenzene	0.5	U	1.97E-07	4.74E-06	1.73E-03	0.75	U	2.82E-07	6.76E-06	2.47E-03	0.5	U	1.74E-07	4.17E-06	1.52E-03	6.53E-07	1.57E-05	5.72E-03
p-Isopropyltoluene	0.5	U	1.97E-07	4.74E-06	1.73E-03	0.75	U	2.82E-07	6.76E-06									

APPENDIX E

Laboratory Analytical Reports



39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

May 8, 2023

Frank Postma
EA Engineering Science & Tech. - RI
301 Metro Center Blvd, Suite 102
Warwick, RI 02886

Project Location: Providence, RI
Client Job Number:
Project Number: 1506610
Laboratory Work Order Number: 23D2794

Enclosed are results of analyses for samples as received by the laboratory on April 24, 2023. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

A handwritten signature in black ink, appearing to read "Kaitlyn".

Kaitlyn A. Feliciano
Project Manager

Table of Contents

Sample Summary	3
Case Narrative	4
Sample Results	5
Sample Preparation Information	35
QC Data	36
Air Toxics by EPA Compendium Methods	36
B339376	36
Flag/Qualifier Summary	40
Certifications	41
Chain of Custody/Sample Receipt	43



39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

EA Engineering Science & Tech. - RI
301 Metro Center Blvd, Suite 102
Warwick, RI 02886
ATTN: Frank Postma

REPORT DATE: 5/8/2023

PURCHASE ORDER NUMBER:

PROJECT NUMBER: 1506610

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 23D2794

The results of analyses performed on the following samples submitted to CON-TEST, a Pace Analytical Laboratory, are found in this report.

PROJECT LOCATION: Providence, RI

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
Gymnasium	23D2794-01	Indoor air		-	
				EPA TO-15	
Cafeteria	23D2794-02	Indoor air		-	
				EPA TO-15	
Kitchen Storage	23D2794-03	Indoor air		-	
				EPA TO-15	
Elevator Hallway	23D2794-04	Indoor air		-	
				EPA TO-15	
Room 145	23D2794-05	Indoor air		-	
				EPA TO-15	
Room 152	23D2794-06	Indoor air		-	
				EPA TO-15	
Room 118	23D2794-07	Indoor air		-	
				EPA TO-15	
Room 110	23D2794-08	Indoor air		-	
				EPA TO-15	
Ambient Outdoor Air	23D2794-09	Ambient Air		-	
				EPA TO-15	
IMP-1	23D2794-10	Sub Slab		-	
				EPA TO-15	
IMP-3	23D2794-11	Sub Slab		-	
				EPA TO-15	
MP-2	23D2794-12	Sub Slab		-	
				EPA TO-15	
MP-5	23D2794-13	Sub Slab		-	
				EPA TO-15	
MP-7	23D2794-14	Sub Slab		-	
				EPA TO-15	
MP-8	23D2794-15	Sub Slab		-	
				EPA TO-15	



39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

CASE NARRATIVE SUMMARY

All reported results are within defined laboratory quality control objectives unless listed below or otherwise qualified in this report.

EPA TO-15

Qualifications:

L-03

Laboratory fortified blank/laboratory control sample recovery is outside of control limits. Reported value for this compound is likely to be biased on the low side.

Analyte & Samples(s) Qualified:

1,1,1,2-Tetrachloroethane

23D2794-01[Gymnasium], 23D2794-02[Cafeteria], 23D2794-03[Kitchen Storage], 23D2794-04[Elevator Hallway], 23D2794-05[Room 145], 23D2794-06[Room 152], 23D2794-07[Room 118], 23D2794-08[Room 110], 23D2794-09[Ambient Outdoor Air], 23D2794-10[IMP-1], 23D2794-11[IMP-3], 23D2794-12[MP-2], 23D2794-13[MP-5], 23D2794-14[MP-7], 23D2794-15[MP-8], B339376-BLK1, B339376-BS1, B339376-DUP1

V-05

Continuing calibration verification (CCV) did not meet method specifications and was biased on the low side for this compound.

Analyte & Samples(s) Qualified:

1,2-Dichlorobenzene

23D2794-01[Gymnasium], 23D2794-02[Cafeteria], 23D2794-03[Kitchen Storage], 23D2794-04[Elevator Hallway], 23D2794-05[Room 145], 23D2794-06[Room 152], 23D2794-07[Room 118], 23D2794-08[Room 110], 23D2794-09[Ambient Outdoor Air], 23D2794-10[IMP-1], 23D2794-11[IMP-3], 23D2794-12[MP-2], 23D2794-13[MP-5], 23D2794-14[MP-7], 23D2794-15[MP-8], B339376-BLK1, B339376-BS1, B339376-DUP1, S086888-CCV1

EPA TO-15

Initial and continuing calibrations met all required performance standards for RCP compounds that are Title III Clean Air Act Amendment compounds listed in table 1 of the TO-15 method unless otherwise specified in this narrative.

Laboratory control sample recoveries and sample replicate RPDs were all within limits specified by the method for RCP compounds that are Title III Clean Air Act Amendment compounds listed in table 1 of the TO-15 method unless otherwise specified in this narrative. Recovery limits of 50-150% are used for propene, acetone, ethanol, isopropanol, ethyl acetate, tetrahydrofuran, cyclohexane, heptane, 2-hexanone, 4-ethyltoluene, n-butylbenzene, sec-butylbenzene, 4-isopropyltoluene, and 1,1,1,2-tetrachloroethane.

The results of analyses reported only relate to samples submitted to Con-Test, a Pace Analytical Laboratory, for testing.

I certify that the analyses listed above, unless specifically listed as subcontracted, if any, were performed under my direction according to the approved methodologies listed in this document, and that based upon my inquiry of those individuals immediately responsible for obtaining the information, the material contained in this report is, to the best of my knowledge and belief, accurate and complete.

Meghan E. Kelley
Reporting Specialist

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Gymnasium**Sample ID:** 23D2794-01

Sample Matrix: Indoor air

Sampled: 4/19/2023 10:09

Sample Description/Location:

Sub Description/Location:

Canister ID: 1259

Canister Size: 6 liter

Flow Controller ID: 4184

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -3

Receipt Vacuum(in Hg): -1.8

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv			ug/m3			Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL				
Acetone	4.3	0.80		10	1.9		0.4	5/2/23 20:23	SFM
Acrylonitrile	ND	0.12		ND	0.25		0.4	5/2/23 20:23	SFM
Benzene	0.069	0.020		0.22	0.064		0.4	5/2/23 20:23	SFM
Bromodichloromethane	ND	0.010		ND	0.067		0.4	5/2/23 20:23	SFM
Bromoform	ND	0.020		ND	0.21		0.4	5/2/23 20:23	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4		0.4	5/2/23 20:23	SFM
n-Butylbenzene	ND	0.058		ND	0.32		0.4	5/2/23 20:23	SFM
sec-Butylbenzene	ND	0.046		ND	0.25		0.4	5/2/23 20:23	SFM
Carbon Tetrachloride	0.062	0.010		0.39	0.063		0.4	5/2/23 20:23	SFM
Chlorobenzene	ND	0.020		ND	0.092		0.4	5/2/23 20:23	SFM
Chloorethane	ND	0.020		ND	0.053		0.4	5/2/23 20:23	SFM
Chloroform	0.011	0.010		0.053	0.049		0.4	5/2/23 20:23	SFM
Chloromethane	0.52	0.040		1.1	0.083		0.4	5/2/23 20:23	SFM
Dibromochloromethane	ND	0.010		ND	0.085		0.4	5/2/23 20:23	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077		0.4	5/2/23 20:23	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12		0.4	5/2/23 20:23	SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12		0.4	5/2/23 20:23	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12		0.4	5/2/23 20:23	SFM
Dichlorodifluoromethane (Freon 12)	0.13	0.020		0.66	0.099		0.4	5/2/23 20:23	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040		0.4	5/2/23 20:23	SFM
1,2-Dichloroethane	0.015	0.010		0.062	0.040		0.4	5/2/23 20:23	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/2/23 20:23	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/2/23 20:23	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/2/23 20:23	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046		0.4	5/2/23 20:23	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25		0.4	5/2/23 20:23	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/2/23 20:23	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/2/23 20:23	SFM
Ethylbenzene	0.034	0.020		0.15	0.087		0.4	5/2/23 20:23	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25		0.4	5/2/23 20:23	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25		0.4	5/2/23 20:23	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072		0.4	5/2/23 20:23	SFM
Methylene Chloride	ND	0.20		ND	0.69		0.4	5/2/23 20:23	SFM
4-Methyl-2-pentanone (MIBK)	0.032	0.020		0.13	0.082		0.4	5/2/23 20:23	SFM
Styrene	ND	0.020		ND	0.085		0.4	5/2/23 20:23	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25		0.4	5/2/23 20:23	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069		0.4	5/2/23 20:23	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Gymnasium**Sample ID:** 23D2794-01

Sample Matrix: Indoor air

Sampled: 4/19/2023 10:09

Sample Description/Location:

Sub Description/Location:

Canister ID: 1259

Canister Size: 6 liter

Flow Controller ID: 4184

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -3

Receipt Vacuum(in Hg): -1.8

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/2/23 20:23	SFM
Toluene	0.12	0.020		0.45	0.075	0.4	5/2/23 20:23	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/2/23 20:23	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/2/23 20:23	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/2/23 20:23	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/2/23 20:23	SFM
1,2,4-Trimethylbenzene	0.029	0.020		0.14	0.098	0.4	5/2/23 20:23	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/2/23 20:23	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/2/23 20:23	SFM
m&p-Xylene	0.13	0.040		0.55	0.17	0.4	5/2/23 20:23	SFM
o-Xylene	0.035	0.020		0.15	0.087	0.4	5/2/23 20:23	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	91.5	70-130	5/2/23 20:23
4-Bromofluorobenzene (2)	75.6	70-130	5/2/23 20:23

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: Cafeteria
Sample ID: 23D2794-02
 Sample Matrix: Indoor air
 Sampled: 4/19/2023 10:03

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 9004
 Canister Size: 6 liter
 Flow Controller ID: 4579
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -29
 Final Vacuum(in Hg): -3
 Receipt Vacuum(in Hg): -3.8
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL		
Acetone	7.0	0.80		17	1.9	0.4	5/2/23 21:14 SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/2/23 21:14 SFM
Benzene	0.061	0.020		0.19	0.064	0.4	5/2/23 21:14 SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/2/23 21:14 SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/2/23 21:14 SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/2/23 21:14 SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/2/23 21:14 SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/2/23 21:14 SFM
Carbon Tetrachloride	0.062	0.010		0.39	0.063	0.4	5/2/23 21:14 SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/2/23 21:14 SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/2/23 21:14 SFM
Chloroform	0.016	0.010		0.080	0.049	0.4	5/2/23 21:14 SFM
Chloromethane	0.50	0.040		1.0	0.083	0.4	5/2/23 21:14 SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/2/23 21:14 SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/2/23 21:14 SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/2/23 21:14 SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 21:14 SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 21:14 SFM
Dichlorodifluoromethane (Freon 12)	0.13	0.020		0.64	0.099	0.4	5/2/23 21:14 SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/2/23 21:14 SFM
1,2-Dichloroethane	0.014	0.010		0.058	0.040	0.4	5/2/23 21:14 SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 21:14 SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 21:14 SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 21:14 SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/2/23 21:14 SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/2/23 21:14 SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 21:14 SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 21:14 SFM
Ethylbenzene	0.020	0.020		0.087	0.087	0.4	5/2/23 21:14 SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/2/23 21:14 SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/2/23 21:14 SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/2/23 21:14 SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/2/23 21:14 SFM
4-Methyl-2-pentanone (MIBK)	0.038	0.020		0.16	0.082	0.4	5/2/23 21:14 SFM
Styrene	ND	0.020		ND	0.085	0.4	5/2/23 21:14 SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/2/23 21:14 SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/2/23 21:14 SFM

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Cafeteria**Sample ID:** 23D2794-02

Sample Matrix: Indoor air

Sampled: 4/19/2023 10:03

Sample Description/Location:

Sub Description/Location:

Canister ID: 9004

Canister Size: 6 liter

Flow Controller ID: 4579

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -3

Receipt Vacuum(in Hg): -3.8

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	0.025	0.020		0.17	0.14	0.4	5/2/23 21:14	SFM
Toluene	0.068	0.020		0.26	0.075	0.4	5/2/23 21:14	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/2/23 21:14	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/2/23 21:14	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/2/23 21:14	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/2/23 21:14	SFM
1,2,4-Trimethylbenzene	0.028	0.020		0.14	0.098	0.4	5/2/23 21:14	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/2/23 21:14	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/2/23 21:14	SFM
m&p-Xylene	0.073	0.040		0.32	0.17	0.4	5/2/23 21:14	SFM
o-Xylene	0.022	0.020		0.096	0.087	0.4	5/2/23 21:14	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	90.6	70-130	5/2/23 21:14
4-Bromofluorobenzene (2)	74.8	70-130	5/2/23 21:14

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: Kitchen Storage
Sample ID: 23D2794-03
 Sample Matrix: Indoor air
 Sampled: 4/19/2023 10:05

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 9002
 Canister Size: 6 liter
 Flow Controller ID: 4580
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -30
 Final Vacuum(in Hg): -4
 Receipt Vacuum(in Hg): -2.5
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	5.5	0.80		13	1.9	0.4	5/2/23 22:05	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/2/23 22:05	SFM
Benzene	0.069	0.020		0.22	0.064	0.4	5/2/23 22:05	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/2/23 22:05	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/2/23 22:05	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/2/23 22:05	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/2/23 22:05	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/2/23 22:05	SFM
Carbon Tetrachloride	0.064	0.010		0.40	0.063	0.4	5/2/23 22:05	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/2/23 22:05	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/2/23 22:05	SFM
Chloroform	0.054	0.010		0.26	0.049	0.4	5/2/23 22:05	SFM
Chloromethane	0.49	0.040		1.0	0.083	0.4	5/2/23 22:05	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/2/23 22:05	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/2/23 22:05	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/2/23 22:05	SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 22:05	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 22:05	SFM
Dichlorodifluoromethane (Freon 12)	0.13	0.020		0.65	0.099	0.4	5/2/23 22:05	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/2/23 22:05	SFM
1,2-Dichloroethane	0.015	0.010		0.060	0.040	0.4	5/2/23 22:05	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 22:05	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 22:05	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 22:05	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/2/23 22:05	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/2/23 22:05	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 22:05	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 22:05	SFM
Ethylbenzene	0.081	0.020		0.35	0.087	0.4	5/2/23 22:05	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/2/23 22:05	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/2/23 22:05	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/2/23 22:05	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/2/23 22:05	SFM
4-Methyl-2-pentanone (MIBK)	ND	0.020		ND	0.082	0.4	5/2/23 22:05	SFM
Styrene	0.074	0.020		0.32	0.085	0.4	5/2/23 22:05	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/2/23 22:05	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/2/23 22:05	SFM

 39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Kitchen Storage**Sample ID:** 23D2794-03

Sample Matrix: Indoor air

Sampled: 4/19/2023 10:05

Sample Description/Location:

Sub Description/Location:

Canister ID: 9002

Canister Size: 6 liter

Flow Controller ID: 4580

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -30

Final Vacuum(in Hg): -4

Receipt Vacuum(in Hg): -2.5

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv			ug/m3			Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL				
Tetrachloroethylene	ND	0.020		ND	0.14		0.4	5/2/23 22:05	SFM
Toluene	0.15	0.020		0.58	0.075		0.4	5/2/23 22:05	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055		0.4	5/2/23 22:05	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055		0.4	5/2/23 22:05	SFM
Trichloroethylene	ND	0.010		ND	0.054		0.4	5/2/23 22:05	SFM
Trichlorofluoromethane (Freon 11)	0.19	0.080		1.1	0.45		0.4	5/2/23 22:05	SFM
1,2,4-Trimethylbenzene	0.090	0.020		0.44	0.098		0.4	5/2/23 22:05	SFM
1,3,5-Trimethylbenzene	0.021	0.020		0.10	0.098		0.4	5/2/23 22:05	SFM
Vinyl Chloride	ND	0.020		ND	0.051		0.4	5/2/23 22:05	SFM
m&p-Xylene	0.36	0.040		1.6	0.17		0.4	5/2/23 22:05	SFM
o-Xylene	0.11	0.020		0.47	0.087		0.4	5/2/23 22:05	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	90.1	70-130	5/2/23 22:05
4-Bromofluorobenzene (2)	74.2	70-130	5/2/23 22:05

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Elevator Hallway**Sample ID:** 23D2794-04

Sample Matrix: Indoor air

Sampled: 4/19/2023 09:53

Sample Description/Location:

Sub Description/Location:

Canister ID: 1991

Canister Size: 6 liter

Flow Controller ID: 4589

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -28

Final Vacuum(in Hg): -2

Receipt Vacuum(in Hg): -1.7

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	7.0	0.80		17	1.9	0.4	5/2/23 22:54	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/2/23 22:54	SFM
Benzene	0.061	0.020		0.20	0.064	0.4	5/2/23 22:54	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/2/23 22:54	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/2/23 22:54	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/2/23 22:54	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/2/23 22:54	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/2/23 22:54	SFM
Carbon Tetrachloride	0.067	0.010		0.42	0.063	0.4	5/2/23 22:54	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/2/23 22:54	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/2/23 22:54	SFM
Chloroform	0.011	0.010		0.055	0.049	0.4	5/2/23 22:54	SFM
Chloromethane	0.49	0.040		1.0	0.083	0.4	5/2/23 22:54	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/2/23 22:54	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/2/23 22:54	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/2/23 22:54	SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 22:54	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 22:54	SFM
Dichlorodifluoromethane (Freon 12)	0.14	0.020		0.71	0.099	0.4	5/2/23 22:54	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/2/23 22:54	SFM
1,2-Dichloroethane	0.014	0.010		0.058	0.040	0.4	5/2/23 22:54	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 22:54	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 22:54	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 22:54	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/2/23 22:54	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/2/23 22:54	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 22:54	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 22:54	SFM
Ethylbenzene	0.054	0.020		0.23	0.087	0.4	5/2/23 22:54	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/2/23 22:54	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/2/23 22:54	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/2/23 22:54	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/2/23 22:54	SFM
4-Methyl-2-pentanone (MIBK)	0.069	0.020		0.28	0.082	0.4	5/2/23 22:54	SFM
Styrene	0.022	0.020		0.094	0.085	0.4	5/2/23 22:54	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/2/23 22:54	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/2/23 22:54	SFM

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Elevator Hallway**Sample ID:** 23D2794-04

Sample Matrix: Indoor air

Sampled: 4/19/2023 09:53

Sample Description/Location:

Sub Description/Location:

Canister ID: 1991

Canister Size: 6 liter

Flow Controller ID: 4589

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -28

Final Vacuum(in Hg): -2

Receipt Vacuum(in Hg): -1.7

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	0.028	0.020		0.19	0.14	0.4	5/2/23 22:54	SFM
Toluene	0.11	0.020		0.42	0.075	0.4	5/2/23 22:54	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/2/23 22:54	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/2/23 22:54	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/2/23 22:54	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/2/23 22:54	SFM
1,2,4-Trimethylbenzene	0.079	0.020		0.39	0.098	0.4	5/2/23 22:54	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/2/23 22:54	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/2/23 22:54	SFM
m&p-Xylene	0.23	0.040		1.00	0.17	0.4	5/2/23 22:54	SFM
o-Xylene	0.069	0.020		0.30	0.087	0.4	5/2/23 22:54	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	90.5	70-130	5/2/23 22:54
4-Bromofluorobenzene (2)	75.1	70-130	5/2/23 22:54

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: Room 145
Sample ID: 23D2794-05
 Sample Matrix: Indoor air
 Sampled: 4/19/2023 09:55

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 1176
 Canister Size: 6 liter
 Flow Controller ID: 4590
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -29
 Final Vacuum(in Hg): 0
 Receipt Vacuum(in Hg): -0.4
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	4.7	0.80		11	1.9	0.4	5/2/23 23:44	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/2/23 23:44	SFM
Benzene	0.062	0.020		0.20	0.064	0.4	5/2/23 23:44	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/2/23 23:44	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/2/23 23:44	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/2/23 23:44	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/2/23 23:44	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/2/23 23:44	SFM
Carbon Tetrachloride	0.065	0.010		0.41	0.063	0.4	5/2/23 23:44	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/2/23 23:44	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/2/23 23:44	SFM
Chloroform	0.011	0.010		0.053	0.049	0.4	5/2/23 23:44	SFM
Chloromethane	0.51	0.040		1.0	0.083	0.4	5/2/23 23:44	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/2/23 23:44	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/2/23 23:44	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/2/23 23:44	SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 23:44	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/2/23 23:44	SFM
Dichlorodifluoromethane (Freon 12)	0.14	0.020		0.71	0.099	0.4	5/2/23 23:44	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/2/23 23:44	SFM
1,2-Dichloroethane	0.014	0.010		0.058	0.040	0.4	5/2/23 23:44	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 23:44	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 23:44	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/2/23 23:44	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/2/23 23:44	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/2/23 23:44	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 23:44	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/2/23 23:44	SFM
Ethylbenzene	ND	0.020		ND	0.087	0.4	5/2/23 23:44	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/2/23 23:44	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/2/23 23:44	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/2/23 23:44	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/2/23 23:44	SFM
4-Methyl-2-pentanone (MIBK)	ND	0.020		ND	0.082	0.4	5/2/23 23:44	SFM
Styrene	ND	0.020		ND	0.085	0.4	5/2/23 23:44	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/2/23 23:44	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/2/23 23:44	SFM

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Room 145**Sample ID: 23D2794-05**

Sample Matrix: Indoor air

Sampled: 4/19/2023 09:55

Sample Description/Location:

Sub Description/Location:

Canister ID: 1176

Canister Size: 6 liter

Flow Controller ID: 4590

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): 0

Receipt Vacuum(in Hg): -0.4

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv			ug/m3			Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL				
Tetrachloroethylene	ND	0.020		ND	0.14		0.4	5/2/23 23:44	SFM
Toluene	0.078	0.020		0.29	0.075		0.4	5/2/23 23:44	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055		0.4	5/2/23 23:44	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055		0.4	5/2/23 23:44	SFM
Trichloroethylene	ND	0.010		ND	0.054		0.4	5/2/23 23:44	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45		0.4	5/2/23 23:44	SFM
1,2,4-Trimethylbenzene	ND	0.020		ND	0.098		0.4	5/2/23 23:44	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098		0.4	5/2/23 23:44	SFM
Vinyl Chloride	ND	0.020		ND	0.051		0.4	5/2/23 23:44	SFM
m&p-Xylene	0.053	0.040		0.23	0.17		0.4	5/2/23 23:44	SFM
o-Xylene	ND	0.020		ND	0.087		0.4	5/2/23 23:44	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	91.4	70-130	5/2/23 23:44
4-Bromofluorobenzene (2)	76.0	70-130	5/2/23 23:44

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: Room 152
Sample ID: 23D2794-06
 Sample Matrix: Indoor air
 Sampled: 4/21/2023 09:20

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 2160
 Canister Size: 6 liter
 Flow Controller ID: 4741
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -30
 Final Vacuum(in Hg): -2
 Receipt Vacuum(in Hg): -1.6
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	6.2	0.80		15	1.9	0.4	5/3/23 0:33	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 0:33	SFM
Benzene	0.12	0.020		0.40	0.064	0.4	5/3/23 0:33	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 0:33	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 0:33	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/3/23 0:33	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 0:33	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 0:33	SFM
Carbon Tetrachloride	0.069	0.010		0.43	0.063	0.4	5/3/23 0:33	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 0:33	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 0:33	SFM
Chloroform	0.042	0.010		0.21	0.049	0.4	5/3/23 0:33	SFM
Chloromethane	0.57	0.040		1.2	0.083	0.4	5/3/23 0:33	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 0:33	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 0:33	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 0:33	SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 0:33	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 0:33	SFM
Dichlorodifluoromethane (Freon 12)	0.13	0.020		0.64	0.099	0.4	5/3/23 0:33	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 0:33	SFM
1,2-Dichloroethane	0.017	0.010		0.068	0.040	0.4	5/3/23 0:33	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 0:33	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 0:33	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 0:33	SFM
1,2-Dichloropropane	0.010	0.010		0.048	0.046	0.4	5/3/23 0:33	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 0:33	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 0:33	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 0:33	SFM
Ethylbenzene	0.041	0.020		0.18	0.087	0.4	5/3/23 0:33	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 0:33	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 0:33	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 0:33	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 0:33	SFM
4-Methyl-2-pentanone (MIBK)	0.048	0.020		0.19	0.082	0.4	5/3/23 0:33	SFM
Styrene	0.034	0.020		0.14	0.085	0.4	5/3/23 0:33	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 0:33	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 0:33	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Room 152**Sample ID: 23D2794-06**

Sample Matrix: Indoor air

Sampled: 4/21/2023 09:20

Sample Description/Location:

Sub Description/Location:

Canister ID: 2160

Canister Size: 6 liter

Flow Controller ID: 4741

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -30

Final Vacuum(in Hg): -2

Receipt Vacuum(in Hg): -1.6

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/3/23 0:33	SFM
Toluene	0.23	0.020		0.87	0.075	0.4	5/3/23 0:33	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 0:33	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 0:33	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/3/23 0:33	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/3/23 0:33	SFM
1,2,4-Trimethylbenzene	0.043	0.020		0.21	0.098	0.4	5/3/23 0:33	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/3/23 0:33	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 0:33	SFM
m&p-Xylene	0.12	0.040		0.52	0.17	0.4	5/3/23 0:33	SFM
o-Xylene	0.048	0.020		0.21	0.087	0.4	5/3/23 0:33	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	91.2	70-130	5/3/23 0:33
4-Bromofluorobenzene (2)	75.8	70-130	5/3/23 0:33

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Room 118**Sample ID: 23D2794-07**

Sample Matrix: Indoor air

Sampled: 4/21/2023 09:24

Sample Description/Location:

Sub Description/Location:

Canister ID: 2144

Canister Size: 6 liter

Flow Controller ID: 4740

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -4

Receipt Vacuum(in Hg): -3.7

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL		
Acetone	4.6	0.80		11	1.9	0.4	5/3/23 1:24 SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 1:24 SFM
Benzene	0.11	0.020		0.36	0.064	0.4	5/3/23 1:24 SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 1:24 SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 1:24 SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/3/23 1:24 SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 1:24 SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 1:24 SFM
Carbon Tetrachloride	0.059	0.010		0.37	0.063	0.4	5/3/23 1:24 SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 1:24 SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 1:24 SFM
Chloroform	0.039	0.010		0.19	0.049	0.4	5/3/23 1:24 SFM
Chloromethane	0.51	0.040		1.1	0.083	0.4	5/3/23 1:24 SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 1:24 SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 1:24 SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 1:24 SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 1:24 SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 1:24 SFM
Dichlorodifluoromethane (Freon 12)	0.13	0.020		0.65	0.099	0.4	5/3/23 1:24 SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 1:24 SFM
1,2-Dichloroethane	0.017	0.010		0.068	0.040	0.4	5/3/23 1:24 SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 1:24 SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 1:24 SFM
trans-1,2-Dichloroethylene	0.012	0.010		0.049	0.040	0.4	5/3/23 1:24 SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/3/23 1:24 SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 1:24 SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 1:24 SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 1:24 SFM
Ethylbenzene	0.038	0.020		0.16	0.087	0.4	5/3/23 1:24 SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 1:24 SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 1:24 SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 1:24 SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 1:24 SFM
4-Methyl-2-pentanone (MIBK)	0.042	0.020		0.17	0.082	0.4	5/3/23 1:24 SFM
Styrene	ND	0.020		ND	0.085	0.4	5/3/23 1:24 SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 1:24 SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 1:24 SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Room 118**Sample ID: 23D2794-07**

Sample Matrix: Indoor air

Sampled: 4/21/2023 09:24

Sample Description/Location:

Sub Description/Location:

Canister ID: 2144

Canister Size: 6 liter

Flow Controller ID: 4740

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -4

Receipt Vacuum(in Hg): -3.7

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/3/23 1:24	SFM
Toluene	0.19	0.020		0.73	0.075	0.4	5/3/23 1:24	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 1:24	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 1:24	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/3/23 1:24	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/3/23 1:24	SFM
1,2,4-Trimethylbenzene	0.039	0.020		0.19	0.098	0.4	5/3/23 1:24	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/3/23 1:24	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 1:24	SFM
m&p-Xylene	0.12	0.040		0.51	0.17	0.4	5/3/23 1:24	SFM
o-Xylene	0.043	0.020		0.19	0.087	0.4	5/3/23 1:24	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	90.1	70-130	5/3/23 1:24
4-Bromofluorobenzene (2)	74.4	70-130	5/3/23 1:24

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: Room 110
Sample ID: 23D2794-08
 Sample Matrix: Indoor air
 Sampled: 4/21/2023 09:27

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 1222
 Canister Size: 6 liter
 Flow Controller ID: 4551
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -30
 Final Vacuum(in Hg): -1
 Receipt Vacuum(in Hg): -1.0
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL		
Acetone	3.9	0.80		9.2	1.9	0.4	5/3/23 2:14 SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 2:14 SFM
Benzene	0.093	0.020		0.30	0.064	0.4	5/3/23 2:14 SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 2:14 SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 2:14 SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/3/23 2:14 SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 2:14 SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 2:14 SFM
Carbon Tetrachloride	0.066	0.010		0.42	0.063	0.4	5/3/23 2:14 SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 2:14 SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 2:14 SFM
Chloroform	0.020	0.010		0.100	0.049	0.4	5/3/23 2:14 SFM
Chloromethane	0.48	0.040		1.00	0.083	0.4	5/3/23 2:14 SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 2:14 SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 2:14 SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 2:14 SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 2:14 SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 2:14 SFM
Dichlorodifluoromethane (Freon 12)	0.15	0.020		0.73	0.099	0.4	5/3/23 2:14 SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 2:14 SFM
1,2-Dichloroethane	0.016	0.010		0.063	0.040	0.4	5/3/23 2:14 SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 2:14 SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 2:14 SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 2:14 SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/3/23 2:14 SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 2:14 SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 2:14 SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 2:14 SFM
Ethylbenzene	0.025	0.020		0.11	0.087	0.4	5/3/23 2:14 SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 2:14 SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 2:14 SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 2:14 SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 2:14 SFM
4-Methyl-2-pentanone (MIBK)	0.024	0.020		0.100	0.082	0.4	5/3/23 2:14 SFM
Styrene	ND	0.020		ND	0.085	0.4	5/3/23 2:14 SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 2:14 SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 2:14 SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Room 110**Sample ID: 23D2794-08**

Sample Matrix: Indoor air

Sampled: 4/21/2023 09:27

Sample Description/Location:

Sub Description/Location:

Canister ID: 1222

Canister Size: 6 liter

Flow Controller ID: 4551

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -30

Final Vacuum(in Hg): -1

Receipt Vacuum(in Hg): -1.0

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/3/23 2:14	SFM
Toluene	0.14	0.020		0.53	0.075	0.4	5/3/23 2:14	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 2:14	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 2:14	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/3/23 2:14	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/3/23 2:14	SFM
1,2,4-Trimethylbenzene	0.024	0.020		0.12	0.098	0.4	5/3/23 2:14	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/3/23 2:14	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 2:14	SFM
m&p-Xylene	0.082	0.040		0.36	0.17	0.4	5/3/23 2:14	SFM
o-Xylene	0.036	0.020		0.16	0.087	0.4	5/3/23 2:14	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	90.3	70-130	5/3/23 2:14
4-Bromofluorobenzene (2)	74.7	70-130	5/3/23 2:14

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Ambient Outdoor Air**Sample ID:** 23D2794-09

Sample Matrix: Ambient Air

Sampled: 4/19/2023 11:12

Sample Description/Location:

Sub Description/Location:

Canister ID: 1190

Canister Size: 6 liter

Flow Controller ID: 4185

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -28

Final Vacuum(in Hg): -2

Receipt Vacuum(in Hg): -2.4

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	3.4	0.80		8.1	1.9	0.4	5/3/23 3:04	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 3:04	SFM
Benzene	0.069	0.020		0.22	0.064	0.4	5/3/23 3:04	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 3:04	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 3:04	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/3/23 3:04	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 3:04	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 3:04	SFM
Carbon Tetrachloride	0.064	0.010		0.40	0.063	0.4	5/3/23 3:04	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 3:04	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 3:04	SFM
Chloroform	0.012	0.010		0.057	0.049	0.4	5/3/23 3:04	SFM
Chloromethane	0.51	0.040		1.0	0.083	0.4	5/3/23 3:04	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 3:04	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 3:04	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 3:04	SFM
1,3-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 3:04	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 3:04	SFM
Dichlorodifluoromethane (Freon 12)	0.15	0.020		0.75	0.099	0.4	5/3/23 3:04	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 3:04	SFM
1,2-Dichloroethane	0.014	0.010		0.058	0.040	0.4	5/3/23 3:04	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 3:04	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 3:04	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 3:04	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/3/23 3:04	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 3:04	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 3:04	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 3:04	SFM
Ethylbenzene	0.034	0.020		0.15	0.087	0.4	5/3/23 3:04	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 3:04	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 3:04	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 3:04	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 3:04	SFM
4-Methyl-2-pentanone (MIBK)	0.068	0.020		0.28	0.082	0.4	5/3/23 3:04	SFM
Styrene	ND	0.020		ND	0.085	0.4	5/3/23 3:04	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 3:04	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 3:04	SFM

 39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: Ambient Outdoor Air**Sample ID:** 23D2794-09

Sample Matrix: Ambient Air

Sampled: 4/19/2023 11:12

Sample Description/Location:

Sub Description/Location:

Canister ID: 1190

Canister Size: 6 liter

Flow Controller ID: 4185

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -28

Final Vacuum(in Hg): -2

Receipt Vacuum(in Hg): -2.4

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/3/23 3:04	SFM
Toluene	0.13	0.020		0.49	0.075	0.4	5/3/23 3:04	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 3:04	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 3:04	SFM
Trichloroethylene	ND	0.010		ND	0.054	0.4	5/3/23 3:04	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/3/23 3:04	SFM
1,2,4-Trimethylbenzene	0.020	0.020		0.10	0.098	0.4	5/3/23 3:04	SFM
1,3,5-Trimethylbenzene	ND	0.020		ND	0.098	0.4	5/3/23 3:04	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 3:04	SFM
m&p-Xylene	0.13	0.040		0.57	0.17	0.4	5/3/23 3:04	SFM
o-Xylene	0.038	0.020		0.17	0.087	0.4	5/3/23 3:04	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	90.8	70-130	5/3/23 3:04
4-Bromofluorobenzene (2)	75.6	70-130	5/3/23 3:04

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: IMP-1
Sample ID: 23D2794-10
 Sample Matrix: Sub Slab
 Sampled: 4/19/2023 10:08

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 2139
 Canister Size: 6 liter
 Flow Controller ID: 4670
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -30
 Final Vacuum(in Hg): 0
 Receipt Vacuum(in Hg): -0.6
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv			ug/m3			Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL				
Acetone	9.2	0.80		22	1.9		0.4	5/3/23 4:32	SFM
Acrylonitrile	ND	0.12		ND	0.25		0.4	5/3/23 4:32	SFM
Benzene	0.090	0.020		0.29	0.064		0.4	5/3/23 4:32	SFM
Bromodichloromethane	ND	0.010		ND	0.067		0.4	5/3/23 4:32	SFM
Bromoform	ND	0.020		ND	0.21		0.4	5/3/23 4:32	SFM
2-Butanone (MEK)	1.7	0.80		5.1	2.4		0.4	5/3/23 4:32	SFM
n-Butylbenzene	ND	0.058		ND	0.32		0.4	5/3/23 4:32	SFM
sec-Butylbenzene	ND	0.046		ND	0.25		0.4	5/3/23 4:32	SFM
Carbon Tetrachloride	0.066	0.010		0.42	0.063		0.4	5/3/23 4:32	SFM
Chlorobenzene	ND	0.020		ND	0.092		0.4	5/3/23 4:32	SFM
Chloroethane	ND	0.020		ND	0.053		0.4	5/3/23 4:32	SFM
Chloroform	0.015	0.010		0.074	0.049		0.4	5/3/23 4:32	SFM
Chloromethane	0.47	0.040		0.98	0.083		0.4	5/3/23 4:32	SFM
Dibromochloromethane	ND	0.010		ND	0.085		0.4	5/3/23 4:32	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077		0.4	5/3/23 4:32	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12		0.4	5/3/23 4:32	SFM
1,3-Dichlorobenzene	0.24	0.020		1.4	0.12		0.4	5/3/23 4:32	SFM
1,4-Dichlorobenzene	0.021	0.020		0.13	0.12		0.4	5/3/23 4:32	SFM
Dichlorodifluoromethane (Freon 12)	0.15	0.020		0.72	0.099		0.4	5/3/23 4:32	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040		0.4	5/3/23 4:32	SFM
1,2-Dichloroethane	0.015	0.010		0.060	0.040		0.4	5/3/23 4:32	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 4:32	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 4:32	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 4:32	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046		0.4	5/3/23 4:32	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25		0.4	5/3/23 4:32	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/3/23 4:32	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/3/23 4:32	SFM
Ethylbenzene	1.6	0.020		6.9	0.087		0.4	5/3/23 4:32	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25		0.4	5/3/23 4:32	SFM
p-Isopropyltoluene (p-Cymene)	0.067	0.046		0.37	0.25		0.4	5/3/23 4:32	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072		0.4	5/3/23 4:32	SFM
Methylene Chloride	ND	0.20		ND	0.69		0.4	5/3/23 4:32	SFM
4-Methyl-2-pentanone (MIBK)	0.32	0.020		1.3	0.082		0.4	5/3/23 4:32	SFM
Styrene	0.60	0.020		2.6	0.085		0.4	5/3/23 4:32	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25		0.4	5/3/23 4:32	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069		0.4	5/3/23 4:32	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: IMP-1**Sample ID:** 23D2794-10

Sample Matrix: Sub Slab

Sampled: 4/19/2023 10:08

Sample Description/Location:

Sub Description/Location:

Canister ID: 2139

Canister Size: 6 liter

Flow Controller ID: 4670

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -30

Final Vacuum(in Hg): 0

Receipt Vacuum(in Hg): -0.6

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/3/23 4:32	SFM
Toluene	1.9	0.020		7.1	0.075	0.4	5/3/23 4:32	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 4:32	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 4:32	SFM
Trichloroethylene	0.018	0.010		0.097	0.054	0.4	5/3/23 4:32	SFM
Trichlorofluoromethane (Freon 11)	0.20	0.080		1.1	0.45	0.4	5/3/23 4:32	SFM
1,2,4-Trimethylbenzene	0.89	0.020		4.4	0.098	0.4	5/3/23 4:32	SFM
1,3,5-Trimethylbenzene	0.22	0.020		1.1	0.098	0.4	5/3/23 4:32	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 4:32	SFM
m&p-Xylene	6.3	0.040		27	0.17	0.4	5/3/23 4:32	SFM
o-Xylene	1.6	0.020		6.8	0.087	0.4	5/3/23 4:32	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	92.8	70-130	5/3/23 4:32
4-Bromofluorobenzene (2)	77.5	70-130	5/3/23 4:32

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: IMP-3
Sample ID: 23D2794-11
 Sample Matrix: Sub Slab
 Sampled: 4/19/2023 09:48

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 1987
 Canister Size: 6 liter
 Flow Controller ID: 4669
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -27
 Final Vacuum(in Hg): 0
 Receipt Vacuum(in Hg): 0.0
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	9.3	0.80		22	1.9	0.4	5/3/23 6:17	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 6:17	SFM
Benzene	0.092	0.020		0.29	0.064	0.4	5/3/23 6:17	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 6:17	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 6:17	SFM
2-Butanone (MEK)	ND	0.80		ND	2.4	0.4	5/3/23 6:17	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 6:17	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 6:17	SFM
Carbon Tetrachloride	0.067	0.010		0.42	0.063	0.4	5/3/23 6:17	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 6:17	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 6:17	SFM
Chloroform	0.012	0.010		0.059	0.049	0.4	5/3/23 6:17	SFM
Chloromethane	0.47	0.040		0.96	0.083	0.4	5/3/23 6:17	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 6:17	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 6:17	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 6:17	SFM
1,3-Dichlorobenzene	0.024	0.020		0.14	0.12	0.4	5/3/23 6:17	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 6:17	SFM
Dichlorodifluoromethane (Freon 12)	0.14	0.020		0.68	0.099	0.4	5/3/23 6:17	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 6:17	SFM
1,2-Dichloroethane	0.017	0.010		0.068	0.040	0.4	5/3/23 6:17	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 6:17	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 6:17	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 6:17	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/3/23 6:17	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 6:17	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 6:17	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 6:17	SFM
Ethylbenzene	0.36	0.020		1.6	0.087	0.4	5/3/23 6:17	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 6:17	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 6:17	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 6:17	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 6:17	SFM
4-Methyl-2-pentanone (MIBK)	0.10	0.020		0.41	0.082	0.4	5/3/23 6:17	SFM
Styrene	0.12	0.020		0.50	0.085	0.4	5/3/23 6:17	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 6:17	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 6:17	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: IMP-3**Sample ID:** 23D2794-11

Sample Matrix: Sub Slab

Sampled: 4/19/2023 09:48

Sample Description/Location:

Sub Description/Location:

Canister ID: 1987

Canister Size: 6 liter

Flow Controller ID: 4669

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -27

Final Vacuum(in Hg): 0

Receipt Vacuum(in Hg): 0.0

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	ND	0.020		ND	0.14	0.4	5/3/23 6:17	SFM
Toluene	0.74	0.020		2.8	0.075	0.4	5/3/23 6:17	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 6:17	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 6:17	SFM
Trichloroethylene	0.010	0.010		0.054	0.054	0.4	5/3/23 6:17	SFM
Trichlorofluoromethane (Freon 11)	0.18	0.080		1.0	0.45	0.4	5/3/23 6:17	SFM
1,2,4-Trimethylbenzene	0.15	0.020		0.76	0.098	0.4	5/3/23 6:17	SFM
1,3,5-Trimethylbenzene	0.036	0.020		0.18	0.098	0.4	5/3/23 6:17	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 6:17	SFM
m&p-Xylene	1.4	0.040		6.1	0.17	0.4	5/3/23 6:17	SFM
o-Xylene	0.35	0.020		1.5	0.087	0.4	5/3/23 6:17	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	92.8	70-130	5/3/23 6:17
4-Bromofluorobenzene (2)	76.6	70-130	5/3/23 6:17

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: MP-2
Sample ID: 23D2794-12
 Sample Matrix: Sub Slab
 Sampled: 4/19/2023 11:27

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 9006
 Canister Size: 6 liter
 Flow Controller ID: 4746
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -29
 Final Vacuum(in Hg): -3
 Receipt Vacuum(in Hg): -2.1
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	2.7	0.80		6.4	1.9	0.4	5/3/23 7:07	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 7:07	SFM
Benzene	0.072	0.020		0.23	0.064	0.4	5/3/23 7:07	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 7:07	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 7:07	SFM
2-Butanone (MEK)	1.0	0.80		3.0	2.4	0.4	5/3/23 7:07	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 7:07	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 7:07	SFM
Carbon Tetrachloride	0.066	0.010		0.42	0.063	0.4	5/3/23 7:07	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 7:07	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 7:07	SFM
Chloroform	0.013	0.010		0.064	0.049	0.4	5/3/23 7:07	SFM
Chloromethane	1.3	0.040		2.8	0.083	0.4	5/3/23 7:07	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 7:07	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 7:07	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 7:07	SFM
1,3-Dichlorobenzene	0.21	0.020		1.2	0.12	0.4	5/3/23 7:07	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 7:07	SFM
Dichlorodifluoromethane (Freon 12)	0.14	0.020		0.68	0.099	0.4	5/3/23 7:07	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 7:07	SFM
1,2-Dichloroethane	0.012	0.010		0.050	0.040	0.4	5/3/23 7:07	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 7:07	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 7:07	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 7:07	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/3/23 7:07	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 7:07	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 7:07	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 7:07	SFM
Ethylbenzene	1.4	0.020		6.0	0.087	0.4	5/3/23 7:07	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 7:07	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 7:07	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 7:07	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 7:07	SFM
4-Methyl-2-pentanone (MIBK)	0.11	0.020		0.46	0.082	0.4	5/3/23 7:07	SFM
Styrene	0.39	0.020		1.7	0.085	0.4	5/3/23 7:07	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 7:07	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 7:07	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: MP-2**Sample ID:** 23D2794-12

Sample Matrix: Sub Slab

Sampled: 4/19/2023 11:27

Sample Description/Location:

Sub Description/Location:

Canister ID: 9006

Canister Size: 6 liter

Flow Controller ID: 4746

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -3

Receipt Vacuum(in Hg): -2.1

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	0.42	0.020		2.9	0.14	0.4	5/3/23 7:07	SFM
Toluene	1.9	0.020		7.0	0.075	0.4	5/3/23 7:07	SFM
1,1,1-Trichloroethane	0.015	0.010		0.083	0.055	0.4	5/3/23 7:07	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 7:07	SFM
Trichloroethylene	0.16	0.010		0.83	0.054	0.4	5/3/23 7:07	SFM
Trichlorofluoromethane (Freon 11)	0.25	0.080		1.4	0.45	0.4	5/3/23 7:07	SFM
1,2,4-Trimethylbenzene	0.56	0.020		2.7	0.098	0.4	5/3/23 7:07	SFM
1,3,5-Trimethylbenzene	0.15	0.020		0.73	0.098	0.4	5/3/23 7:07	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 7:07	SFM
m&p-Xylene	5.6	0.040		25	0.17	0.4	5/3/23 7:07	SFM
o-Xylene	1.4	0.020		6.2	0.087	0.4	5/3/23 7:07	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	93.2	70-130	5/3/23 7:07
4-Bromofluorobenzene (2)	78.1	70-130	5/3/23 7:07

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: MP-5
Sample ID: 23D2794-13
 Sample Matrix: Sub Slab
 Sampled: 4/19/2023 11:48

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 1884
 Canister Size: 6 liter
 Flow Controller ID: 4275
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -30
 Final Vacuum(in Hg): -4
 Receipt Vacuum(in Hg): -4.7
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Acetone	4.5	0.80		11	1.9	0.4	5/3/23 8:00	SFM
Acrylonitrile	ND	0.12		ND	0.25	0.4	5/3/23 8:00	SFM
Benzene	0.072	0.020		0.23	0.064	0.4	5/3/23 8:00	SFM
Bromodichloromethane	ND	0.010		ND	0.067	0.4	5/3/23 8:00	SFM
Bromoform	ND	0.020		ND	0.21	0.4	5/3/23 8:00	SFM
2-Butanone (MEK)	0.93	0.80		2.7	2.4	0.4	5/3/23 8:00	SFM
n-Butylbenzene	ND	0.058		ND	0.32	0.4	5/3/23 8:00	SFM
sec-Butylbenzene	ND	0.046		ND	0.25	0.4	5/3/23 8:00	SFM
Carbon Tetrachloride	0.068	0.010		0.43	0.063	0.4	5/3/23 8:00	SFM
Chlorobenzene	ND	0.020		ND	0.092	0.4	5/3/23 8:00	SFM
Chloroethane	ND	0.020		ND	0.053	0.4	5/3/23 8:00	SFM
Chloroform	0.015	0.010		0.074	0.049	0.4	5/3/23 8:00	SFM
Chloromethane	0.87	0.040		1.8	0.083	0.4	5/3/23 8:00	SFM
Dibromochloromethane	ND	0.010		ND	0.085	0.4	5/3/23 8:00	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077	0.4	5/3/23 8:00	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12	0.4	5/3/23 8:00	SFM
1,3-Dichlorobenzene	0.086	0.020		0.52	0.12	0.4	5/3/23 8:00	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12	0.4	5/3/23 8:00	SFM
Dichlorodifluoromethane (Freon 12)	0.14	0.020		0.70	0.099	0.4	5/3/23 8:00	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040	0.4	5/3/23 8:00	SFM
1,2-Dichloroethane	0.014	0.010		0.055	0.040	0.4	5/3/23 8:00	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 8:00	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 8:00	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040	0.4	5/3/23 8:00	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046	0.4	5/3/23 8:00	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25	0.4	5/3/23 8:00	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 8:00	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045	0.4	5/3/23 8:00	SFM
Ethylbenzene	1.6	0.020		7.0	0.087	0.4	5/3/23 8:00	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25	0.4	5/3/23 8:00	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25	0.4	5/3/23 8:00	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072	0.4	5/3/23 8:00	SFM
Methylene Chloride	ND	0.20		ND	0.69	0.4	5/3/23 8:00	SFM
4-Methyl-2-pentanone (MIBK)	0.17	0.020		0.70	0.082	0.4	5/3/23 8:00	SFM
Styrene	0.42	0.020		1.8	0.085	0.4	5/3/23 8:00	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25	0.4	5/3/23 8:00	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069	0.4	5/3/23 8:00	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: MP-5**Sample ID:** 23D2794-13

Sample Matrix: Sub Slab

Sampled: 4/19/2023 11:48

Sample Description/Location:

Sub Description/Location:

Canister ID: 1884

Canister Size: 6 liter

Flow Controller ID: 4275

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -30

Final Vacuum(in Hg): -4

Receipt Vacuum(in Hg): -4.7

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL		
Tetrachloroethylene	0.058	0.020		0.40	0.14	0.4	5/3/23 8:00 SFM
Toluene	1.4	0.020		5.3	0.075	0.4	5/3/23 8:00 SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 8:00 SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 8:00 SFM
Trichloroethylene	2.1	0.010		11	0.054	0.4	5/3/23 8:00 SFM
Trichlorofluoromethane (Freon 11)	0.34	0.080		1.9	0.45	0.4	5/3/23 8:00 SFM
1,2,4-Trimethylbenzene	0.72	0.020		3.6	0.098	0.4	5/3/23 8:00 SFM
1,3,5-Trimethylbenzene	0.19	0.020		0.92	0.098	0.4	5/3/23 8:00 SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 8:00 SFM
m&p-Xylene	6.7	0.040		29	0.17	0.4	5/3/23 8:00 SFM
o-Xylene	1.8	0.020		7.7	0.087	0.4	5/3/23 8:00 SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	91.8	70-130	5/3/23 8:00
4-Bromofluorobenzene (2)	76.5	70-130	5/3/23 8:00

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: MP-7
Sample ID: 23D2794-14
 Sample Matrix: Sub Slab
 Sampled: 4/19/2023 11:55

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 1163
 Canister Size: 6 liter
 Flow Controller ID: 4286
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -30
 Final Vacuum(in Hg): -5
 Receipt Vacuum(in Hg): -2.9
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv			ug/m3			Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL				
Acetone	4.5	0.80		11	1.9		0.4	5/3/23 8:51	SFM
Acrylonitrile	ND	0.12		ND	0.25		0.4	5/3/23 8:51	SFM
Benzene	0.037	0.020		0.12	0.064		0.4	5/3/23 8:51	SFM
Bromodichloromethane	ND	0.010		ND	0.067		0.4	5/3/23 8:51	SFM
Bromoform	ND	0.020		ND	0.21		0.4	5/3/23 8:51	SFM
2-Butanone (MEK)	1.6	0.80		4.8	2.4		0.4	5/3/23 8:51	SFM
n-Butylbenzene	ND	0.058		ND	0.32		0.4	5/3/23 8:51	SFM
sec-Butylbenzene	ND	0.046		ND	0.25		0.4	5/3/23 8:51	SFM
Carbon Tetrachloride	0.065	0.010		0.41	0.063		0.4	5/3/23 8:51	SFM
Chlorobenzene	ND	0.020		ND	0.092		0.4	5/3/23 8:51	SFM
Chloroethane	0.024	0.020		0.064	0.053		0.4	5/3/23 8:51	SFM
Chloroform	0.013	0.010		0.064	0.049		0.4	5/3/23 8:51	SFM
Chloromethane	0.57	0.040		1.2	0.083		0.4	5/3/23 8:51	SFM
Dibromochloromethane	ND	0.010		ND	0.085		0.4	5/3/23 8:51	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077		0.4	5/3/23 8:51	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12		0.4	5/3/23 8:51	SFM
1,3-Dichlorobenzene	0.058	0.020		0.35	0.12		0.4	5/3/23 8:51	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12		0.4	5/3/23 8:51	SFM
Dichlorodifluoromethane (Freon 12)	0.14	0.020		0.70	0.099		0.4	5/3/23 8:51	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040		0.4	5/3/23 8:51	SFM
1,2-Dichloroethane	ND	0.010		ND	0.040		0.4	5/3/23 8:51	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 8:51	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 8:51	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 8:51	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046		0.4	5/3/23 8:51	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25		0.4	5/3/23 8:51	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/3/23 8:51	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/3/23 8:51	SFM
Ethylbenzene	1.3	0.020		5.8	0.087		0.4	5/3/23 8:51	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25		0.4	5/3/23 8:51	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25		0.4	5/3/23 8:51	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072		0.4	5/3/23 8:51	SFM
Methylene Chloride	ND	0.20		ND	0.69		0.4	5/3/23 8:51	SFM
4-Methyl-2-pentanone (MIBK)	0.18	0.020		0.73	0.082		0.4	5/3/23 8:51	SFM
Styrene	0.40	0.020		1.7	0.085		0.4	5/3/23 8:51	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25		0.4	5/3/23 8:51	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069		0.4	5/3/23 8:51	SFM

 39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: MP-7**Sample ID:** 23D2794-14

Sample Matrix: Sub Slab

Sampled: 4/19/2023 11:55

Sample Description/Location:

Sub Description/Location:

Canister ID: 1163

Canister Size: 6 liter

Flow Controller ID: 4286

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -30

Final Vacuum(in Hg): -5

Receipt Vacuum(in Hg): -2.9

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	0.020	0.020		0.14	0.14	0.4	5/3/23 8:51	SFM
Toluene	0.99	0.020		3.7	0.075	0.4	5/3/23 8:51	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 8:51	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 8:51	SFM
Trichloroethylene	0.049	0.010		0.26	0.054	0.4	5/3/23 8:51	SFM
Trichlorofluoromethane (Freon 11)	0.24	0.080		1.4	0.45	0.4	5/3/23 8:51	SFM
1,2,4-Trimethylbenzene	0.90	0.020		4.4	0.098	0.4	5/3/23 8:51	SFM
1,3,5-Trimethylbenzene	0.21	0.020		1.0	0.098	0.4	5/3/23 8:51	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 8:51	SFM
m&p-Xylene	5.6	0.040		24	0.17	0.4	5/3/23 8:51	SFM
o-Xylene	1.5	0.020		6.7	0.087	0.4	5/3/23 8:51	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	93.3	70-130	5/3/23 8:51
4-Bromofluorobenzene (2)	79.0	70-130	5/3/23 8:51

ANALYTICAL RESULTS

Project Location: Providence, RI
 Date Received: 4/24/2023
Field Sample #: MP-8
Sample ID: 23D2794-15
 Sample Matrix: Sub Slab
 Sampled: 4/19/2023 11:28

Sample Description/Location:
 Sub Description/Location:
 Canister ID: 9015
 Canister Size: 6 liter
 Flow Controller ID: 4747
 Sample Type: 30 min

Work Order: 23D2794
 Initial Vacuum(in Hg): -29
 Final Vacuum(in Hg): -4
 Receipt Vacuum(in Hg): -2.6
 Flow Controller Type: Fixed-Orifice
 Flow Controller Calibration
 RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv			ug/m3			Dilution	Date/Time Analyzed	Analyst
	Results	RL	Flag/Qual	Results	RL				
Acetone	6.5	0.80		16	1.9		0.4	5/3/23 9:42	SFM
Acrylonitrile	ND	0.12		ND	0.25		0.4	5/3/23 9:42	SFM
Benzene	0.075	0.020		0.24	0.064		0.4	5/3/23 9:42	SFM
Bromodichloromethane	ND	0.010		ND	0.067		0.4	5/3/23 9:42	SFM
Bromoform	ND	0.020		ND	0.21		0.4	5/3/23 9:42	SFM
2-Butanone (MEK)	4.4	0.80		13	2.4		0.4	5/3/23 9:42	SFM
n-Butylbenzene	ND	0.058		ND	0.32		0.4	5/3/23 9:42	SFM
sec-Butylbenzene	ND	0.046		ND	0.25		0.4	5/3/23 9:42	SFM
Carbon Tetrachloride	0.070	0.010		0.44	0.063		0.4	5/3/23 9:42	SFM
Chlorobenzene	ND	0.020		ND	0.092		0.4	5/3/23 9:42	SFM
Chloroethane	ND	0.020		ND	0.053		0.4	5/3/23 9:42	SFM
Chloroform	0.012	0.010		0.061	0.049		0.4	5/3/23 9:42	SFM
Chloromethane	0.45	0.040		0.92	0.083		0.4	5/3/23 9:42	SFM
Dibromochloromethane	ND	0.010		ND	0.085		0.4	5/3/23 9:42	SFM
1,2-Dibromoethane (EDB)	ND	0.010		ND	0.077		0.4	5/3/23 9:42	SFM
1,2-Dichlorobenzene	ND	0.020	V-05	ND	0.12		0.4	5/3/23 9:42	SFM
1,3-Dichlorobenzene	0.37	0.020		2.2	0.12		0.4	5/3/23 9:42	SFM
1,4-Dichlorobenzene	ND	0.020		ND	0.12		0.4	5/3/23 9:42	SFM
Dichlorodifluoromethane (Freon 12)	0.15	0.020		0.73	0.099		0.4	5/3/23 9:42	SFM
1,1-Dichloroethane	ND	0.010		ND	0.040		0.4	5/3/23 9:42	SFM
1,2-Dichloroethane	0.016	0.010		0.065	0.040		0.4	5/3/23 9:42	SFM
1,1-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 9:42	SFM
cis-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 9:42	SFM
trans-1,2-Dichloroethylene	ND	0.010		ND	0.040		0.4	5/3/23 9:42	SFM
1,2-Dichloropropane	ND	0.010		ND	0.046		0.4	5/3/23 9:42	SFM
1,3-Dichloropropane	ND	0.054		ND	0.25		0.4	5/3/23 9:42	SFM
cis-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/3/23 9:42	SFM
trans-1,3-Dichloropropene	ND	0.010		ND	0.045		0.4	5/3/23 9:42	SFM
Ethylbenzene	1.2	0.020		5.1	0.087		0.4	5/3/23 9:42	SFM
Isopropylbenzene (Cumene)	ND	0.051		ND	0.25		0.4	5/3/23 9:42	SFM
p-Isopropyltoluene (p-Cymene)	ND	0.046		ND	0.25		0.4	5/3/23 9:42	SFM
Methyl tert-Butyl Ether (MTBE)	ND	0.020		ND	0.072		0.4	5/3/23 9:42	SFM
Methylene Chloride	ND	0.20		ND	0.69		0.4	5/3/23 9:42	SFM
4-Methyl-2-pentanone (MIBK)	0.11	0.020		0.45	0.082		0.4	5/3/23 9:42	SFM
Styrene	0.36	0.020		1.5	0.085		0.4	5/3/23 9:42	SFM
1,1,1,2-Tetrachloroethane	ND	0.036	L-03	ND	0.25		0.4	5/3/23 9:42	SFM
1,1,2,2-Tetrachloroethane	ND	0.010		ND	0.069		0.4	5/3/23 9:42	SFM

ANALYTICAL RESULTS

Project Location: Providence, RI

Date Received: 4/24/2023

Field Sample #: MP-8**Sample ID:** 23D2794-15

Sample Matrix: Sub Slab

Sampled: 4/19/2023 11:28

Sample Description/Location:

Sub Description/Location:

Canister ID: 9015

Canister Size: 6 liter

Flow Controller ID: 4747

Sample Type: 30 min

Work Order: 23D2794

Initial Vacuum(in Hg): -29

Final Vacuum(in Hg): -4

Receipt Vacuum(in Hg): -2.6

Flow Controller Type: Fixed-Orifice

Flow Controller Calibration

RPD Pre and Post-Sampling:

EPA TO-15

Analyte	ppbv		ug/m3		Dilution	Date/Time Analyzed	Analyst	
	Results	RL	Flag/Qual	Results	RL			
Tetrachloroethylene	0.025	0.020		0.17	0.14	0.4	5/3/23 9:42	SFM
Toluene	1.8	0.020		6.6	0.075	0.4	5/3/23 9:42	SFM
1,1,1-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 9:42	SFM
1,1,2-Trichloroethane	ND	0.010		ND	0.055	0.4	5/3/23 9:42	SFM
Trichloroethylene	0.010	0.010		0.054	0.054	0.4	5/3/23 9:42	SFM
Trichlorofluoromethane (Freon 11)	0.18	0.080		1.0	0.45	0.4	5/3/23 9:42	SFM
1,2,4-Trimethylbenzene	0.56	0.020		2.8	0.098	0.4	5/3/23 9:42	SFM
1,3,5-Trimethylbenzene	0.14	0.020		0.67	0.098	0.4	5/3/23 9:42	SFM
Vinyl Chloride	ND	0.020		ND	0.051	0.4	5/3/23 9:42	SFM
m&p-Xylene	4.7	0.040		20	0.17	0.4	5/3/23 9:42	SFM
o-Xylene	1.1	0.020		4.9	0.087	0.4	5/3/23 9:42	SFM

Surrogates	% Recovery	% REC Limits	
4-Bromofluorobenzene (1)	93.4	70-130	5/3/23 9:42
4-Bromofluorobenzene (2)	78.2	70-130	5/3/23 9:42

 39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data

Prep Method: TO-15 Prep	Analytical Method: EP		Pressure Dilution	Pre Dilution	Pre-Dil Initial mL	Pre-Dil Final mL	Default Injection mL	Actual Injection mL	Date
Lab Number [Field ID]		Batch							
23D2794-01 [Gymnasium]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-02 [Cafeteria]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-03 [Kitchen Storage]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-04 [Elevator Hallway]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-05 [Room 145]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-06 [Room 152]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-07 [Room 118]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-08 [Room 110]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-09 [Ambient Outdoor Air]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-10 [IMP-1]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-11 [IMP-3]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-12 [MP-2]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-13 [MP-5]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-14 [MP-7]		B339376	1	1	N/A	1000	400	1000	05/02/23
23D2794-15 [MP-8]		B339376	1	1	N/A	1000	400	1000	05/02/23

QUALITY CONTROL**Air Toxics by EPA Compendium Methods - Quality Control**

Analyte	ppbv Results	RL	ug/m3 Results	RL	Spike Level ppbv	Source Result	%REC	%REC Limits	RPD RPD	RPD Limit	Flag/Qual
---------	-----------------	----	------------------	----	---------------------	------------------	------	----------------	------------	--------------	-----------

Batch B339376 - TO-15 Prep

Blank (B339376-BLK1)	Prepared & Analyzed: 05/02/23									
Acetone	ND	1.4								
Acrylonitrile	ND	0.20								
Benzene	ND	0.035								
Bromodichloromethane	ND	0.018								
Bromoform	ND	0.035								
2-Butanone (MEK)	ND	1.4								
n-Butylbenzene	ND	0.10								
sec-Butylbenzene	ND	0.080								
Carbon Tetrachloride	ND	0.018								
Chlorobenzene	ND	0.035								
Chloroethane	ND	0.035								
Chloroform	ND	0.018								
Chloromethane	ND	0.070								
Dibromochloromethane	ND	0.018								
1,2-Dibromoethane (EDB)	ND	0.018								
1,2-Dichlorobenzene	ND	0.035								V-05
1,3-Dichlorobenzene	ND	0.035								
1,4-Dichlorobenzene	ND	0.035								
Dichlorodifluoromethane (Freon 12)	ND	0.035								
1,1-Dichloroethane	ND	0.018								
1,2-Dichloroethane	ND	0.018								
1,1-Dichloroethylene	ND	0.018								
cis-1,2-Dichloroethylene	ND	0.018								
trans-1,2-Dichloroethylene	ND	0.018								
1,2-Dichloropropane	ND	0.018								
1,3-Dichloropropane	ND	0.095								
cis-1,3-Dichloropropene	ND	0.018								
trans-1,3-Dichloropropene	ND	0.018								
Ethylbenzene	ND	0.035								
Isopropylbenzene (Cumene)	ND	0.089								
p-Isopropyltoluene (p-Cymene)	ND	0.080								
Methyl tert-Butyl Ether (MTBE)	ND	0.035								
Methylene Chloride	ND	0.35								
4-Methyl-2-pentanone (MIBK)	ND	0.035								
Styrene	ND	0.035								
1,1,1,2-Tetrachloroethane	ND	0.064								L-03
1,1,2,2-Tetrachloroethane	ND	0.018								
Tetrachloroethylene	ND	0.035								
Toluene	ND	0.035								
1,1,1-Trichloroethane	ND	0.018								
1,1,2-Trichloroethane	ND	0.018								
Trichloroethylene	ND	0.018								
Trichlorofluoromethane (Freon 11)	ND	0.14								
1,2,4-Trimethylbenzene	ND	0.035								
1,3,5-Trimethylbenzene	ND	0.035								
Vinyl Chloride	ND	0.035								

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL**Air Toxics by EPA Compendium Methods - Quality Control**

Analyte	ppbv Results	RL	ug/m3 Results	RL	Spike Level ppbv	Source Result	%REC %REC	%REC Limits	RPD RPD	RPD Limit	Flag/Qual
---------	-----------------	----	------------------	----	---------------------	------------------	--------------	----------------	------------	--------------	-----------

Batch B339376 - TO-15 Prep

Blank (B339376-BLK1)	Prepared & Analyzed: 05/02/23						
m&p-Xylene	ND	0.070					
o-Xylene	ND	0.035					
Surrogate: 4-Bromofluorobenzene (1)	7.33		8.00		91.6	70-130	
Surrogate: 4-Bromofluorobenzene (2)	6.11		8.00		76.3	70-130	
LCS (B339376-BS1)	Prepared & Analyzed: 05/02/23						
Acetone	5.64		5.00		113	70-130	
Acrylonitrile	3.13		2.88		109	70-130	
Benzene	4.99		5.00		99.9	70-130	
Bromodichloromethane	5.18		5.00		104	70-130	
Bromoform	4.54		5.00		90.8	70-130	
2-Butanone (MEK)	4.99		5.00		99.8	70-130	
n-Butylbenzene	1.09		1.14		95.7	70-130	
sec-Butylbenzene	1.14		1.14		99.8	70-130	
Carbon Tetrachloride	4.68		5.00		93.6	70-130	
Chlorobenzene	4.60		5.00		92.0	70-130	
Chloroethane	4.85		5.00		96.9	70-130	
Chloroform	4.43		5.00		88.7	70-130	
Chloromethane	4.63		5.00		92.5	70-130	
Dibromochloromethane	4.77		5.00		95.4	70-130	
1,2-Dibromoethane (EDB)	4.98		5.00		99.6	70-130	
1,2-Dichlorobenzene	4.48		5.00		89.7	70-130	V-05
1,3-Dichlorobenzene	4.54		5.00		90.9	70-130	
1,4-Dichlorobenzene	4.60		5.00		91.9	70-130	
Dichlorodifluoromethane (Freon 12)	4.49		5.00		89.8	70-130	
1,1-Dichloroethane	4.35		5.00		86.9	70-130	
1,2-Dichloroethane	4.77		5.00		95.4	70-130	
1,1-Dichloroethylene	4.76		5.00		95.3	70-130	
cis-1,2-Dichloroethylene	4.56		5.00		91.2	70-130	
trans-1,2-Dichloroethylene	4.52		5.00		90.5	70-130	
1,2-Dichloropropane	5.14		5.00		103	70-130	
1,3-Dichloropropane	1.09		1.35		80.7	70-130	
cis-1,3-Dichloropropene	5.09		5.00		102	70-130	
trans-1,3-Dichloropropene	5.20		5.00		104	70-130	
Ethylbenzene	5.06		5.00		101	70-130	
Isopropylbenzene (Cumene)	1.15		1.27		90.7	70-130	
p-Isopropyltoluene (p-Cymene)	1.12		1.14		97.9	70-130	
Methyl tert-Butyl Ether (MTBE)	4.12		5.00		82.5	70-130	
Methylene Chloride	4.42		5.00		88.3	70-130	
4-Methyl-2-pentanone (MIBK)	6.32		5.00		126	70-130	
Styrene	5.34		5.00		107	70-130	
1,1,1,2-Tetrachloroethane	0.614		0.910		67.5 *	70-130	L-03
1,1,2,2-Tetrachloroethane	4.91		5.00		98.1	70-130	
Tetrachloroethylene	4.32		5.00		86.4	70-130	
Toluene	4.92		5.00		98.5	70-130	
1,1,1-Trichloroethane	4.95		5.00		99.1	70-130	
1,1,2-Trichloroethane	4.85		5.00		97.1	70-130	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL**Air Toxics by EPA Compendium Methods - Quality Control**

Analyte	ppbv Results	RL	ug/m3 Results	RL	Spike Level ppbv	Source Result	%REC %REC	RPD Limits	RPD RPD	RPD Limit	Flag/Qual
---------	-----------------	----	------------------	----	---------------------	------------------	--------------	---------------	------------	--------------	-----------

Batch B339376 - TO-15 Prep

LCS (B339376-BS1)	Prepared & Analyzed: 05/02/23						
Trichlorethylene	5.22			5.00		104	70-130
Trichlorofluoromethane (Freon 11)	5.09			5.00		102	70-130
1,2,4-Trimethylbenzene	5.16			5.00		103	70-130
1,3,5-Trimethylbenzene	5.11			5.00		102	70-130
Vinyl Chloride	4.71			5.00		94.2	70-130
m&p-Xylene	10.2			10.0		102	70-130
o-Xylene	5.15			5.00		103	70-130
<i>Surrogate: 4-Bromofluorobenzene (1)</i>	7.58			8.00		94.8	70-130
<i>Surrogate: 4-Bromofluorobenzene (2)</i>	6.04			8.00		75.4	70-130

Duplicate (B339376-DUP1)	Source: 23D2794-10					Prepared: 05/02/23 Analyzed: 05/03/23					
Acetone	8.9	0.80	21	1.9		9.2		4.05	25		
Acrylonitrile	ND	0.12	ND	0.25		ND			25		
Benzene	0.087	0.020	0.28	0.064		0.090		3.62	25		
Bromodichloromethane	ND	0.010	ND	0.067		ND			25		
Bromoform	ND	0.020	ND	0.21		ND			25		
2-Butanone (MEK)	1.7	0.80	5.1	2.4		1.7		0.373	25		
n-Butylbenzene	0.026	0.058	0.14	0.32		0.026		0.00	25		
sec-Butylbenzene	ND	0.046	ND	0.25		ND			25		
Carbon Tetrachloride	0.067	0.010	0.42	0.063		0.066		1.20	25		
Chlorobenzene	ND	0.020	ND	0.092		ND			25		
Chloroethane	ND	0.020	ND	0.053		ND			25		
Chloroform	0.016	0.010	0.078	0.049		0.015		5.13	25		
Chloromethane	0.45	0.040	0.93	0.083		0.47		4.75	25		
Dibromochloromethane	ND	0.010	ND	0.085		ND			25		
1,2-Dibromoethane (EDB)	ND	0.010	ND	0.077		ND			25		
1,2-Dichlorobenzene	ND	0.020	ND	0.12		ND			25		V-05
1,3-Dichlorobenzene	0.24	0.020	1.4	0.12		0.24		0.334	25		
1,4-Dichlorobenzene	0.022	0.020	0.13	0.12		0.021		5.61	25		
Dichlorodifluoromethane (Freon 12)	0.14	0.020	0.67	0.099		0.15		6.82	25		
1,1-Dichloroethane	ND	0.010	ND	0.040		ND			25		
1,2-Dichloroethane	0.017	0.010	0.068	0.040		0.015		12.7	25		
1,1-Dichloroethylene	ND	0.010	ND	0.040		ND			25		
cis-1,2-Dichloroethylene	ND	0.010	ND	0.040		ND			25		
trans-1,2-Dichloroethylene	ND	0.010	ND	0.040		ND			25		
1,2-Dichloropropane	0.0080	0.010	0.037	0.046		0.0088		9.52	25		
1,3-Dichloropropane	ND	0.054	ND	0.25		ND			25		
cis-1,3-Dichloropropene	ND	0.010	ND	0.045		ND			25		
trans-1,3-Dichloropropene	ND	0.010	ND	0.045		ND			25		
Ethylbenzene	1.6	0.020	7.1	0.087		1.6		3.06	25		
Isopropylbenzene (Cumene)	0.024	0.051	0.12	0.25		0.023		3.45	25		
p-Isopropyltoluene (p-Cymene)	0.068	0.046	0.38	0.25		0.067		1.77	25		
Methyl tert-Butyl Ether (MTBE)	ND	0.020	ND	0.072		ND			25		
Methylene Chloride	0.080	0.20	0.28	0.69		0.080		0.00	25		
4-Methyl-2-pentanone (MIBK)	0.31	0.020	1.3	0.082		0.32		3.39	25		
Styrene	0.61	0.020	2.6	0.085		0.60		2.18	25		
1,1,1,2-Tetrachloroethane	ND	0.036	ND	0.25		ND			25		L-03

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Air Toxics by EPA Compendium Methods - Quality Control

Analyte	ppbv Results	RL	ug/m3 Results	RL	Spike Level ppbv	Source Result	%REC %REC	Limits	RPD RPD	Limit	Flag/Qual
---------	-----------------	----	------------------	----	---------------------	------------------	--------------	--------	------------	-------	-----------

Batch B339376 - TO-15 Prep

Duplicate (B339376-DUP1)	Source: 23D2794-10				Prepared: 05/02/23 Analyzed: 05/03/23						
1,1,2,2-Tetrachloroethane	ND	0.010	ND	0.069		ND				25	
Tetrachloroethylene	0.018	0.020	0.12	0.14		0.018			0.00	25	
Toluene	1.9	0.020	7.3	0.075		1.9			2.95	25	
1,1,1-Trichloroethane	ND	0.010	ND	0.055		ND				25	
1,1,2-Trichloroethane	ND	0.010	ND	0.055		ND				25	
Trichloroethylene	0.018	0.010	0.095	0.054		0.018			2.25	25	
Trichlorofluoromethane (Freon 11)	0.19	0.080	1.1	0.45		0.20			3.64	25	
1,2,4-Trimethylbenzene	0.82	0.020	4.0	0.098		0.89			8.03	25	
1,3,5-Trimethylbenzene	0.23	0.020	1.1	0.098		0.22			7.33	25	
Vinyl Chloride	ND	0.020	ND	0.051		ND				25	
m&p-Xylene	6.4	0.040	28	0.17		6.3			1.78	25	
o-Xylene	1.6	0.020	7.0	0.087		1.6			2.97	25	
<i>Surrogate: 4-Bromofluorobenzene (1)</i>	7.34			8.00		91.7		70-130			
<i>Surrogate: 4-Bromofluorobenzene (2)</i>	6.11			8.00		76.3		70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

FLAG/QUALIFIER SUMMARY

- * QC result is outside of established limits.
 - † Wide recovery limits established for difficult compound.
 - ‡ Wide RPD limits established for difficult compound.
 - # Data exceeded client recommended or regulatory level
 - ND Not Detected
 - RL Reporting Limit is at the level of quantitation (LOQ)
 - DL Detection Limit is the lower limit of detection determined by the MDL study
 - MCL Maximum Contaminant Level
- Percent recoveries and relative percent differences (RPDs) are determined by the software using values in the calculation which have not been rounded.
- No results have been blank subtracted unless specified in the case narrative section.
- L-03 Laboratory fortified blank/laboratory control sample recovery is outside of control limits. Reported value for this compound is likely to be biased on the low side.
 - V-05 Continuing calibration verification (CCV) did not meet method specifications and was biased on the low side for this compound.

 39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

CERTIFICATIONS
Certified Analyses included in this Report

Analyte	Certifications
EPA TO-15 in Air	
Acetone	AIHA,NY,ME,NH
Acrylonitrile	AIHA,NJ,NY,ME,NH
Benzene	AIHA,FL,NJ,NY,ME,NH,VA
Bromodichloromethane	AIHA,NJ,NY,ME,NH,VA
Bromoform	AIHA,NJ,NY,ME,NH,VA
2-Butanone (MEK)	AIHA,FL,NJ,NY,ME,NH,VA
Carbon Tetrachloride	AIHA,FL,NJ,NY,ME,NH,VA
Chlorobenzene	AIHA,FL,NJ,NY,ME,NH,VA
Chloroethane	AIHA,FL,NJ,NY,ME,NH,VA
Chloroform	AIHA,FL,NJ,NY,ME,NH,VA
Chloromethane	AIHA,FL,NJ,NY,ME,NH,VA
Dibromochloromethane	AIHA,NY,ME,NH
1,2-Dibromoethane (EDB)	AIHA,NJ,NY,ME,NH
1,2-Dichlorobenzene	AIHA,FL,NJ,NY,ME,NH,VA
1,3-Dichlorobenzene	AIHA,NJ,NY,ME,NH
1,4-Dichlorobenzene	AIHA,FL,NJ,NY,ME,NH,VA
Dichlorodifluoromethane (Freon 12)	AIHA,NY,ME,NH
1,1-Dichloroethane	AIHA,FL,NJ,NY,ME,NH,VA
1,2-Dichloroethane	AIHA,FL,NJ,NY,ME,NH,VA
1,1-Dichloroethylene	AIHA,FL,NJ,NY,ME,NH,VA
cis-1,2-Dichloroethylene	AIHA,FL,NY,ME,NH,VA
trans-1,2-Dichloroethylene	AIHA,NJ,NY,ME,NH,VA
1,2-Dichloropropane	AIHA,FL,NJ,NY,ME,NH,VA
cis-1,3-Dichloropropene	AIHA,FL,NJ,NY,ME,NH,VA
trans-1,3-Dichloropropene	AIHA,NY,ME,NH
Ethylbenzene	AIHA,FL,NJ,NY,ME,NH,VA
Isopropylbenzene (Cumene)	AIHA,NJ,NY,ME,NH
Methyl tert-Butyl Ether (MTBE)	AIHA,FL,NJ,NY,ME,NH,VA
Methylene Chloride	AIHA,FL,NJ,NY,ME,NH,VA
4-Methyl-2-pentanone (MIBK)	AIHA,FL,NJ,NY,ME,NH
Styrene	AIHA,FL,NJ,NY,ME,NH,VA
1,1,2,2-Tetrachloroethane	AIHA,FL,NJ,NY,ME,NH,VA
Tetrachloroethylene	AIHA,FL,NJ,NY,ME,NH,VA
Toluene	AIHA,FL,NJ,NY,ME,NH,VA
1,1,1-Trichloroethane	AIHA,FL,NJ,NY,ME,NH,VA
1,1,2-Trichloroethane	AIHA,FL,NJ,NY,ME,NH,VA
Trichloroethylene	AIHA,FL,NJ,NY,ME,NH,VA
Trichlorofluoromethane (Freon 11)	AIHA,NY,ME,NH
1,2,4-Trimethylbenzene	AIHA,NJ,NY,ME,NH
1,3,5-Trimethylbenzene	AIHA,NJ,NY,ME,NH
Vinyl Chloride	AIHA,FL,NJ,NY,ME,NH,VA
m&p-Xylene	AIHA,FL,NJ,NY,ME,NH,VA
o-Xylene	AIHA,FL,NJ,NY,ME,NH,VA



39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Con-Test, a Pace Environmental Laboratory, operates under the following certifications and accreditations:

Code	Description	Number	Expires
AIHA	AIHA-LAP, LLC - ISO 17025:2017	100033	03/1/2024
NY	New York State Department of Health	10899 NELAP	04/1/2024
NH	New Hampshire Environmental Lab	2516 NELAP	02/5/2024
NJ	New Jersey DEP	MA007 NELAP	06/30/2023
FL	Florida Department of Health	E871027 NELAP	06/30/2023
ME	State of Maine	MA00100	06/9/2023
VA	Commonwealth of Virginia	460217	12/14/2023


<http://www.pacelabs.com>

DOC #378 REV3_11232021

Phone: 413-525-2332
 Fax: 413-525-6405
www.pacelabs.com

CHAIN OF CUSTODY RECORD (AIR)

ANALYSIS REQUESTED									
Lab Receipt Pressure									
Final Pressure									
Initial Pressure									
Please fill out completely, sign, date and retain the yellow copy for your records									
Summa canisters and flow controllers must be returned within 15 days of receipt or rental fees will apply									
For summa canister and flow controller information please refer to Con-Test's Air Media Agreement									
7-Day	<input type="checkbox"/>	10-Day	<input checked="" type="checkbox"/>	" Hg					
Due Date:									
Project Number:	150606								
Project Manager:	Frank Postore								
Pace Quote Name/Number:									
Invoice Recipient:	Metamix Dine								
Sampled By:	TC / LL								
Lab Use	Client Use	Collection Data		Duration	Flow Rate	Matrix	Volume		
Pace Work Order#	Client Sample ID / Description	Beginning Date/Time	Ending Date/Time	Total Minutes Sampled	<input type="checkbox"/> m ³ /min	L/min	<input checked="" type="checkbox"/> Liters m ³		
01	Gymnasium	4/19 11:28	4/19 16:09	41		TA	6	X	
02	Cafeeteria	4/19 11:33	4/19 16:03	30			~	V	
03	Kitchen Storage	4/19 11:35	4/19 10:05	30			~	V	
04	Elevator Hallway	4/19 11:23	4/19 11:53	30			~	V	
05	Room 145	4/19 11:25	4/19 11:55	30			~	V	
06	Room 162	4/19 11:26	4/19 11:28	20			~	V	
07	Room 118	4/19 11:34	4/19 11:44	30			~	V	
08	Door	4/19 11:37	4/19 11:37	20			~	V	
09	Ambient Cut-off Air	4/19 10:41	4/19 11:12	31		AMB	~	V	
Comments:	Please report in mg/m ³								
Please use the following codes to indicate possible sample concentration within the Conc Code column above: H - High; M - Medium; L - Low; C - Clear; U - Unknown									
Matrix Codes: SG = SOIL GAS IA = INDOOR AIR AMB = AMBIENT SS = SUB SLAB D = DUP BL = BLANK O = Other _____									
Relinquished by: (signature) <i>Marij</i>	Date/Time: 4/24/23 11:11a	Discretionary Sampling		Special Requirements					
Received by: (signature) <i>Frank Postore</i>	Date/Time: 4/24/23 11:11			<input type="checkbox"/> MA MCP Required					
Relinquished by: (signature) <i>Frank Postore</i>	Date/Time: 4/24/23 11:30			<input type="checkbox"/> MCP Certification Form Required					
Received by: (signature) <i>Frank Postore</i>	Date/Time: 4/24/23 11:30			<input type="checkbox"/> CT RCP Required					
Relinquished by: (signature) <i>Frank Postore</i>	Date/Time: 4/24/23 11:30			<input type="checkbox"/> RCP Certification Form Required					
Received by: (signature) <i>M. Murphy</i>	Date/Time: 4/24/23 11:11								
Received by: (signature) <i>M. Murphy</i>	Date/Time: 4/24/23 11:11								
NEA/C and AIHA-LAP, LLC Accredited									
Project Entity									
Government <input type="checkbox"/> Municipality <input type="checkbox"/> MWRA <input type="checkbox"/> WRTA Federal <input type="checkbox"/> 21 J <input checked="" type="checkbox"/> School <input type="checkbox"/> Brownfield City <input type="checkbox"/> MBTA <input type="checkbox"/> Other									
Chromatogram <input type="checkbox"/> AIHA-LAP, LLC <input type="checkbox"/> PCB ONLY <input type="checkbox"/> Soxhlet <input type="checkbox"/> Non Soxhlet									

*2 of 2**Pace Analytical®*

CHAIN OF CUSTODY RECORD (AIR)

Phone: 413-525-2332

Fax: 413-525-6405

www.pacelabs.com

23027941

P.O. Box 1000

Billerica, MA 01821

Phone: 978-256-5745

Project Name:

B4 Engineering Inc.

Address: 301 Autore Center Blvd., Woburn, MA 01789

Phone: 401-352-5745

Project Location:

Providence, RI

Project Number:

1606610

Project Manager:

Frank Gestone

Pace Quote Name/Number:

Invoice Recipient:

McNamee, Inc.

Sampled By:

TC/LL

Lab Use:

Client Use:

Collection Data:

Pace Work Order#:

Client Sample ID / Description:

Beginning Date/Time:

4-24-13 09:32

Ending Date/Time:

4-24-13 10:08

Total Minutes Sampled:

36

Code:

SS

Flow Rate:

m/min

Duration:

L/min

Matrix:

L

Volume:

Liters m³

Comments:

Date/Time:

4-24-13 10:08

Date/Time:

4-24-13 11:16

Date/Time:

4-24-13 11:30

Date/Time:

4-24-13 11:48

Date/Time:

4-24-13 11:55

Date/Time:

4-24-13 11:58

Date/Time:

4-24-13 12:02

Date/Time:

4-24-13 12:08

Date/Time:

4-24-13 12:12

Date/Time:

4-24-13 12:16

Date/Time:

4-24-13 12:20

Date/Time:

4-24-13 12:24

Date/Time:

4-24-13 12:28

Date/Time:

4-24-13 12:32

Date/Time:

4-24-13 12:36

Date/Time:

4-24-13 12:40

Date/Time:

4-24-13 12:44

Date/Time:

4-24-13 12:48

Date/Time:

4-24-13 12:52

Date/Time:

4-24-13 12:56

Date/Time:

4-24-13 12:58

Date/Time:

4-24-13 13:02

Date/Time:

4-24-13 13:06

Date/Time:

4-24-13 13:10

Date/Time:

4-24-13 13:14

Date/Time:

4-24-13 13:18

Date/Time:

4-24-13 13:22

Date/Time:

4-24-13 13:26

Date/Time:

4-24-13 13:30

Date/Time:

4-24-13 13:34

Date/Time:

4-24-13 13:38

Date/Time:

4-24-13 13:42

Date/Time:

4-24-13 13:46

Date/Time:

4-24-13 13:50

Date/Time:

4-24-13 13:54

Date/Time:

4-24-13 13:58

Date/Time:

4-24-13 14:02

Date/Time:

4-24-13 14:06

Date/Time:

4-24-13 14:10

Date/Time:

4-24-13 14:14

Date/Time:

4-24-13 14:18

Date/Time:

4-24-13 14:22

Date/Time:

4-24-13 14:26

Date/Time:

4-24-13 14:30

Date/Time:

4-24-13 14:34

Date/Time:

4-24-13 14:38

Date/Time:

4-24-13 14:42

Date/Time:

4-24-13 14:46

Date/Time:

4-24-13 14:50

Date/Time:

4-24-13 14:54

Date/Time:

4-24-13 14:58

Date/Time:

4-24-13 15:02

Date/Time:

4-24-13 15:06

Date/Time:

4-24-13 15:10

Date/Time:

4-24-13 15:14

Date/Time:

4-24-13 15:18

Date/Time:

4-24-13 15:22

Date/Time:

4-24-13 15:26

Date/Time:

4-24-13 15:30

Date/Time:

4-24-13 15:34

Date/Time:

4-24-13 15:38

Date/Time:

4-24-13 15:42

Date/Time:

4-24-13 15:46

Date/Time:

4-24-13 15:50

Date/Time:

4-24-13 15:54

Date/Time:

4-24-13 15:58

Date/Time:

4-24-13 16:02

Date/Time:

4-24-13 16:06

Date/Time:

4-24-13 16:10

Date/Time:

4-24-13 16:14

Date/Time:

4-24-13 16:18

Date/Time:

4-24-13 16:22

Date/Time:

4-24-13 16:26

Date/Time:

4-24-13 16:30

Date/Time:

4-24-13 16:34

Date/Time:

4-24-13 16:38

Date/Time:

4-24-13 16:42

Date/Time:

4-24-13 16:46

Date/Time:

4-24-13 16:50

Date/Time:

4-24-13 16:54

Date/Time:

4-24-13 16:58

Date/Time:

4-24-13 17:02

Date/Time:

4-24-13 17:06

Date/Time:

4-24-13 17:10

Date/Time:

4-24-13 17:14

Date/Time:

4-24-13 17:18

Date/Time:

4-24-13 17:22

Date/Time:

4-24-13 17:26

Date/Time:

4-24-13 17:30

Date/Time:

4-24-13 17:34

Date/Time:

4-24-13 17:38

Date/Time:

4-24-13 17:42

Date/Time:

4-24-13 17:46

Date/Time:

4-24-13 17:50

Date/Time:

4-24-13 17:54

Date/Time:

4-24-13 17:58

WIS

SPL

BLK

OTH

PCB ONLY

SOXHLET

NON SOXHLET

WRTA

MWRA

AWRA

SCHOOL

MBTA

CITY

BROWNFIELD

21 J

BROWNSFIELD

1600

OTHER

1747

1748

1749

1750

1751

1752

1753

1754

1755

1756

1757

1758

1759

1760

1761

1762

1763

1764

1765

1766

1767

1768

1769

1770

1771

1772

1773

1774

1775

1776

1777

39 Spruce St.
East Longmeadow, MA. 01028
P: 413-525-2332
F:413-525-6405
www.pacelabs.com

Log In Back-Sheet

Login Sample Receipt Checklist – (Rejection Criteria Listing
– Using Acceptance Policy) Any False statement will be
brought to the attention of the Client – True or False



Client EA Engineering
Project Alvarez High School
MCP/RCP Required _____
Deliverable Package Requirement _____
Location Providence, RI
PWSID# (When Applicable) _____
Arrival Method COURIER
Received By / Date / Time MEM 4-24-23 1817
Back-Sheet By / Date / Time KMC 4-25-23 0915
Temperature Method _____ # _____
Temp < 6°C Actual Temperature _____
Rush Samples: Yes No _____ Notify _____
Short Hold: Yes No _____ Notify _____

Notes regarding Samples/COC outside of SOP:

	True	False
Received on Ice	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Received in Cooler	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Custody Seal: DATE TIME	<input type="checkbox"/>	<input checked="" type="checkbox"/>
COC Relinquished	<input checked="" type="checkbox"/>	<input type="checkbox"/>
COC/Samples Labels Agree	<input checked="" type="checkbox"/>	<input type="checkbox"/>
All Samples in Good Condition	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Samples Received within Holding Time	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Is there enough Volume	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Proper Media/Container Used	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Individually Certified Cans (15)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Trip Blanks	<input type="checkbox"/>	<input checked="" type="checkbox"/>
COC Legible	<input checked="" type="checkbox"/>	<input type="checkbox"/>
COC Included: (Check all included)		
Client <input checked="" type="checkbox"/>	Analysis <input type="checkbox"/>	Sampler Name <input type="checkbox"/>
Project <input checked="" type="checkbox"/>	IDs <input type="checkbox"/>	Collection Date/Time <input type="checkbox"/>

Container	#	Size	Regulator	Duration	Accessories			
Summa Cans	15	6L	15	30 min	Nut/Ferrule		IC Train	15
Tedlar Bags					Tubing			
TO-17 Tubes					T-Connector		Shipping Charges	
Radiello					Syringe			
Pufs/ TO-11					Tedlar			

Can #'s	8	1222	16		24		Regs #'s	8	4551	16		24
1 1259	9	1190	17		25		1 4184	9	4185	17		25
2 9004	10	2139	18		26		2 4579	10	4670	18		26
3 9002	11	1987	19		27		3 4580	11	4669	19		27
4 1991	12	9006	20		28		4 4589	12	4746	20		28
5 1176	13	1884	21		29		5 4590	13	4275	21		29
6 2160	14	1163	22		30		6 4741	14	4286	22		30
7 2144	15	9015	23		31		7 4740	15	4747	23		31
Unused Media	8		16		24		Pufs/TO-17's	8		16		24
1	9		17		25		1	9		17		25
2	10		18		26		2	10		18		26
3	11		19		27		3	11		19		27
4	12		20		28		4	12		20		28
5	13		21		29		5	13		21		29
6	14		22		30		6	14		22		30
7	15		23		31		7	15		23		

APPENDIX F

Laboratory MRL Correspondence



39 Spruce Street
East Longmeadow, MA 01089

June 9, 2023

Frank Postma
EA Engineering Science & Technology
2350 Post Road
Warwick, RI 02886
RE: RIDEM – Approved Action Level – Work Order 23D2794

Dear Mr. Postma:

This letter is in response to the RIDEM – Approved Action Levels provided. Several of the compounds, appear to be beyond the scope of the current methodologies available, as well as, the current analytical instrumentation available for these methods. The following compounds that Con-Test, A Pace Analytical Laboratory had issues meeting the limits are listed below:

Bromodichloromethane
1,1,2,2-Tetrachloroethane
1,1,1,2-Tetrachloroethane
1,2-Dibromoethane

If you have any questions please feel free to call me at (413) 525-2332 ext. 41.

Sincerely,

A handwritten signature in black ink that reads "Tod Kopyscinski".

Tod Kopyscinski
Laboratory Director